



ADDENDUM NO. 1 TO PROJECT NO. 44185

CONSTRUCTION WORK, HVAC WORK AND ELECTRICAL WORK

**PROVIDE VENTILATION, MAIN SCHOOL BUILDING
VARIOUS DOCCS FACILITIES**

March 8, 2013

NOTE: This Addendum forms a part of the Contract Documents. Insert it in the Project Manual. Acknowledge receipt of this Addendum in the space provided on the Bid Form.

SPECIFICATIONS – All Contracts

1. Page 011000-1, Article 1.02.A: Change referenced contracts to 44185-C, H and E.
2. Page 011000-3, Article 1.06.B.1: Delete the sentence “The above period will not be included in the number of days specified for completion of the Work of all contracts”.
3. Page 087100-5, Article 2.04: Add the following:
Group 2
 1. Continuous Hinge: 1 ea. - Markar FM300HT x CHS-1 x torx x 630 x marked “TOP”
 2. Mortise Lockset: 1 ea. - Corbin Russwin ML2022 (storedoor) x YWM x less cylinders x M17 x M04 x 630.
 3. Mortise Cylinder: 2 ea. - Compatible with above specified lockset and Facility’s existing key system x 626.
 4. Security Closer: 1 ea - LCN 4214 x CNS3077 x SRI x AL x torx.
 5. Threshold: 1 – ea Zero 548A x torx.
 6. Door Bottom: 1 – ea Zero 39A x torx.
 7. Perimeter Gasketing: 1 set DHSI 105 anti-ligature x brown (2 finger at hinge jamb.)

ELECTRICAL CONTRACT SPECIFICATIONS

1. 283105 MODIFICATIONS TO FIRE ALARM SYSTEM:
 - a. Page 283105-5, Article 1.11 MAINTENANCE
– Change
“A. Spare Parts”
To
“A. Spare Parts (Per Facility):”

CONSTRUCTION WORK DRAWINGS

1. Drawing A-502:
 - a. Details 1, 1A, and 5, Add the following note with an arrow pointing to the GWB on each side of the existing building end wall:

“IN THE AREA OF THE ADDITION: PROVIDE 1 LAYER OF 5/8" TYPE 'X' GYP.BD. EACH SIDE OF WALL AS REQUIRED FOR THE WALL TO HAVE A 1 HOUR FIRE RATING PER UL DESIGN "W1B-1 hr T-U309".”

2. Drawing A-601:
 - a. BUILDING ADDITION, DOOR SCHEDULE:

Revise Detail references as indicated below:

Door No	Head Detail	Jamb Detail	Sill Detail	HDWE
E1	2/A-702	3/A-702	4/A-702	2

3. Addendum Drawings:
 - a. Drawings A-701 and A-702, both noted “TEMPORARY CONSTRUCTION MEANS OF EGRESS: PLANS, SECTIONS, ELEVATIONS & DETAILS”, accompany this Addendum and forms part of the Contract Documents.

4. Drawings S-101 and S-102:
 - a. Change note heading “EARTHWORK-SITE WORK-DIV 2” to read “EARTHWORK-SITE WORK-DIV 31.”
 - b. Delete MASONRY-DIV 4 note 2.c.
 - c. Change last sentence in MASONRY-DIV 4 note 13 from “PROVIDE COARSE GROUT FOR REINFORCED CORES IN 8” CMU AND LARGER.” to read “PROVIDE COARSE GROUT FOR UN-REINFORCED CORES IN 8” CMU AND LARGER.”

5. Drawing S-201:
 - a. SECTION 2/S201: Change “1/2” EXP. JOINT WITH TYPE 1B SEALANT” to read “1/2” EXP. JOINT WITH TYPE 1A SEALANT.”
 - b. Replace detail “TYP. MASONRY WALL REINFORCEMENT ELEVATION” with the detail shown on drawing S-202 accompanying this Addendum.
 - c. Add detail “TYPICAL SLAB WALL EXPANSION JOINT” shown on drawing S-202 accompanying this Addendum.

ELECTRICAL WORK DRAWINGS

1. E-101:
 - a. “CONDUIT AND CONDUCTOR SCHEDULE”
 - For circuit designation no.3, change “3-#2” to “4-#2”.

2. E-104:
 - a. “CONDUIT AND CONDUCTOR SCHEDULE”
 - For circuit designation no.3, change “3-#2” to “4-#2”.
 - For circuit designation no.4, change “3-4/0” to “4-4/0”.

ADDENDUM NO. 1 TO PROJECT NO. 44185

- For circuit designation no.4, change “2” C” to “2-1/2” C”.
3. E-107:
- a. “CONDUIT AND CONDUCTOR SCHEDULE”
 - For circuit designation no.3, change “3-#2” to “4-#2”.
 - For circuit designation no.4, change “3-1/0” to “4-1/0”.
 - For circuit designation no.4, change “1-1/2” C” to “2” C”.
 - Add circuit designation no.5.
 - For circuit designation no. 5, under the “CONDUCTOR” heading , add “2-#10 1#10 EGC”
 - For circuit designation no. 5, under the “RIGID STEEL CONDUIT” heading, add “1/2” C”
 - b. “SPECIFIC NOTES:”:
 - Change
“3. PROVIDE (1) – 1 POLE 20 ATE CIRCUIT BREAKER IN LIGHTING PANEL, LP-3, LOCATED IN THE ELECTRICAL ROOM.”
To
“3. PROVIDE (1) – 1 POLE 40 ATE CIRCUIT BREAKER IN LIGHTING PANEL, LP-3, LOCATED IN THE ELECTRICAL ROOM.”
 - c. “PANELBOARD SCHEDULE (LP-3)”:
 - For location no.2 (“PUMP 1 MOTOR CONTROLLER”), change “20” to “40”.
 - For location no.4 (“PUMP 2 MOTOR CONTROLLER”), change “20” to “40”.
 - d. “FLOOR PLAN – MARCY CF BLDG. NO. 26”:
 - In room assigned “MECHANICAL”
Change
circuit designation “2”
To
circuit designation “5”.
4. E-103, E-106, E-109:
- a. GENERAL NOTES
 - Change
“C. LOCATE FIRE ALARM DEVICES AS DIRECTED BY FIRE ALARM COMPANY FURNISHING DEVICES”
To
“C. LOCATE FIRE ALARM DEVICES SO AS TO ALLOW ACCESS FOR MAINTENANCE.”
 - b. SPECIFIC NOTES:
 - Add
“4. COORDINATE LOCATION OF AIR DUCT SMOKE SENSORS WITH MECHANICAL CONTRACTOR.”
 - c. ONE-LINE NOTES:
 - Change
“1. INDIVIDUAL ADDRESSABLE MODULE AND INTERMEDIATE RELAY IN JUNCTION BOXES LOCATED ADJACENT TO DISCONNECT FOR AAH-1 AS DIRECTED.”

ADDENDUM NO. 1 TO PROJECT NO. 44185

To

“1. INTERMEDIATE RELAY IN JUNCTION BOX LOCATED NEXT TO LC-AAH AS DIRECTED.”

5. E-103:

- a. “FIRE ALARM – CAYUGA CF BLDG. NO. 4”
 - Add leader, with text to read “NOTE 4 (TYP)”, to one symbol for AIR DUCT SMOKE SENSORS.
- b. “FIRE ALARM – CAYUGA CF BLDG. NO. 4”
 - Remove symbol for Individual Addressable Module, IAM.
- c. “FIRE ALARM ONE-LINE – CAYUGA CF BLDG. NO. 4”
 - Replace detail with detail on drawing E-110, noted “REVISED DETAIL FIRE ALARM ONE-LINE 3/6/2013”.

6. E-106:

- a. “FIRE ALARM – MARCY CF BLDG. NO. 4”
 - Add leader, with text to read “NOTE 4 (TYP)”, to one symbol for AIR DUCT SMOKE SENSORS.
- b. “FIRE ALARM – MARCY CF BLDG. NO. 4”
 - Remove symbol for Individual Addressable Module, IAM.
- c. “FIRE ALARM ONE-LINE – MARCY CF BLDG. NO. 4”
 - Replace detail with detail on drawing E-110, noted “REVISED DETAIL FIRE ALARM ONE-LINE 3/6/2013”.

7. E-109:


- a. “FIRE ALARM – MARCY CF BLDG. NO. 26”
 - Add leader, with text to read “NOTE 4 (TYP)”, to one symbol for AIR DUCT SMOKE SENSORS.
- b. “FIRE ALARM – MARCY CF BLDG. NO. 26”
 - Remove symbol for Individual Addressable Module, IAM.
- c. “FIRE ALARM ONE-LINE – MARCY CF BLDG. NO. 26”
 - Replace detail with detail on drawing E-110, noted “REVISED DETAIL FIRE ALARM ONE-LINE 3/6/2013”.

8. ADDENDUM DRAWINGS:


- a. E-110:
 - Drawing E-110, noted “REVISED DETAIL FIRE ALARM ONE-LINE 3/6/2013” accompanies this addendum and forms part of the Contract Documents.
- b. E-500:
 - Drawing E-500, noted “ADDENDUM 1 3/6/213” accompanies this addendum and supersedes the same numbered originally issued drawing.
- c. E-701:
 - Drawing E-701, noted “ADDENDUM 1 3/6/213” accompanies this addendum and supersedes the same numbered originally issued drawing.

END OF ADDENDUM

James Dirolf, P.E.
Director of Design

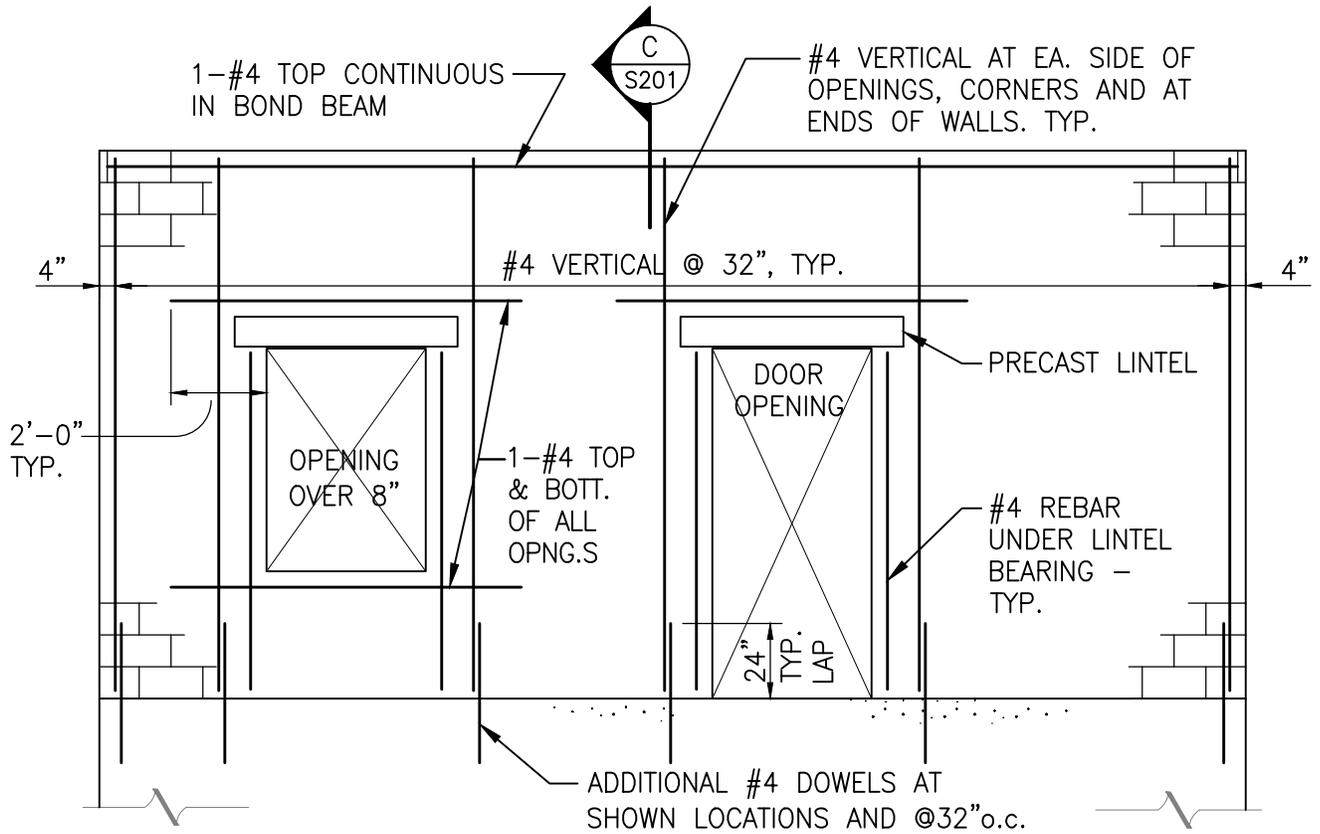


TYP. MASONRY WALL REINFORCEMENT ELEVATION

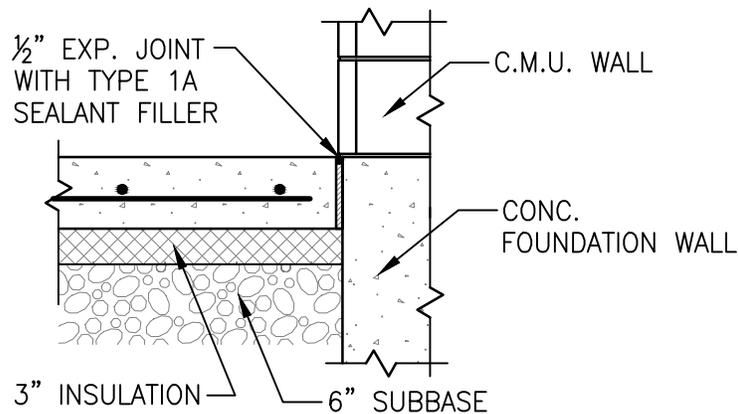


TYPICAL SLAB WALL EXPANSION JOINT

SCALE: 3/4"=1'-0"


 <p>OGS NYS OFFICE OF GENERAL SERVICES Serving New York</p>	SHEET TITLE: DETAILS ADDENDUM 1	
	PROJECT: PROVIDE VENTILATION MAIN SCHOOL BUILDINGS VARIOUS DOCCS FACILITIES	
	WARNING: THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS 'A' MISDEMEANOR.	
	DWG NO: S-202	
CONTRACT: CONSTRUCTION		
PROJ. NO: 44185-C		
DATE: 3/6/2013		
DRAWN: JN		
APPROVED: M. ERNST		

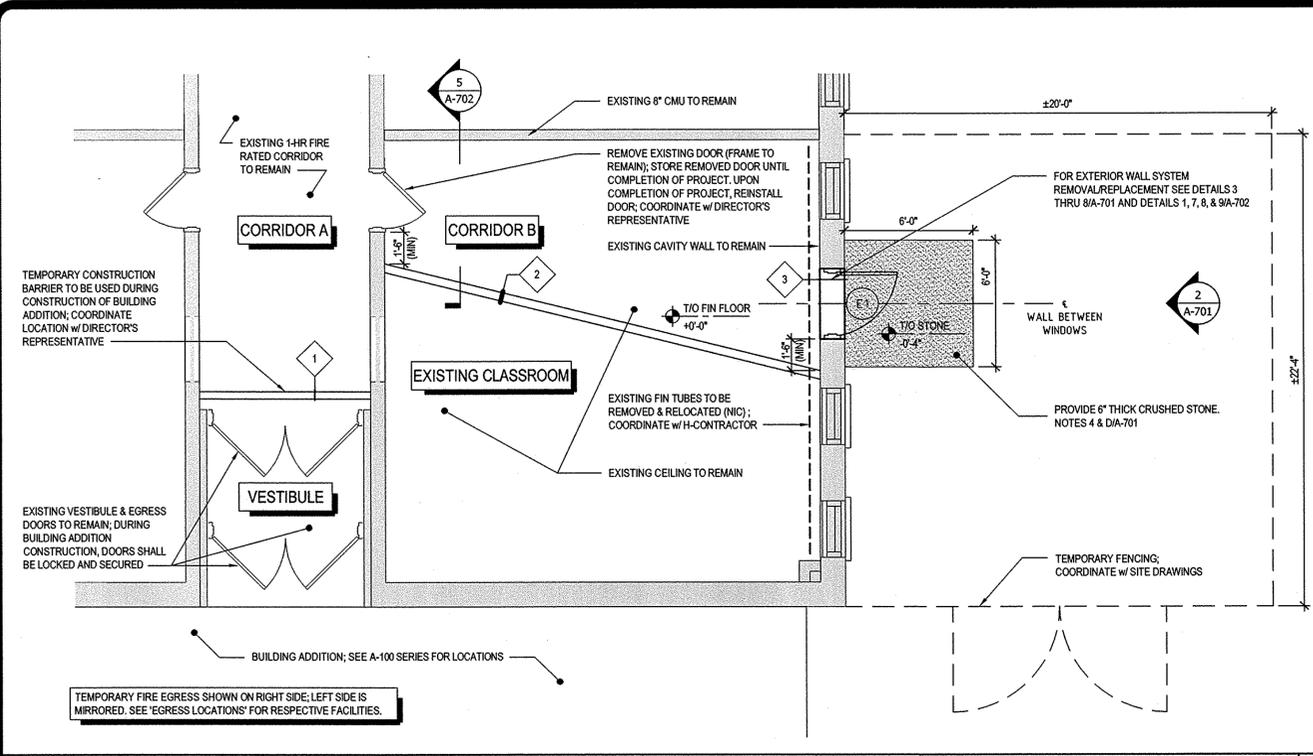


ENLARGED PLAN @ PROVIDED TEMPORARY FIRE EGRESS

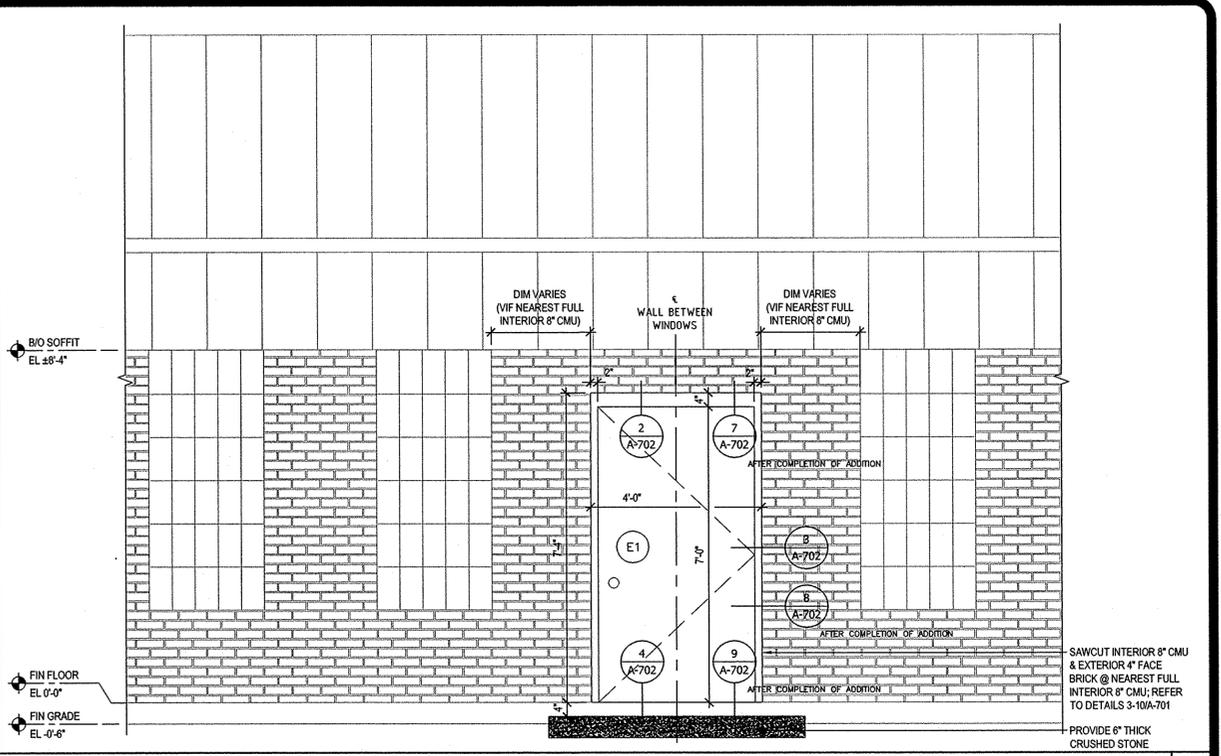


ELEVATION @ EXIT DOOR

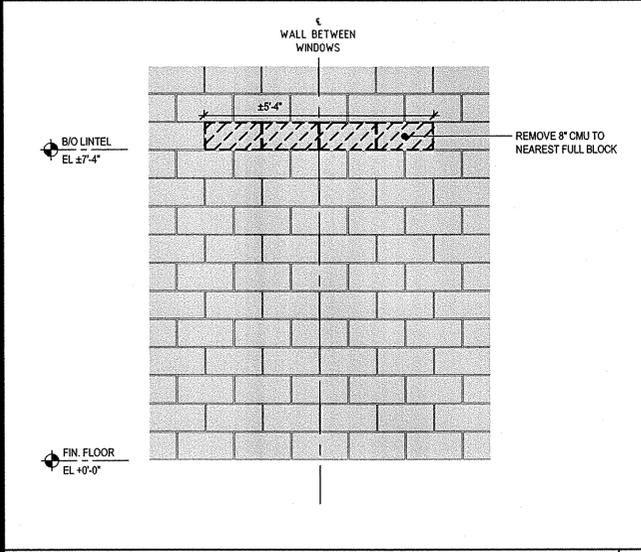


PHASE 1 @ 8" CMU REMOVAL (INTERIOR)

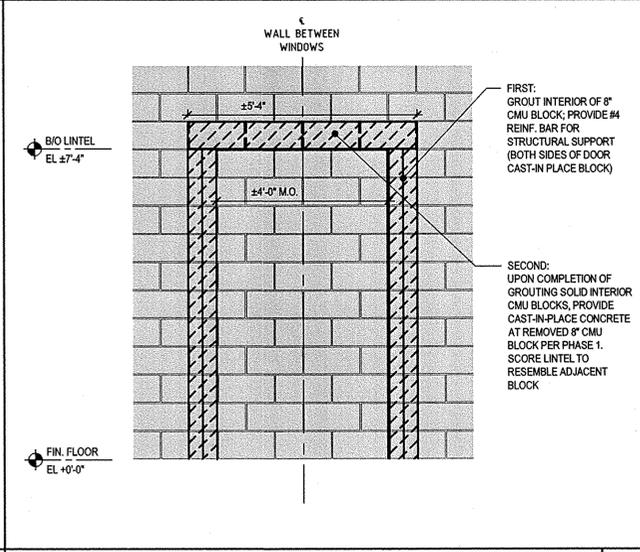


PHASE 2 @ CMU REMOVAL (INTERIOR)

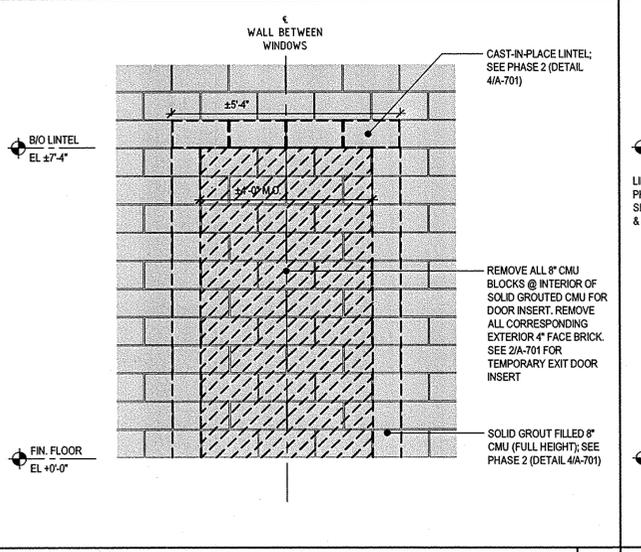


PHASE 3 @ CMU REMOVAL (INTERIOR)

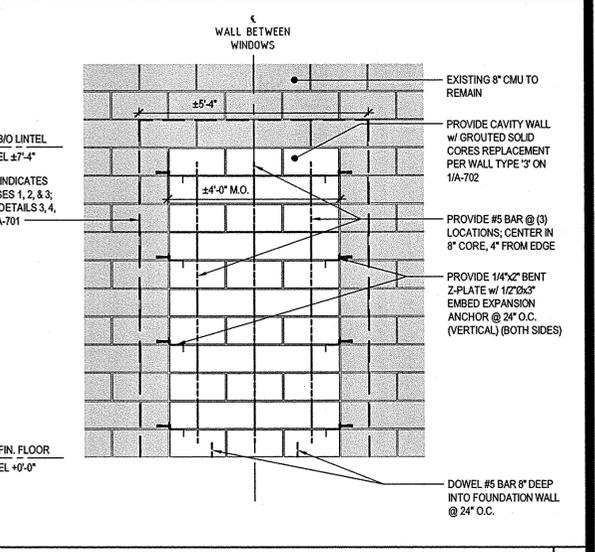

PHASE 4 @ 8" CMU INFILL (INTERIOR)

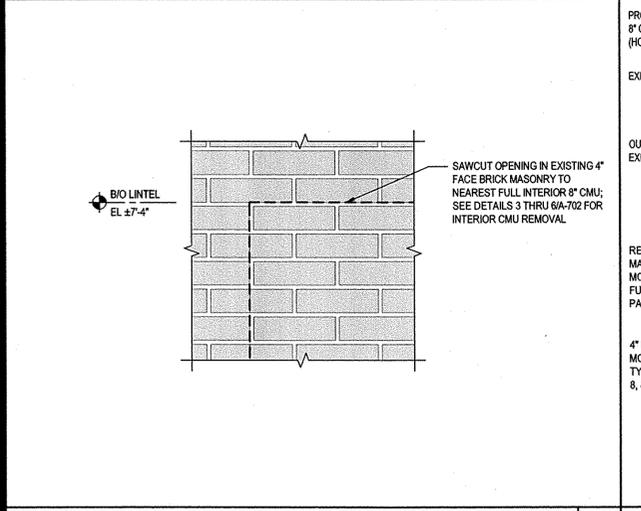

PHASE 3 @ BRICK REMOVAL (EXTERIOR)

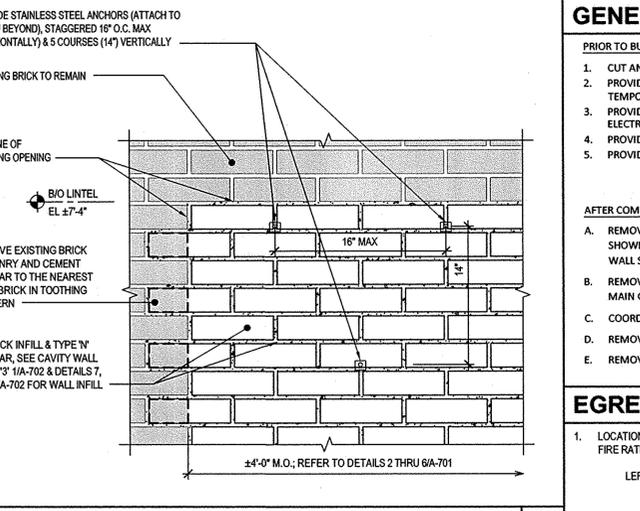

PHASE 4 @ BRICK INFILL (EXTERIOR)

GENERAL NOTES

PRIOR TO BUILDING ADDITION WORK:

- CUT AND REMOVE PORTION OF EXISTING EXTERIOR MASONRY WALL AS REQUIRED TO PROVIDE LINTEL, DOOR FRAME, THRESHOLD AND DOOR 'E1' AS SHOWN; SEE DETAILS 3 THRU 8/A-701.
- PROVIDE TEMPORARY 1 HOUR FIRE RATED CORRIDOR: (1) TYPE '2' WALL PARTITION AND A FULL WIDTH CEILING STRUCTURE, EXTENDING FROM EXISTING CORRIDOR TO TEMPORARY EXIT DOORWAY AS SHOWN IN SECTION 5/A-702 & ENLARGED PLAN 1/A-701. TEMPORARY LIGHTING AND EXIT SIGNAGE ARE BY OTHERS (NIC). COORDINATE W/ ELECTRICAL CONTRACTOR.
- PROVIDE TEMPORARY CONSTRUCTION BARRIER WALL TYPE '1' TO CLOSE OFF THE EXISTING CORRIDOR 'A' & VESTIBULE, FULL HEIGHT AND WIDTH OF THE CORRIDOR. SEE ENLARGED PLAN DETAIL 1/A-701. COORDINATE EXIT SIGNAGE REQUIRED BY OTHERS (NIC) W/ ELECTRICAL CONTRACTOR.
- PROVIDE A TEMPORARY COMPACTED 6" X 6" X 6" THICK CRUSHED STONE EXTERIOR PAD CENTERED IN FRONT OF THE TEMPORARY DOORWAY; SEE DETAIL 1/A-701.
- PROVIDE TEMPORARY 8'-0" HIGH CHAIN LINK FENCE. SEE DETAIL 1/A-701, REFER TO SITE DRAWINGS.

AFTER COMPLETION OF BUILDING ADDITION:

- REMOVE TEMPORARY DOOR 'E1', DOOR FRAME, AND THRESHOLD IN THEIR ENTIRETY; TURN DOOR 'E1', FRAME, AND THRESHOLD OVER TO FACILITY. REMOVE EXTERIOR STEEL ANGLE. CAST-IN-PLACE LINTEL TO REMAIN. INFILL REMAINING MASONRY OPENING AS SHOWN IN DETAILS 6/A-701 & CAVITY WALL TYPE '3' 1/A-702. TOOTH-IN EXTERIOR BRICK VENER FLUSH WITH EXTERIOR WALL SURFACE W/ BRICK TO MATCH EXISTING IN SIZE, COLOR, TEXTURE, & COURSING. PROVIDE 8" CMU ON THE INTERIOR FLUSH W/ INTERIOR WALL SURFACE W/ BUCK ANCHORS SPACED AT 16" O.C. VERTICALLY.
- REMOVE TEMPORARY CORRIDOR CONSTRUCTION BARRIERS, WALLS AND CEILING IN THEIR ENTIRETY. PATCH ALL HOLES IN WALLS AND CEILINGS WHERE DAMAGED BY FASTENERS. PAINT THE ENTIRE CLASSROOM ROOM WITH IAL-3 SYSTEM TO MATCH EXISTING. PAINT MAIN CORRIDOR WITH IAL-3 SYSTEM TO MATCH EXISTING AT PATCHED AREAS ONLY. REMOVE ALL VCT TILES DAMAGED FROM FASTENERS, AND PROVIDE VCT TO MATCH EXISTING. VERIFY VCT FLOORING W/ DIRECTOR'S REPRESENTATIVE.
- COORDINATE ALL REMOVAL OF TEMPORARY ELECTRICAL ITEMS AND REQUIRED ELECTRICAL WORK TO RESTORE LIGHTING FIXTURES AND SIGNAGE BACK TO ORIGINAL W/ ELECTRICAL CONTRACTOR. ALL ELECTRICAL WORK IS BY OTHERS (NIC).
- REMOVE EXTERIOR STONE PAD IN ITS ENTIRETY. TURN STONE OVER TO FACILITY AND STORE STONE AS DIRECTED BY DIRECTOR'S REP. RESTORE GROUNDS AND SEED AS REQUIRED.
- REMOVE TEMPORARY FENCING. RESTORE GROUNDS AND SEED AS REQUIRED.


EGRESS LOCATIONS

1. LOCATIONS LISTED BELOW INDICATE EGRESS SIDE FOR CONSTRUCTION OF TEMPORARY 1-HR FIRE RATED CORRIDOR. LOCATIONS MARKED AS 'LEFT SIDE' ARE MIRRORED FROM 'RIGHT SIDE'

LEFT SIDE	RIGHT SIDE
• CAYUGA CF, BUILDING 14	• MARCY CF, BUILDING 4
	• MARCY CF, BUILDING 26


CONSULTANT

WARNING:
THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS 'A' MISDEMEANOR.

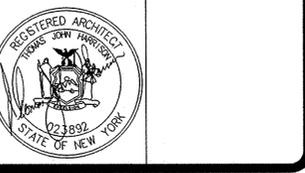

CONTRACT: **CONSTRUCTION**
TITLE: PROVIDE VENTILATION MAIN SCHOOL BUILDINGS
LOCATION: VARIOUS DOCCS FACILITIES
CLIENT: NYS DEPARTMENT OF CORRECTIONS AND COMMUNITY SUPERVISION

PROJECT NUMBER:	44185 - C
DESIGNED BY:	ME
DRAWN BY:	ME/OMM
FIELD CHECK:	
APPROVED:	
SHEET TITLE:	TEMPORARY CONSTRUCTION MEANS OF EGRESS: PLANS, SECTIONS, ELEVATIONS & DETAILS
DRAWING NUMBER:	A-701
SHEET	OF

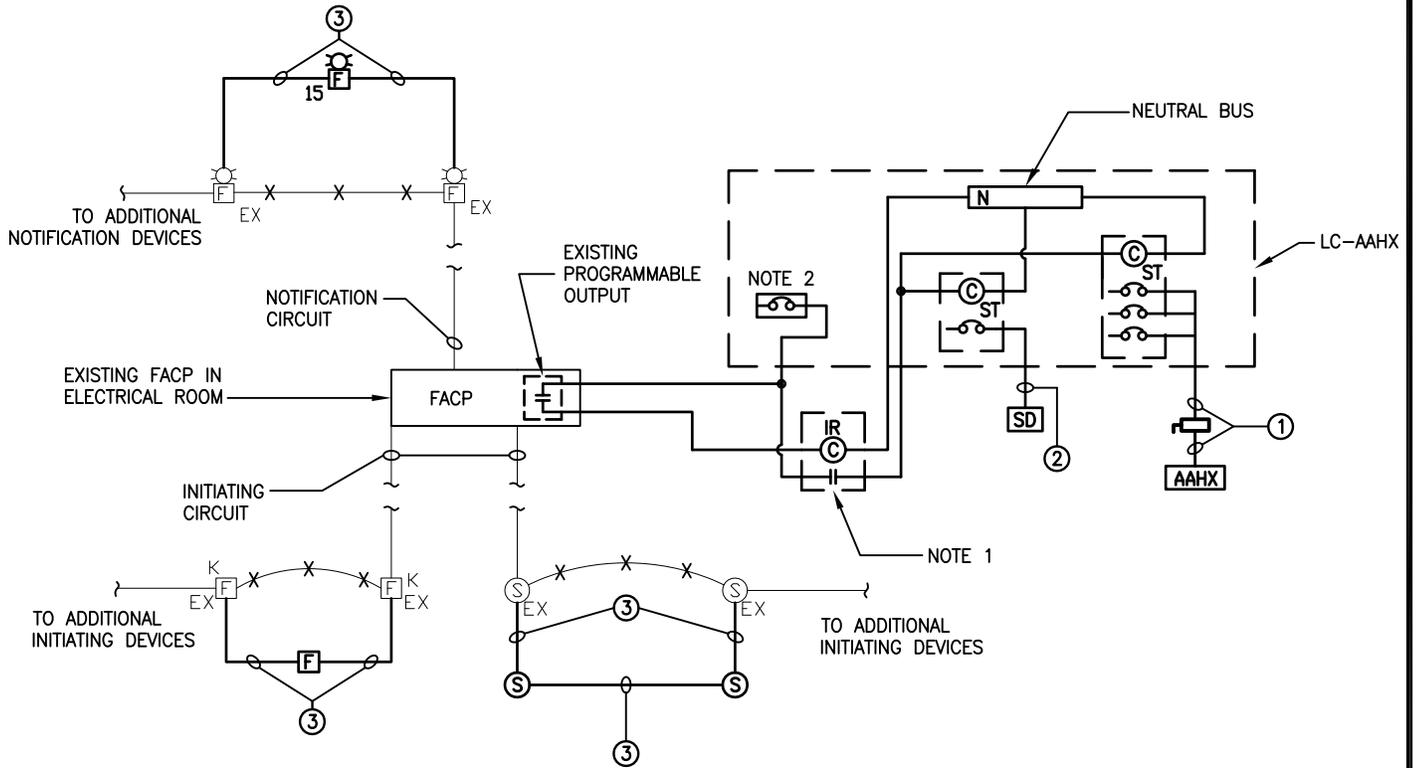

NYS OFFICE OF GENERAL SERVICES

Serving New York

CONTRACT: ELECTRICAL
 PROJ. NO: 44185-E
 DATE: 3/6/2013
 DRAWN: G. BRADLEY
 APPROVED: -

SHEET TITLE: REVISED DETAIL
 FIRE ALARM
 ONE-LINE

PROJECT: PROVIDE VENTILATION
 MAIN SCHOOL BUILDINGS
 BUILDING NO. 4 OR 26

WARNING: THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS 'A' MISDEMEANOR.

DWG NO:
 E-110


CONSULTANT

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS 'A' MISDEMEANOR.




CONTRACT: **ELECTRICAL**
 TITLE: PROVIDE VENTILATION MAIN SCHOOL BUILDINGS BUILDING NO. 4 OR 26
 LOCATION: VARIOUS DOCCS FACILITIES
 CLIENT: NYS DEPARTMENT OF CORRECTIONS AND COMMUNITY SUPERVISION


MARK	DATE	DESCRIPTION
	3/6/2013	ADDENDUM 1
	2/6/2013	BID DOCUMENT
PROJECT NUMBER:	44185 - E	
DESIGNED BY:	G. BRADLEY	
DRAWN BY:	G. BRADLEY	
FIELD CHECK:		
APPROVED:		
SHEET TITLE:	DETAILS	
DRAWING NUMBER:	E-500	
SHEET 10	OF 11	

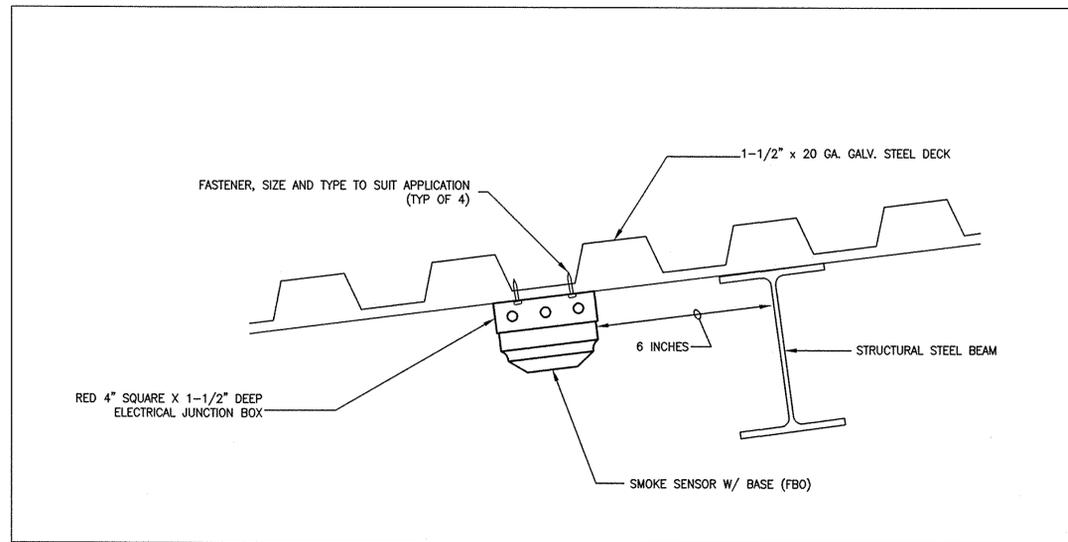


SMOKE SENSOR MOUNTING DETAIL (A)
 NOT TO SCALE

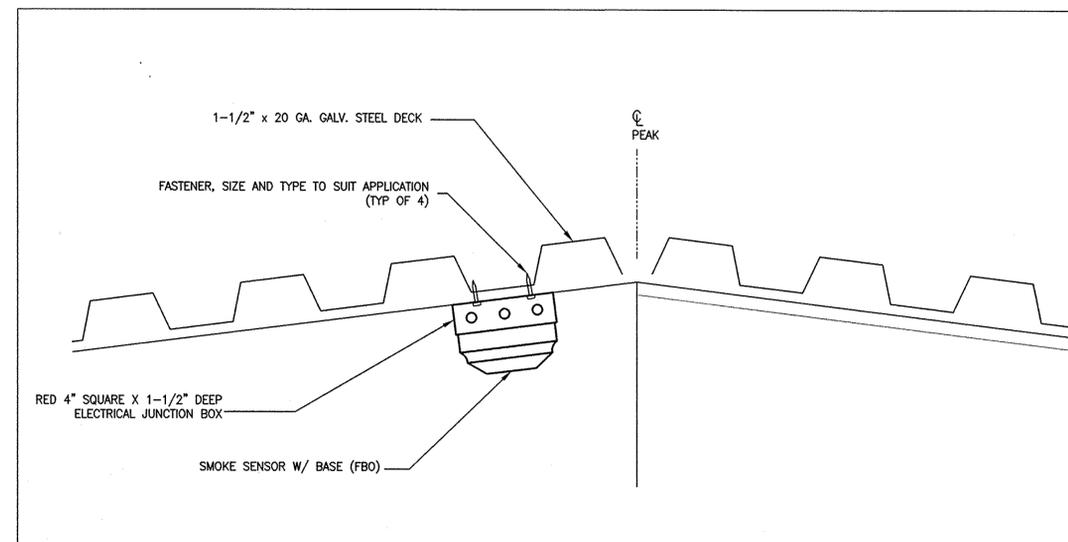


SMOKE SENSOR MOUNTING DETAIL (B)
 NOT TO SCALE

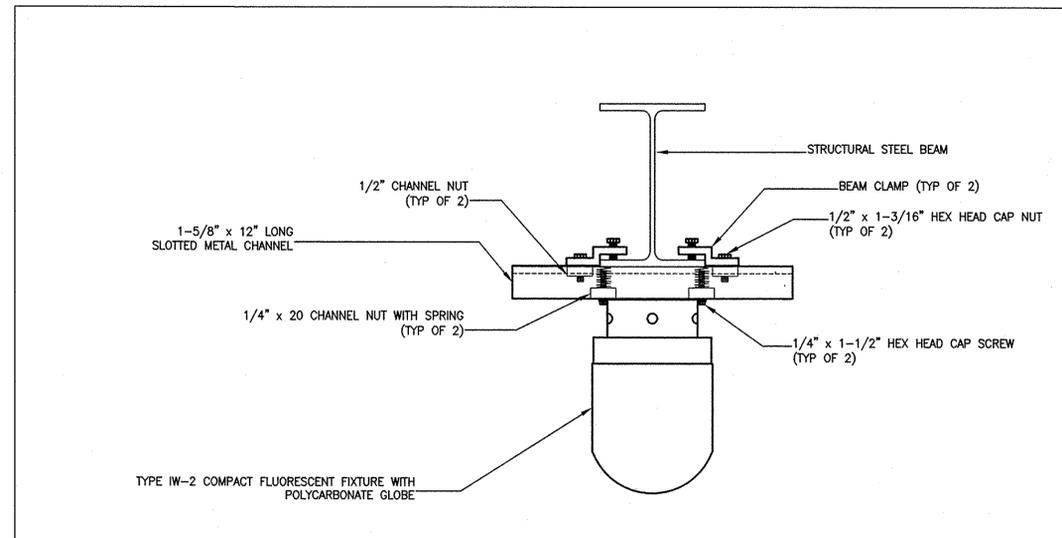

TYPE IW-1 LIGHT FIXTURE MOUNTING DETAIL
 NOT TO SCALE

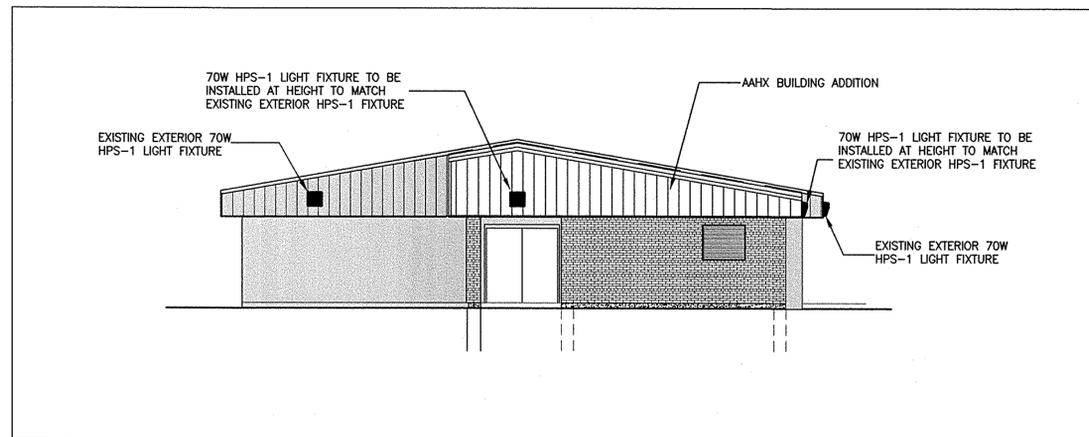

HPS-1 LIGHT FIXTURE MOUNTING LOCATION - CAYUGA CF
 NOT TO SCALE

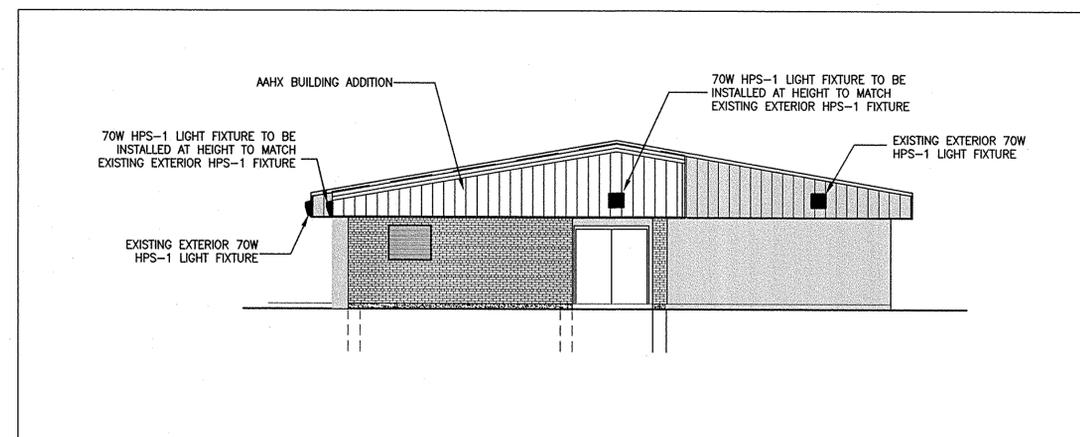


HPS-1 LIGHT FIXTURE MOUNTING LOCATION - MARCY CF
 NOT TO SCALE

LIGHTING - TEMPORARY EGRESS PATH

SCALE: 1/8" = 1'-0"


- MARCY CORRECTIONAL FACILITY, BLDG. NO. 4
(SEE DRAWING E-105 FOR COMPLETE FLOOR PLAN)
- MARCY CORRECTIONAL FACILITY, BLDG. NO. 26
(SEE DRAWING E-108 FOR COMPLETE FLOOR PLAN)

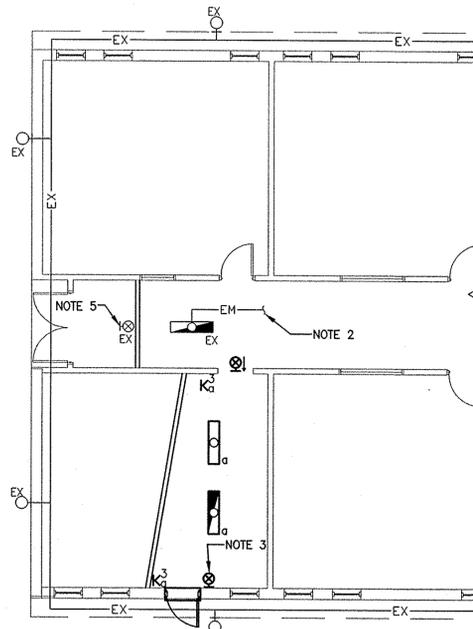

LIGHTING - TEMPORARY EGRESS PATH

SCALE: 1/8" = 1'-0"

- CAYUGA CORRECTIONAL FACILITY, BLDG. NO. 4
(SEE DRAWING E-102 FOR COMPLETE FLOOR PLAN)

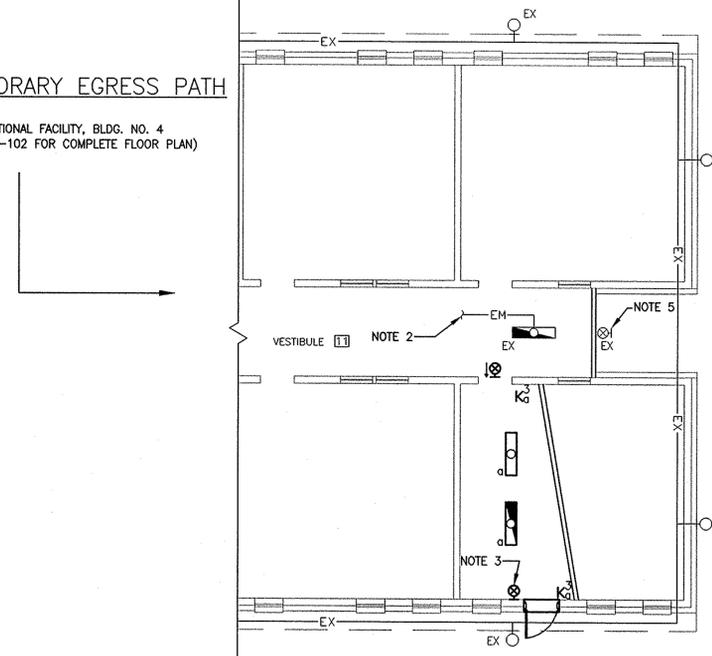

GENERAL NOTES:

(THIS DRAWING ONLY)

- CAPITAL LETTER(S) OR LETTERS AND NUMERALS INDICATE FIXTURE TYPE.
- LOWER CASE LETTER INDICATES SWITCHING ARRANGEMENT.
- EMERGENCY LIGHTING UNIT SHALL BE CONNECTED TO UNSWITCHED CIRCUIT CONDUCTORS.
- FIXTURE SUPPLIED BY BOTH THE NORMAL AND EMERGENCY LIGHTING SYSTEMS. FIXTURE WITH 2 BALLASTS, ONE CONNECTED TO THE NORMAL LIGHTING SYSTEM AND ONE CONNECTED TO THE EMERGENCY LIGHTING SYSTEM.
- DO NOT COMBINE EMERGENCY CONDUCTORS (FROM CBU) AND NORMAL POWER CONDUCTORS IN THE SAME RACEWAYS.
- AFTER REMOVAL OF TEMPORARY EGRESS PATH, HAND OVER ALL MATERIAL TO FACILITY OR AS DIRECTED BY THE DIRECTOR'S REPRESENTATIVE.
- CONTRACTOR SHALL PROVIDE FIRESTOPPING FOR ALL PENETRATIONS.
- FOR ALL TEMPORARY PENETRATIONS:
 - CUT AND ALTER EXISTING MATERIALS AS REQUIRED TO PERFORM THE WORK. LIMIT CUTTING TO SMALLEST AMOUNT NECESSARY.
 - PERFORM CUTTING AND REMOVING IN A MANNER WHICH WILL PREVENT DAMAGE TO CONSTRUCTION AND SURROUNDING SURFACES WHICH ARE TO REMAIN.
 - PATCH EXISTING CONSTRUCTION AND FINISHES DEFACED AND/OR DAMAGED DUE TO ALTERATIONS AND REMOVALS. FINISH PATCHED SURFACES TO MATCH EXISTING, ADJACENT SURFACES AS CLOSELY AS PRACTICABLE.
 - PAINT PATCHED AREAS TO MATCH EXISTING, ADJACENT SURFACES AS CLOSELY AS PRACTICABLE.
 - CONDITION OF AREAS WHERE WORK IS TO BE COMPLETED IS TO BE IN EQUAL TO OR BETTER THAN CONDITION BEFORE WORK WAS CONDUCTED.


SPECIFIC NOTES:

(THIS DRAWING ONLY)

- FOR FLUORESCENT EMERGENCY LIGHTING FIXTURE CONDUCTORS: CONNECT TO EMERGENCY LIGHTING CIRCUIT SIDE OF THE CLOSEST, EXISTING FLUORESCENT EMERGENCY LIGHTING FIXTURE.


FOR EXIT SIGN CONDUCTORS: CONNECT TO EMERGENCY CIRCUIT CONDUCTORS OF THE CLOSEST, EXISTING EXIT SIGN.
- THE EXISTING EMERGENCY LIGHTING CIRCUIT EXTENDS TO THE EMERGENCY LIGHTING CIRCUIT SIDE OF EXISTING FLUORESCENT LIGHTING FIXTURES THEN TO THE EXISTING CBU, LOCATED IN THE ELECTRICAL ROOM.
- MOUNT EXIT SIGN ABOVE CENTER OF EXTERIOR DOOR. IF BOTTOM OF EXIT SIGN IS LESS THAN 7'-4" ABOVE FINISHED FLOOR, OFF-SET MOUNTING TO LOCATION AS SHOWN.
- PROVIDE CONDUIT AND CONDUCTORS BACK TO EXISTING ELECTRICAL ROOM.
PROVIDE (1) - SINGLE POLE 20 ATE CIRCUIT BREAKER IN AVAILABLE SPACE IN EXISTING LIGHTING PANELS, LOCATED IN THE ELECTRICAL ROOM, AS FOLLOWS:
a) CAYUGA CF - LP-2 SECTION 2

PROVIDE (1) - SINGLE POLE 20 ATE CIRCUIT BREAKER IN LIGHTING PANEL 'LP-3', THAT IS TO BE PROVIDED UNDER THIS CONTRACT. COORDINATE INSTALLATION OF LIGHTING PANEL 'LP-3' AND THE CONSTRUCTION OF THE TEMPORARY EGRESS PATH WITH CONSTRUCTION AND MECHANICAL CONTRACTORS.
a) MARCY CF - BLDG. NO. 4
b) MARCY CF - BLDG. NO. 26
- REMOVE AND RE-INSTALL THE EXISTING EXIT SIGN TO ALLOW FOR THE INSTALLATION OF THE TEMPORARY WALL BEING PROVIDED BY THE C-CONTRACT.

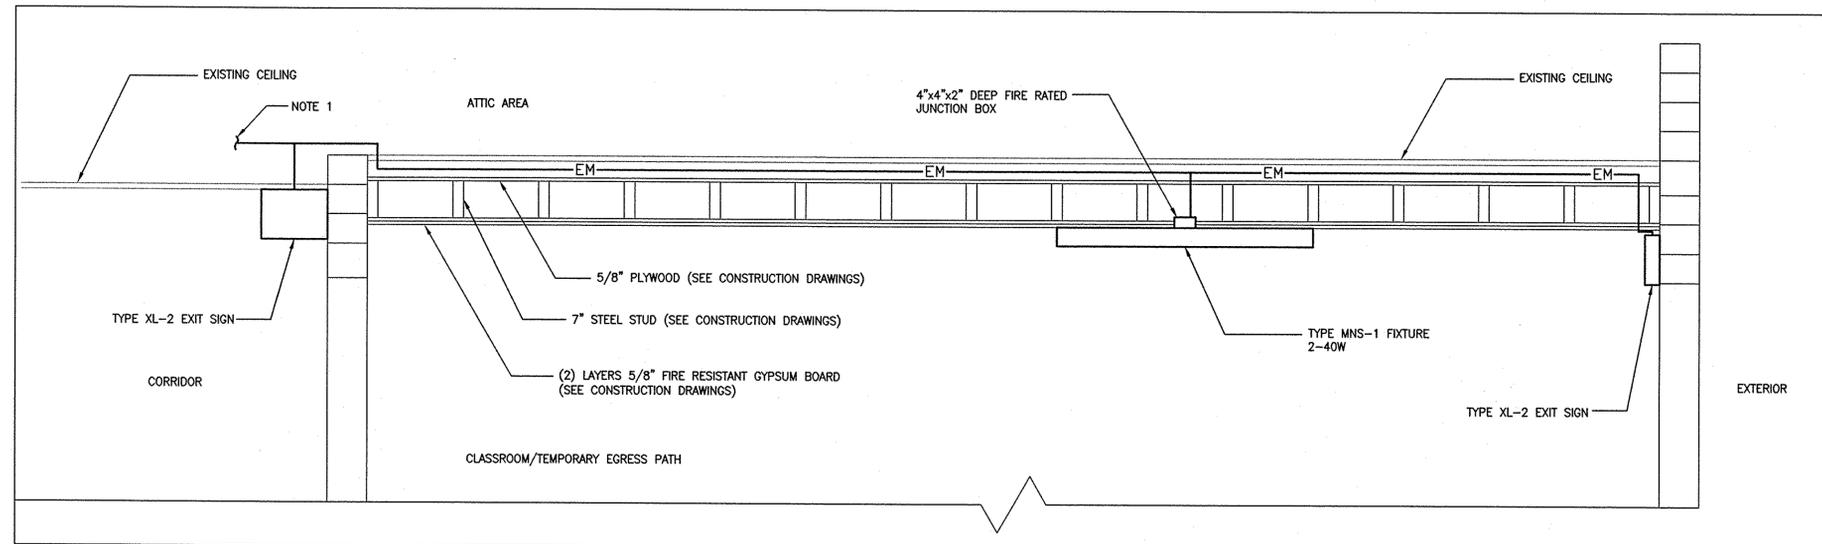


EMERGENCY LIGHTING SYSTEM - TEMPORARY EGRESS PATH

NOT TO SCALE

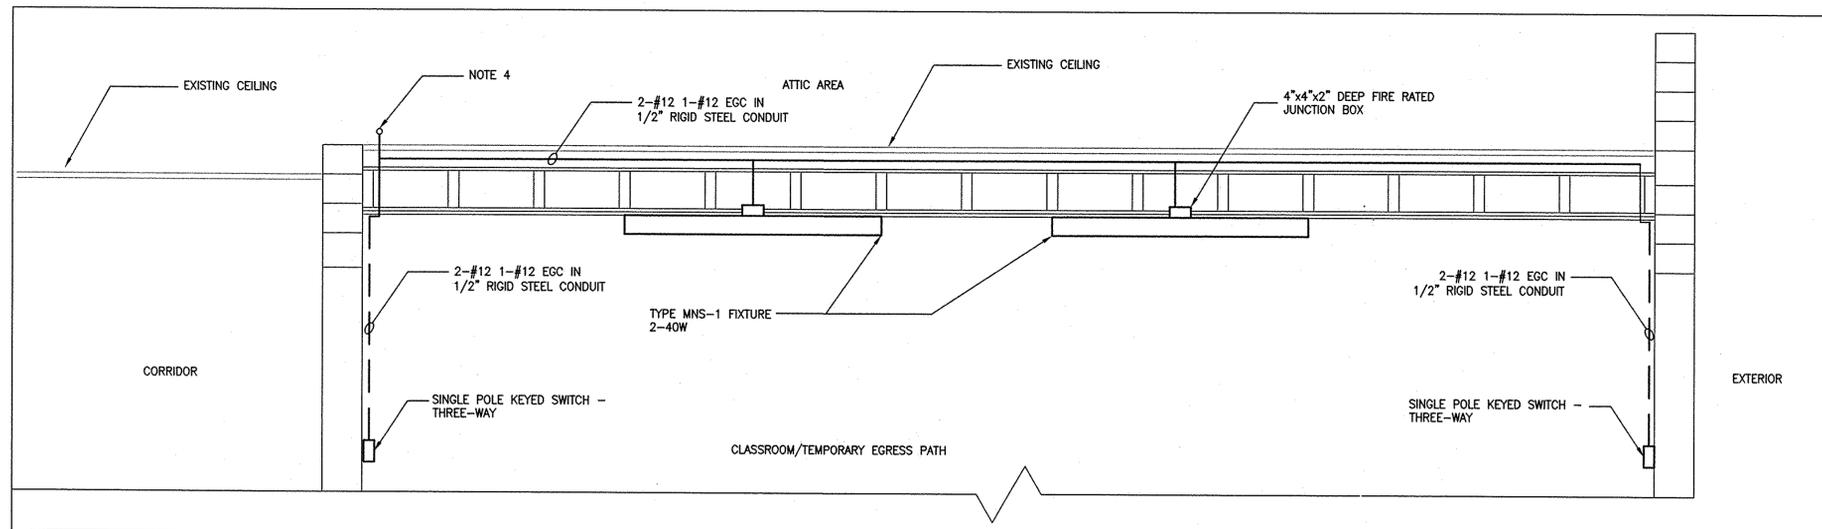

LIGHTING SYSTEM - TEMPORARY EGRESS PATH

NOT TO SCALE

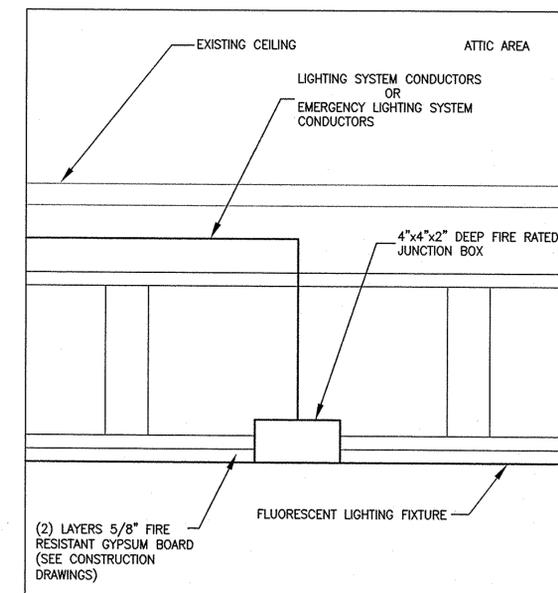

MOUNTING DETAIL - ENLARGED

NOT TO SCALE



CONSULTANT

WARNING:
THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS 'A' MISDEMEANOR.



CONTRACT:

ELECTRICAL

TITLE: **PROVIDE VENTILATION MAIN SCHOOL BUILDINGS BUILDING NO. 4 OR 14**

LOCATION: **VARIOUS DOCCS FACILITIES**

CLIENT: **NYS DEPARTMENT OF CORRECTIONS AND COMMUNITY SUPERVISION**

MARK	DATE	DESCRIPTION
	3/6/2013	ADDENDUM 1
	2/6/2013	BID DOCUMENT

PROJECT NUMBER:	44185 - E
DESIGNED BY:	G. BRADLEY
DRAWN BY:	G. BRADLEY
FIELD CHECK:	
APPROVED:	

SHEET TITLE: **TEMPORARY EGRESS**

DRAWING NUMBER: **E-701**