



STATE OF NEW YORK  
OFFICE OF GENERAL SERVICES  
DESIGN AND CONSTRUCTION GROUP  
THE GOVERNOR NELSON A. ROCKEFELLER  
EMPIRE STATE PLAZA  
ALBANY, NY 12242



---

---

**ADDENDUM NO. 3 TO PROJECT NO. 44190**

**CONSTRUCTION WORK, HVAC WORK, PLUMBING WORK, AND ELECTRICAL WORK  
PROVIDE FIELD OPERATIONS BUILDING  
STATE PREPAREDNESS TRAINING CENTER  
5900 AIRPORT ROAD  
ORISKANY, NY 13424**

December 20, 2011

**NOTE:** This Addendum forms a part of the Contract Documents. Insert it in the Project Manual. Acknowledge receipt of this Addendum in the space provided on the Bid Form.

**COMMON DIVISION 1 SECTIONS**

1. SECTION 011000 SUMMARY OF WORK: Delete the Section bound in Project Manual and substitute the attached Section (pages 011000-1 thru 011000-5) dated "REVISED 12/15/11".
2. SECTION 013113 PROJECT SCHEDULE: Delete this Section in its entirety.
3. Page 015000-5, Paragraph 1.11 A.: Delete this Paragraph in its entirety and replace with the following:
  - "A. Drawing No. C-100 STAGING PLAN identifies the access route for the contractors of all the trades.
    1. Supervisors from each Contractor will be required to shuttle/carpool workers in vehicles clearly marked with the company name from the designated parking area to the construction site.
    2. Only one vehicle/shuttle per trade will be allowed in the staging area.
    3. The Construction Work Contractor will be required to provide a security guard to operate the existing access gate during work hours established by the facility thru the Director's Representative for each working date, to enforce ID badges and limit access to contractors and deliveries.
    4. The security guard is required for the duration of the Work through substantial completion."
4. Page 015000-5, Subparagraph 1.12 A.1.: Delete this Subparagraph in its entirety and replace with the following
  - "1. Park vehicles in areas where directed. Refer to Drawing No. C-001 Staging Plan for parking area designation."

**CONSTRUCTION WORK SPECIFICATIONS**

- 5. DOCUMENT 003113 PRELIMINARY PROJECT SCHEDULE: Delete this Document in its entirety.

**HVAC WORK SPECIFICATIONS**

- 6. DOCUMENT 003113 PRELIMINARY PROJECT SCHEDULE: Delete this Document in its entirety.

**PLUMBING WORK SPECIFICATIONS**

- 7. DOCUMENT 003113 PRELIMINARY PROJECT SCHEDULE: Delete this Document in its entirety.
- 8. Page 221100-10, Paragraph 3.08 D.: Delete this Paragraph in its entirety and replace with the following:
  - “D. Drainage (Sanitary) Above Ground:
    - 1. Option No. 1: Service weight, coated, cast iron bell and spigot pipe and fittings with rubber ring push-on joints.
    - 2. Option No. 2: Hubless, coated, cast iron pipe, fittings, and joint couplings.”
- 9. Page 224200-6, Subparagraph 2.07 A.5: Delete this Subparagraph in its entirety.
- 10. Page 224200-7, Subparagraph 2.07 D.1.: Change “WC-1” in the first line to read “WC-1 and WC-2”.

**ELECTRICAL WORK SPECIFICATIONS**

- 11. DOCUMENT 003113 PRELIMINARY PROJECT SCHEDULE: Delete this Document in its entirety.
- 12. Page 260543-4, Paragraph 3.03 B.: Add the following Subparagraph:
  - “3. For power and communications service raceway into building, use concrete encased schedule 40 PVC with GRS elbows.”
- 13. Page 260543-4, ARTICLE 3.03 CONDUIT SCHEDULE - TYPES AND USE: Add the following Paragraphs:
  - “C. For branch lighting circuits use Schedule 80 PVC in sand bed with GRS elbows and GRS above grade.
  - D. Any conduit type conflicts on drawings are to follow the specification and the modifications of Addendum No. 3.”

**CONSTRUCTION WORK DRAWINGS**

- 14. Revised Drawings:
  - a. Drawing Nos. C-001, C-202, and C-501 noted “REVISED DRAWING 12/15/11” accompany this Addendum and supersede the same numbered originally issued drawing.

**ELECTRICAL WORK DRAWINGS**

15. Drawing No E-101, ELECTRICAL FLOOR PLAN – LIGHTING:
  - a. Delete the three (3) Type “FH” fixtures and branch circuit P2/15 between Columns B-1 and D-1.
  - b. Change the Type “FG” fixture at Column Line A-1 to read Type “FF” fixture.

**END OF ADDENDUM**

James Dirolf, P.E.  
Director of Design

**SECTION 011000**

**SUMMARY OF THE WORK**

**PART 1 GENERAL**

**1.01 WORK COVERED BY CONTRACT DOCUMENTS**

- A. The title and location of the Work is printed on the cover of this Project Manual.
- B. Type of Contract: Fixed price.

**1.02 RELATED CONTRACTS**

- A. The Project consists of the following separate contracts:

Construction Work	Project No. 44190-C
HVAC Work	Project No. 44190-H
Plumbing Work	Project No. 44190-P
Electrical Work	Project No. 44190-E
- B. The suffix letter at the end of the project number distinguishes the separate Contracts. The Sections in Division 01 of the Specifications which have more than one suffix letter (such as this Section) are common to each related Contract.

**1.03 SUBSTANTIAL AND PHYSICAL COMPLETION DATE**

- A. Substantially complete the Work within 560 days after the Agreement is approved by the Comptroller.
  - 1. The time allocated for the performance of work under this contract includes 10 days for notification of the Contractor of the Comptroller's approval of the Agreement.
  - 2. The approval of the Agreement by the Comptroller constitutes the filing of the Contract Documents as a public record and notice to the Contractor that a fully executed contract exists between the Contractor and the State.
- B. Physically complete the Work within 120 days after the Substantial Completion date.

**1.04 CONTRACT AWARD SUBMITTALS**

- A. Submittal No. 1 (Lead Contractor Only): Establish the subscription with the electronic submittals website provider as described in ELECTRONIC SUBMITTALS Article in Specifications Section 013300, and submit not later than 10 days after approval of the Contract by the Comptroller.

- B. Submittal No. 2: Submit the CONTRACTOR'S LIST OF SUBCONTRACTORS-SUPPLIERS information required in SCHEDULES AND RECORDS Article in Specification Section 013000 not later than 15 days after approval of the Contract by the Comptroller.
- C. Submittal No.3: Submit the CONTRACTOR'S PROGRESS SCHEDULE information required in SCHEDULES AND RECORDS Article in Specification Section 013000 not later than 15 days after approval of the Contract by the Comptroller.

**1.05 RESTRICTED WORK PERIOD**

- A. Do not perform the roofing and related Work between December 1<sup>st</sup> and April 1<sup>st</sup> unless approved otherwise, in writing, by the Director. During this period, clear the roof of materials, equipment, and debris. Maintain the roof in a watertight condition.

**1.06 ITEMS NOT INCLUDED**

- A. The following items shown on the Drawings are not included in the Contract:
  - 1. Items indicated "NIC" (Not in Contract).
  - 2. Existing construction, except where such construction is to be removed, replaced, or altered.

**1.07 CONFINED SPACE**

- A. Comply with confined space and permit-required confined space as defined in Title 29, Part 1910, Section 146 of the Code of Federal Regulations (29CFR 1910.146).

**1.08 CONTRACTOR USE OF PREMISES**

- A. Work hours shall be as established by the Facility authorities thru the Director's Representative.
- B. Inform the Director's Representative of work area access requirements. The Director's Representative will coordinate and schedule the requirements with Facility staff to obtain and ensure timely availability of work areas.
- C. Check in with the Facility Representative, as directed, at the beginning of each work day. Furnish information regarding where employees will be working during the day.
- D. Comply with the Facility's Visitor Identification Policy. A copy of the current policy will be distributed at the initial job meeting.
- E. The following items are not allowed on the Site or on Facility premises.
  - 1. Firearms, ammunition, weapons, and dangerous instruments (other than tools required for the Work).
  - 2. Alcoholic beverages and persons under the influence of same.

3. Illegal controlled substances and persons under the influence of same.
  4. Cameras (except with written permission from the Director's Representative).
- F. Comply with Facility policies relating to smoking at the Site.
- G. Store materials and perform the Work so that pedestrian and vehicular traffic is not obstructed.
- H. Do not diminish the level of life safety during performance of the Work.
- I. Utility Outages and Shutdowns: Do not interrupt utility services or branch services except for the time required to make new connections. Arrange with the Director's Representative for the time and duration of interruptions of services. Provide temporary services required to maintain services at all times other than during scheduled interruptions.
- J. Be responsible and accountable for employees, suppliers, subcontractors and their employees, with regard to their use of the premises. Direct them to comply with the Facility Regulations and with the security and traffic regulations.
- K. Furnish Facility authorities with a telephone number or method to contact the supervisor for the Work in case of an emergency after work hours, including weekends and holidays.
- L. Comply with applicable federal and State of New York Right-to-Know Law provisions and supply copies of the appropriate Material Safety Data Sheets (MSDS) to the Director's Representative, and to the Facility's Right-to-Know Information Officer.
- M. Direct employees to be watchful for people in or near the work area where safety hazards may be present. Notify the Facility Safety/Security Department, if necessary, to remove them from the work area or Site.
- N. Report fire and other emergency situations to the Facility Safety/Security Department immediately.

#### **1.09 OPENINGS AND CHASES IN NEW CONSTRUCTION**

- A. Construction Work Contract:
1. Unless specifically indicated otherwise, provide openings, chases, and similar items in new construction provided under this Contract, as required for items to be provided under related contracts.
  2. After the installation and completion of the items for which openings and chases have been provided, build in, over, around and finish the openings and chases to complete the Work.
  3. Provide all cutting, patching, and refinishing resulting from failure to provide the required openings and chases, if the necessary information was furnished by the related contractor before 24 hours of start of the applicable part of the Work.

4. If related contractors fail to furnish drawings or written information covering the openings and chases they require in new construction at least 24 hours before installation of the Work affected by those items, the related contractors will be required to do all cutting, patching, and refinishing of the construction so affected, at their own expense.
- B. HVAC Work, Plumbing Work, and Electrical Work Contracts:
1. Unless specifically indicated otherwise, furnish drawings or written information to the Construction Work Contractor covering the openings and chases required in new construction for the Work. If such information is not furnished at least 24 hours before start of the applicable part of the Construction Work Contractor's work, all necessary cutting, patching and refinishing will be included in the Contract at no additional cost to the State.

#### **1.10 REFERENCE SPECIFICATIONS AND STANDARDS**

- A. Comply with the requirements of the various specifications and standards referred to in these Specifications, except where they conflict with the requirements of these Specifications. Such reference specifications and standards shall be the date of latest revision in effect at the time of receiving bids, unless the date is given.
- B. DOT Specifications: If the abbreviation DOT appears in these Specifications, it shall mean the most current edition of the New York State Department of Transportation, Office of Engineering specifications entitled "STANDARD SPECIFICATIONS - CONSTRUCTION AND MATERIALS", including all applicable Addenda in effect at the time of receipt of bids. The DOT specifications may be purchased from the Department of Transportation, Plan and Publication Sales, 50 Wolf Road, Albany, NY 12232, (518) 457-2124.

#### **1.11 LAYING OUT**

- A. Examine the Contract Documents thoroughly and promptly report any errors or discrepancies to the Director's Representative before commencing the Work.
- B. Lay out the Work in accordance with the Contract Documents.
- C. Construction Work Contract:
1. Provide and maintain axis lines on each floor.
  2. Provide and maintain marks 4 feet above finish floor on each column at each floor.
  3. Take elevations and locations from control points located by the Director's Representative.

#### **1.12 SPECIAL INSPECTIONS**

- A. Special Inspections and tests are required by Chapter 17 of the Building Code of New York State (BCNYS). Inspections & Testing Services will be provided by the state unless otherwise noted.
- B. Contractors are responsible for notifying the Directors Representative regarding individual inspections listed in the **STATEMENT OF SPECIAL INSPECTIONS**. Contractors shall cooperate with the inspectors and testing agencies and sufficient notice and lead time (minimum 48 hours) must be allowed for inspection and testing to be performed.
- C. Where deficiencies are identified, the contractor must take corrective actions to comply with the contract documents or remedy the deficiencies in accordance with Article 9 of the General Conditions

**PART 2 PRODUCTS (Not Used)**

**PART 3 EXECUTION (Not Used)**

**END OF SECTION**

WARNING:

THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS 'A' MISDEMEANOR.



CONTRACT: **CONSTRUCTION**

TITLE: PROVIDE FIELD OPERATIONS BUILDING

LOCATION: STATE PREPAREDNESS TRAINING CENTER  
5900 AIRPORT ROAD  
ORISKANY, NY 13424

CLIENT: NY DIVISION OF HOMELAND SECURITY AND EMERGENCY SERVICES

BD	DATE	DESCRIPTION
BD	10/19/2011	BID DOCUMENTS
MARK	DATE	DESCRIPTION

PROJECT NUMBER: **44190-C**

DESIGNED BY: Designer

DRAWN BY: Author

FIELD CHECK: Checker

APPROVED: Approver





SHEET TITLE:

**STAGING PLAN**

SCALE 1" = 120'-0"

DRAWING NUMBER:

C-001

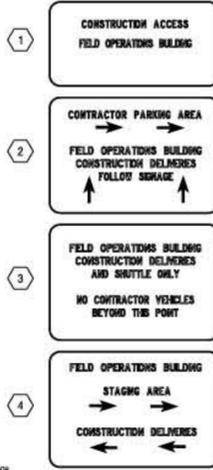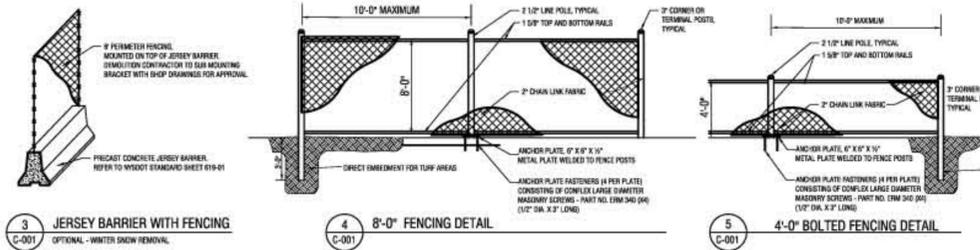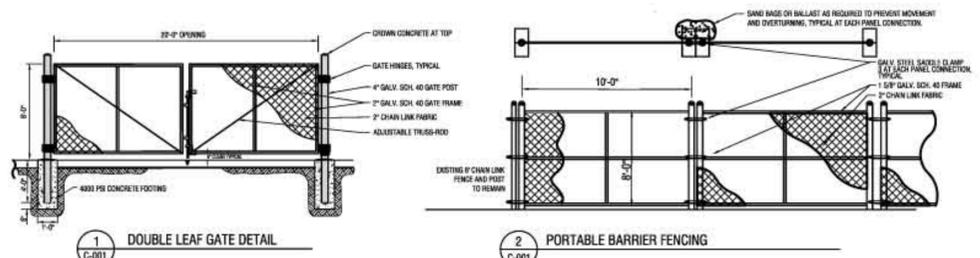

NOTES:


1. MAINTENANCE AND PROTECTION OF TRAFFIC MUST COMPLY WITH THE NATIONAL MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES WITH THE NEW YORK STATE SUPPLEMENT AND SECTION 918 OF THE CURRENT NYSDOT STANDARD SPECIFICATION.
2. MAINTAIN MINIMUM TRAVEL LANE WIDTH OF 12 FEET IN EACH DIRECTION.
3. CHANNELIZING DEVICE SPACING (CENTER TO CENTER) SHALL NOT EXCEED 75'
4. MINIMUM MOUNTING HEIGHT OF ALL SIGNS SHALL BE 5.0 FEET.

CONSTRUCTION ACCESS TO FIELD OPERATIONS BUILDING

1. ACCESS TO SITE IS THROUGH EXISTING SECOND STREET GATE ONLY.
2. CONTRACTOR TO INSTALL SIGNAGE, TRAFFIC CONTROLS AND BARRIERS AS DIRECTED BY THE DIRECTOR'S REPRESENTATIVE.
3. CONTRACTOR SHALL MAINTAIN THE SECOND STREET CONSTRUCTION ACCESS "GATE" AND CONTROLS FOR THE DURATION OF THE PROJECT.
4. CONTRACTOR TO SUPPLY A GATE GUARD TO CONTROL ACCESS OF AUTHORIZED VEHICLES AND INDIVIDUAL. GATE GUARD TO ENFORCE ID BADGES, OPERATE THE GATE AND LIMIT ACCESS TO APPROVED CONTRACTORS AND CONSTRUCTION RELATED DELIVERIES. GATE GUARD SHALL BE PRESENT DURING ALL HOURS AND PHASES OF CONSTRUCTION AND THRU THE DURATION OF THE PROJECT.
5. ALL CONSTRUCTION VEHICLES SHALL PARK IN THE DESIGNATED AREA, ZONE 3. CONTRACTOR SHALL PROVIDE SHUTTLE FOR WORKERS BETWEEN PARKING AND CONSTRUCTION AREA. SHUTTLE SHALL TRAVEL ALONG THE DESIGNATED CONSTRUCTION ACCESS TO THE STAGING AREA, ZONE 2, OR FIELD OPERATIONS CONTRACT LIMIT LINE, ZONE 1.
6. THIS IS AN ACTIVE EMERGENCY VEHICLE OPERATIONS CENTER (EVOC) AND ALL FIELD OPERATIONS BUILDING CONSTRUCTION TRAFFIC MUST STAY ON THE DESIGNATED ROUTES DEFINED ON THE STAGING PLANS AND AS OUTLINED IN THE CONTRACT DOCUMENTS.
7. SPEED LIMIT IS 25 MPH. SPEED LIMIT SHALL BE POSTED.
8. CONTRACTOR 'C' IS RESPONSIBLE FOR SNOW REMOVALS FROM ALL ZONES.
9. CONTRACTOR 'C' SHALL SECURE THE CONSTRUCTION STAGING AREA WITH PORTABLE BARRIER FENCING AND MAINTAIN THE FENCING AND GATES THRU THE DURATION OF THE CONTRACT.
10. PROVIDE AND MAINTAIN INLET PROTECTION AS REQUIRED IN SWPPP AND CONTRACT DOCUMENTS FOR ALL INLETS LOCATED WITHIN THE STAGING AREA.
11. PROVIDE AND MAINTAIN SANITARY FACILITIES WITHIN THE CONSTRUCTION STAGING AREA PER CONTRACT DOCUMENTS.
12. AFTER ISSUANCE OF THE CERTIFICATE OF OCCUPANCY AND REMOVAL OF THE CONSTRUCTION STAGING AREA, THE 'C' CONTRACTOR SHALL MICRO-PAVE ZONE 4C AND REPAIR IMPACTED SURFACES ASSOCIATED WITH RECOVER OF SURVEY CONTROL AND CONSTRUCTION STAGING.
13. ALL CONSTRUCTION WASTE AND RECYCLING DUMPSTERS SHALL BE MAINTAINED BY THE 'C' CONTRACTOR. REFER TO SPECIFICATION FOR SPECIFIC REQUIREMENTS.

TEMPORARY SERVICES

1. CONTRACTOR IS RESPONSIBLE FOR OBTAINING AND PAYING ALL ASSOCIATED FEES FOR A HYDRANT USE PERMIT FROM THE MID-HAWK VALLEY WATER AUTHORITY. CONTRACTOR TO INSTALL, TEST, AND DISINFECT WATER MAIN AS DESIGNED ON DRAWING C-202. UPON APPROVAL OF THE MWVA, INSTALL FROST PROOF YARD HYDRANT. HYDRANT USE PERMIT ONLY AVAILABLE DURING NON-FREEZING CONDITIONS.
2. REFER TO THE SPECIFICATIONS FOR TEMPORARY POWER REQUIREMENTS FOR ZONE 1 AND ZONE 2.

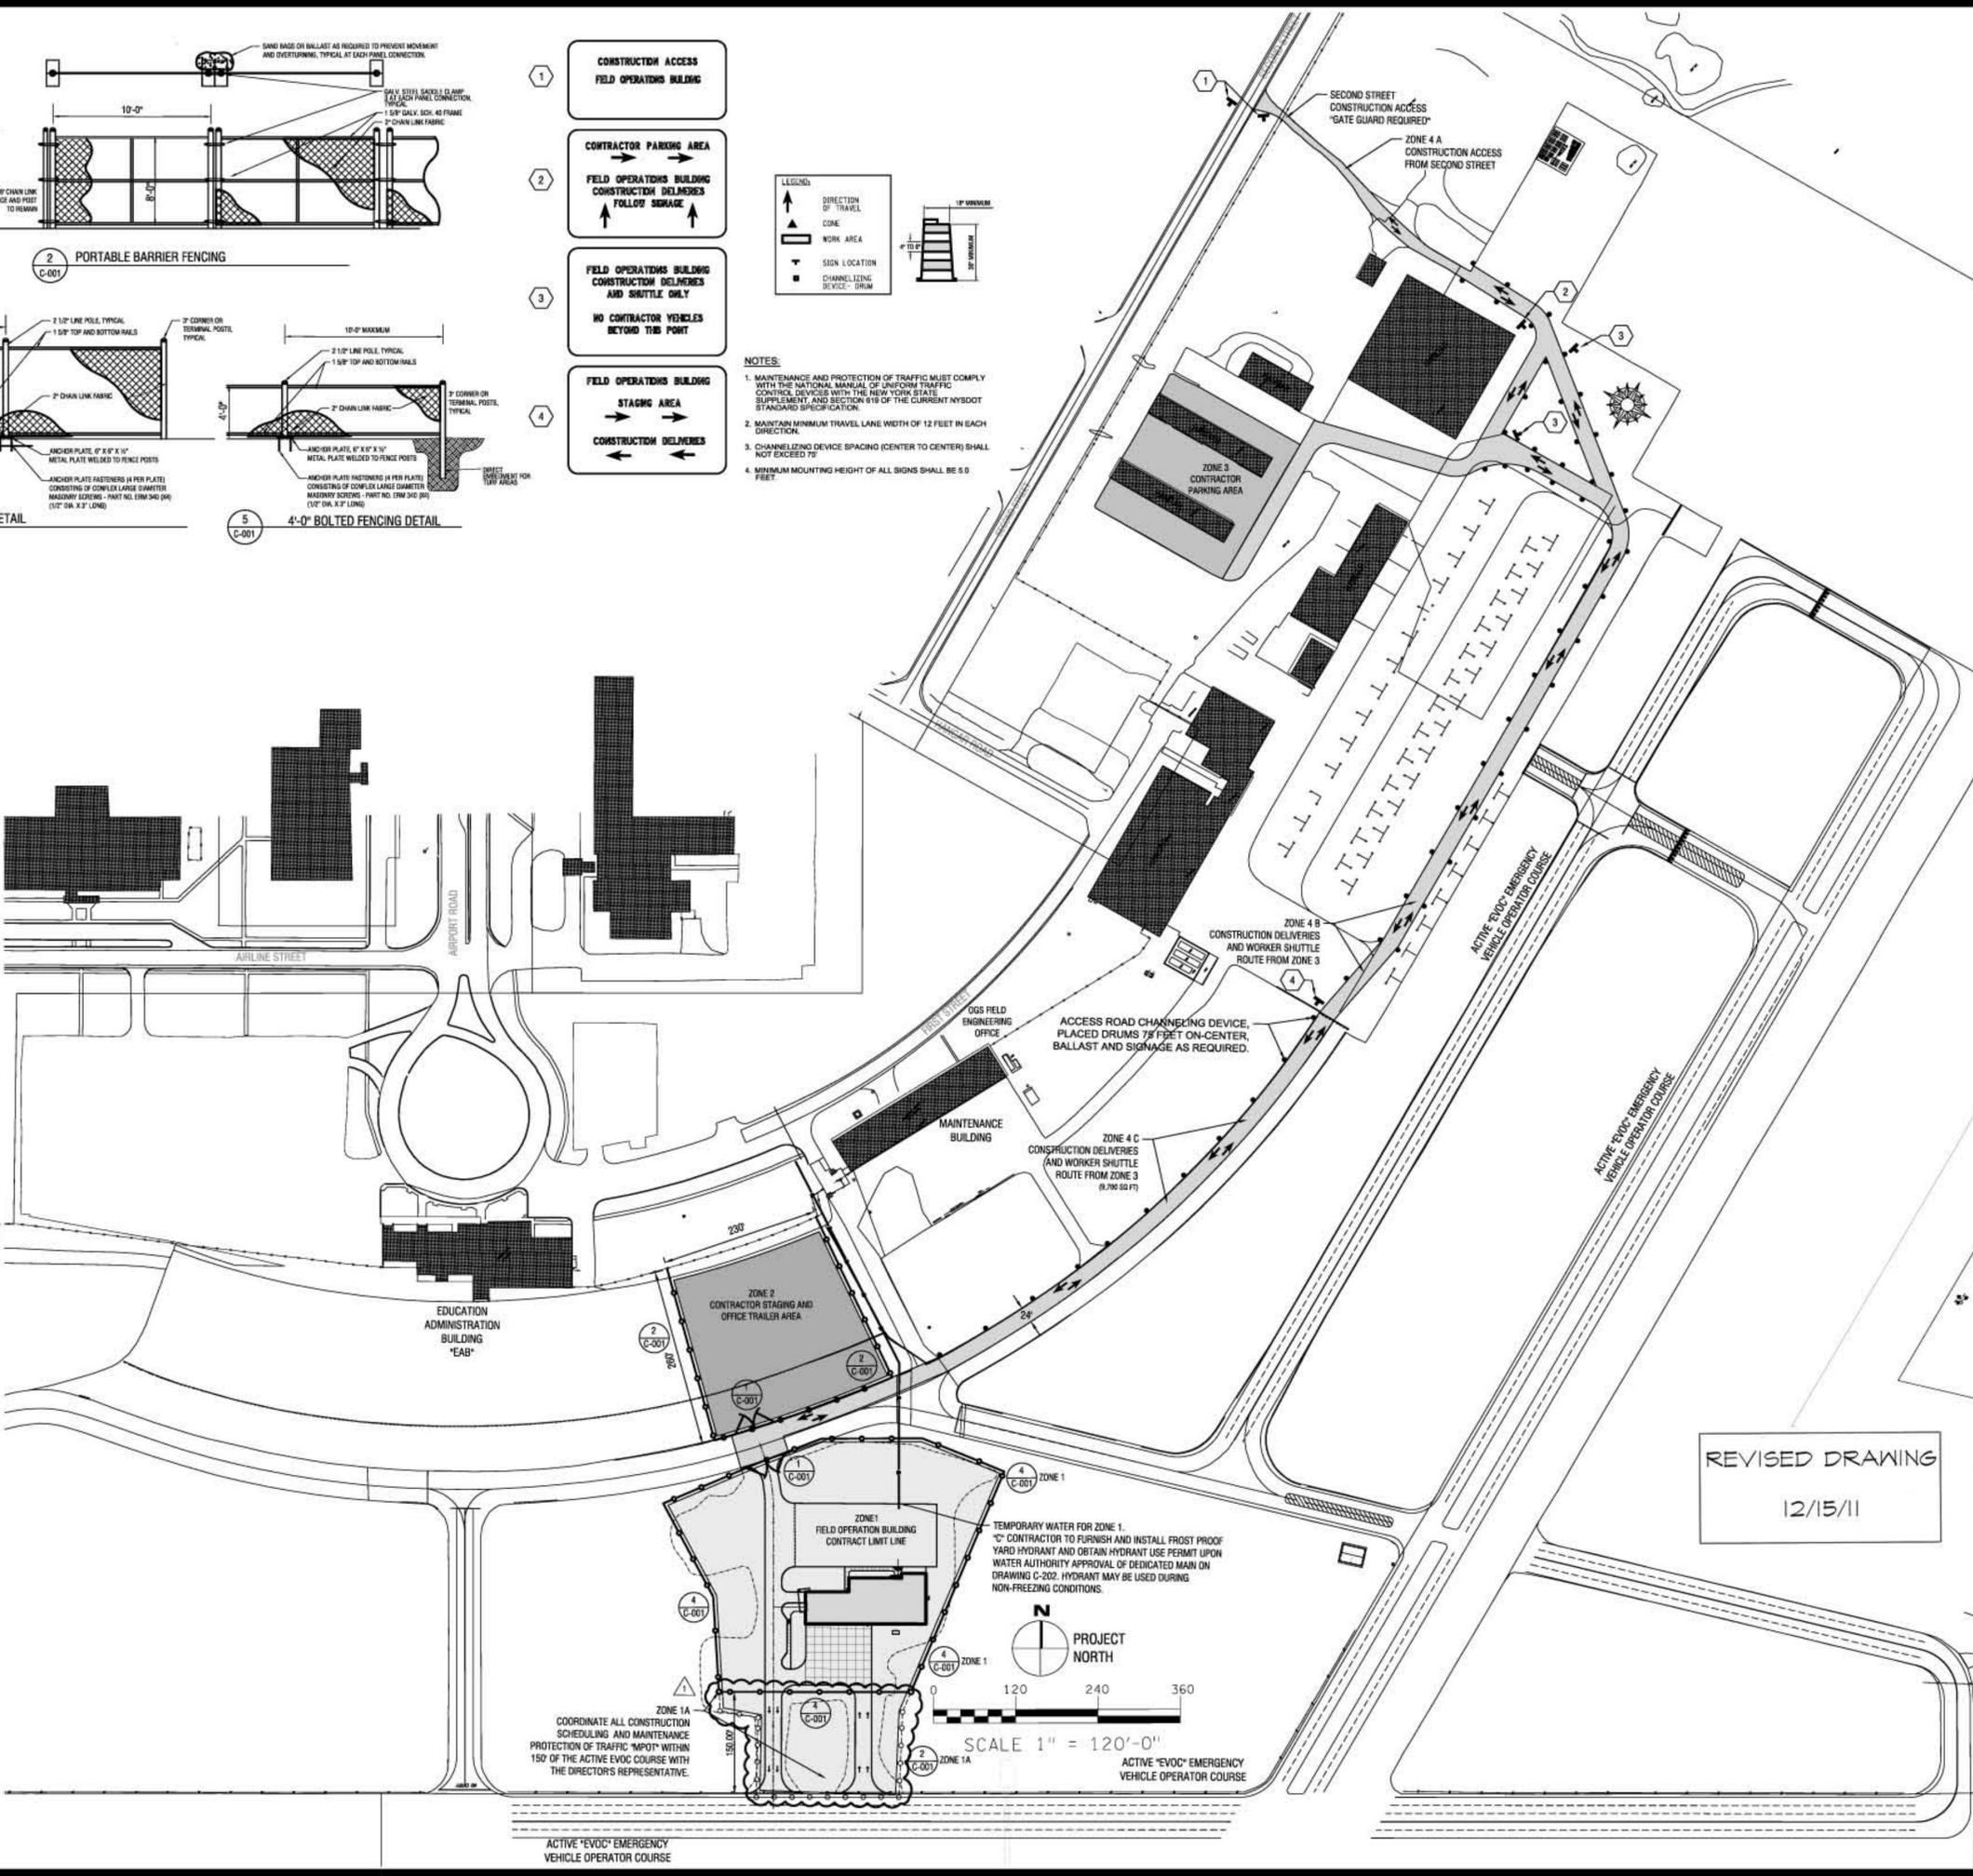


REVISED DRAWING  
12/15/11


ZONE 1A  
COORDINATE ALL CONSTRUCTION SCHEDULING AND MAINTENANCE PROTECTION OF TRAFFIC "MPTD" WITHIN 150' OF THE ACTIVE EVOC COURSE WITH THE DIRECTOR'S REPRESENTATIVE.

24 x 36 PLOT SHEET



PLT: 11/15/11 11:43 AM  
DRAWN BY: AUTHOR (30011)  
CHECKED BY: CHECKER (30011)  
DATE: 11/15/11 11:43 AM

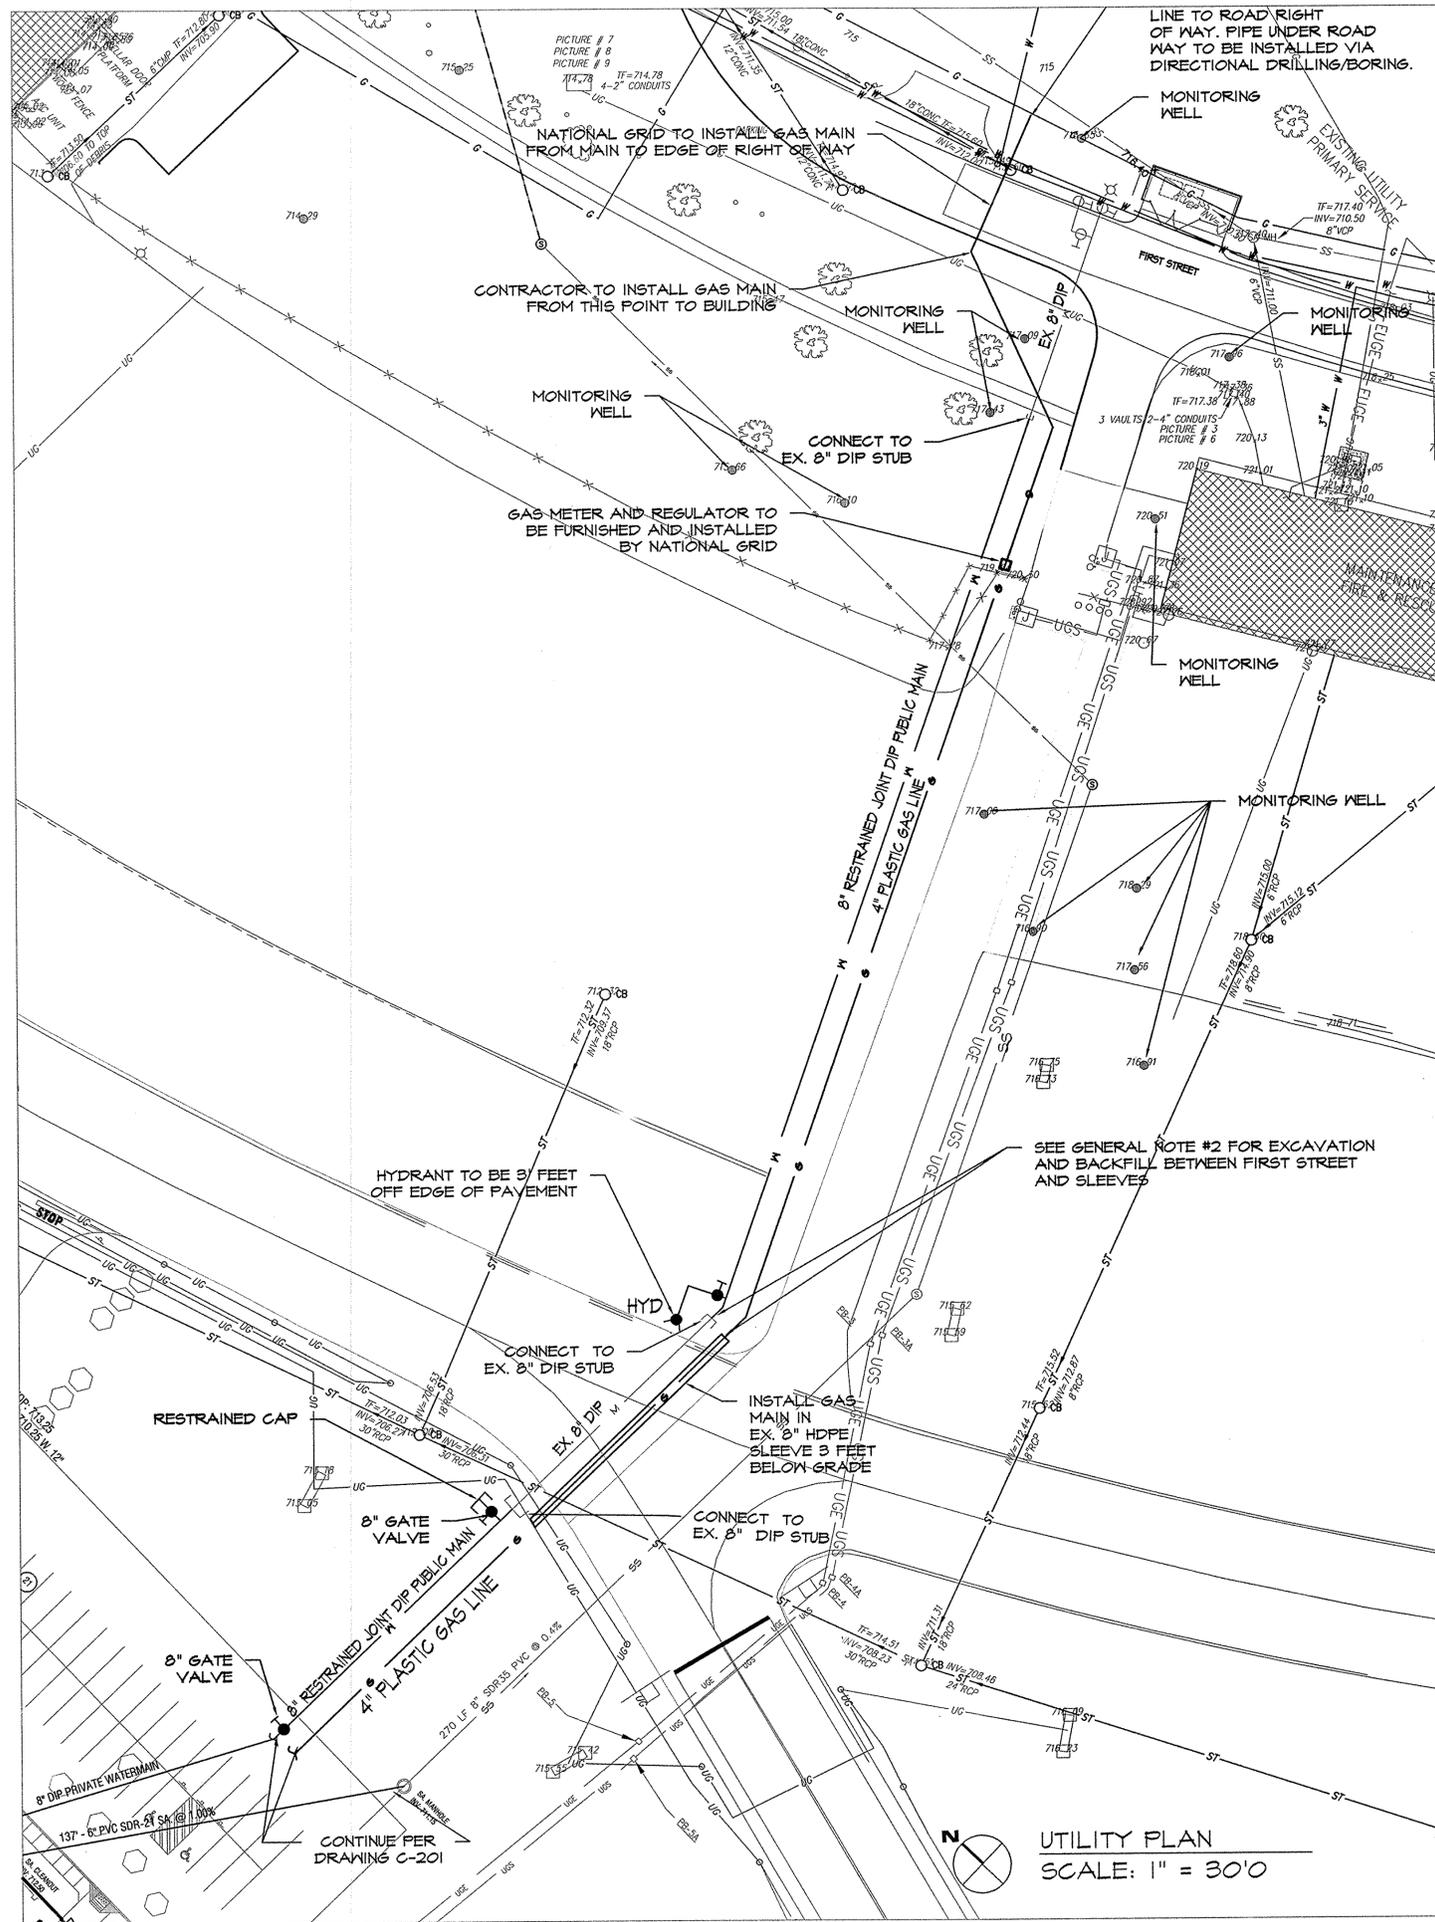


- PUBLIC WATER LINE NOTES: (THIS DRAWING ONLY)**
- CONTACT THE MOHAWK VALLEY WATER AUTHORITY (MVWA) ONE WEEK PRIOR TO INSTALLATION AND TESTING OF THE PUBLIC WATER LINES. THE MVWA MUST INSPECT THE CONNECTION AND INSTALLATION OF PUBLIC MAINS AND WITNESS PRESSURE TESTING OF THE PUBLIC WATER MAIN. THE MVWA WILL ALSO COMPLETE THE BACTERIOLOGICAL TESTING. CONTACT MR. DAVID JONES AT (315) 742-0326.
  - WATER MAIN TO BE DISINFECTED AND TESTED FROM THE POINT OF CONNECTION ON FIRST STREET TO POINT OF TERMINATION.
- NATIONAL GRID GAS MAIN NOTES:**
- NATIONAL GRID WILL MAKE THE CONNECTION TO THE MAIN AND INSTALL THE GAS MAIN WITHIN THE ROAD RIGHT OF WAY.
  - NATIONAL GRID WILL PROVIDE AND INSTALL THE METER AND REGULATOR.
  - INSTALLATION OF THE REMAINDER OF THE GAS MAIN MUST BE COMPLETED BY A NATIONAL GRID CERTIFIED INSTALLER EMPLOYED BY THE CONTRACTOR.
  - GAS PIPE MUST BE PURCHASED FROM NATIONAL GRID BY THE CERTIFIED INSTALLER.
  - NATIONAL GRID MUST BE WITNESS EXCAVATION FOR AND INSTALLATION AND PRESSURE TESTING OF THE GAS MAIN. CONTACT NATIONAL GRID 3 WEEKS PRIOR TO EXCAVATION FOR, AND INSTALLATION AND TESTING OF THE MAIN. CONTACT MR. STEVEN RIEBEN AT (315) 748-1910.
- GENERAL NOTES:**
- INSTALL WATER MAIN IN ACCORDANCE WITH THE SEQUENCE OF OPERATIONS SHOWN ON DRAWING C-401 SO THAT IT MAY BE USED TO PROVIDE TEMPORARY WATER.
  - SOIL CONTAMINATION MAY BE PRESENT IN THIS AREA. PROVIDE IN THE CONTRACT FOR THE REMOVAL, TRANSPORTATION AND DISPOSAL OF 975 CUBIC YARDS OF CONTAMINATED SOIL. SOIL MAY BE DISPOSED OF IN A TYPICAL SOLID WASTE LANDFILL. TURN RECEIPTS FOR TIPPING FEES OVER TO THE DIRECTOR'S REPRESENTATIVE. TO ACCOUNT FOR THE 975 CUBIC YARDS OF SOIL CONTAMINATION, PROVIDE IN THE CONTRACT FOR 975 CUBIC YARDS OF BACKFILL MATERIAL TO BE USED IN THIS AREA.
  - ALL MONITORING WELLS SHALL BE LOCATED, MARKED AND PROTECTED.

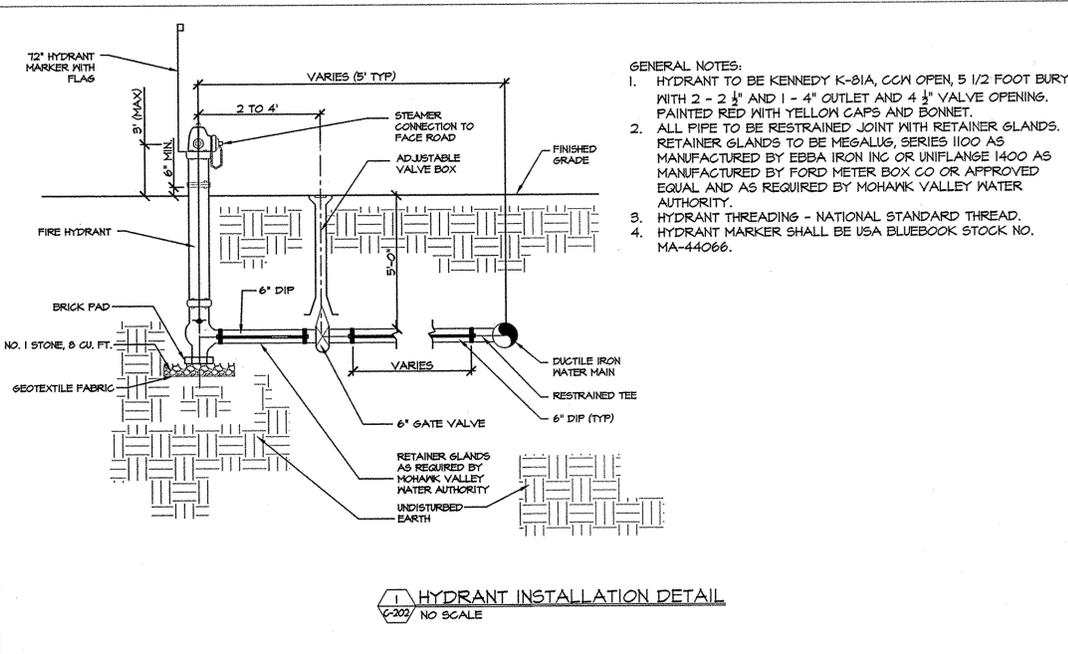

- GENERAL NOTES:**
- HYDRANT TO BE KENNEDY K-81A, CCM OPEN, 5 1/2 FOOT BURY WITH 2 - 2 1/2" AND 1 - 4" OUTLET AND 4 1/2" VALVE OPENING. PAINTED RED WITH YELLOW CAPS AND BONNET.
  - ALL PIPE TO BE RESTRAINED JOINT WITH RETAINER GLANDS. RETAINER GLANDS TO BE MEGALUG, SERIES 1100 AS MANUFACTURED BY EBBA IRON INC OR UNIFLANGE 1400 AS MANUFACTURED BY FORD METER BOX CO OR APPROVED EQUAL AND AS REQUIRED BY MOHAWK VALLEY WATER AUTHORITY.
  - HYDRANT THREADING - NATIONAL STANDARD THREAD.
  - HYDRANT MARKER SHALL BE USA BLUEBOOK STOCK NO. MA-44066.

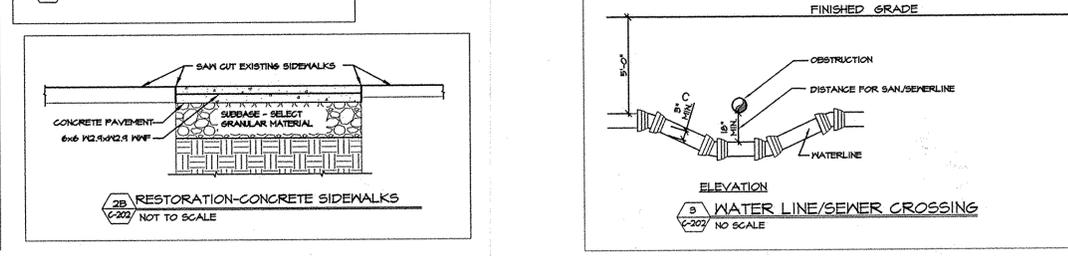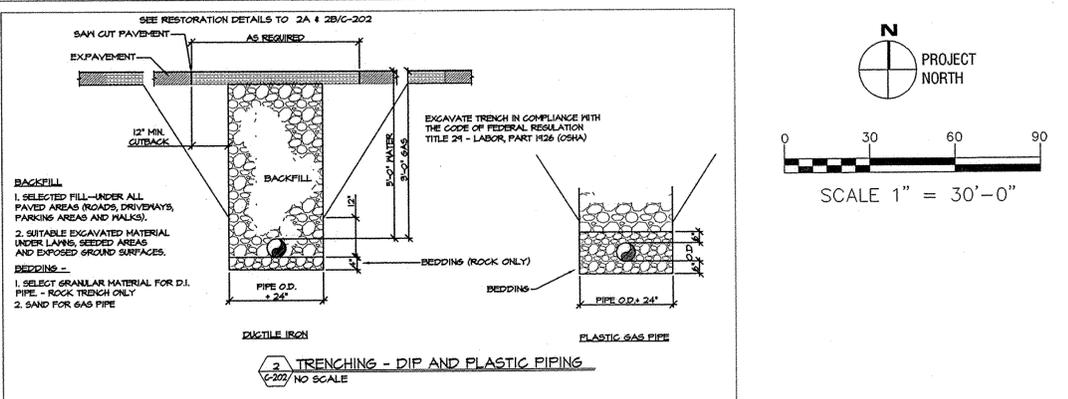

REVISED DRAWING  
12/15/11

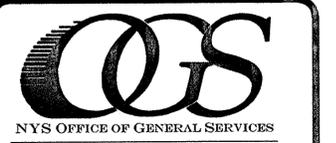


**Serving New York**  
Andrew M. Cuomo  
Governor  
Roann M. Destito  
Commissioner  
James M. Davies, A.I.A.  
Deputy Commissioner  
Design and Construction



300 STATE STREET, SUITE 201  
ROCHESTER, NY 14614  
P: (585) 454-6110  
F: (585) 454-3066  
www.labellapc.com  
Copyright © 2011



**WARNING:**  
THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS 'A' MISDEMEANOR.

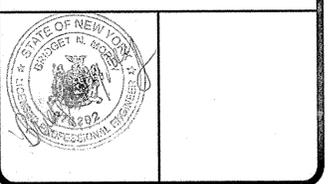

**CONTRACT:** CONSTRUCTION

**TITLE:** PROVIDE FIELD OPERATIONS BUILDING

**LOCATION:** STATE PREPAREDNESS TRAINING CENTER  
5900 AIRPORT ROAD  
ORISKANY, NY 13424

**CLIENT:** NY DIVISION OF HOMELAND SECURITY AND EMERGENCY SERVICES

BD	10/19/2011	BID DOCUMENTS
MARK	DATE	DESCRIPTION
PROJECT NUMBER:	44190-C	
DESIGNED BY:		
DRAWN BY:		
FIELD CHECK:		
APPROVED:		
SHEET TITLE:	UTILITY PLAN	
	SCALE 1" = 30'-0"	
DRAWING NUMBER:	C-202	

