



STATE OF NEW YORK
OFFICE OF GENERAL SERVICES
DESIGN AND CONSTRUCTION GROUP
THE GOVERNOR NELSON A. ROCKEFELLER
EMPIRE STATE PLAZA
ALBANY, NY 12242



ADDENDUM NO. 2 TO PROJECT NO. 44549

**CONSTRUCTION WORK, HVAC WORK, ELECTRIC WORK
PROVIDE FREEZER & COOLER
BLDG. No.-3 DINING ROOM 1
MID-STATE CORRECTIONAL FACILITY
RIVER ROAD
MARCY, NY**

June 28, 2013

NOTE: This Addendum forms a part of the Contract Documents. Insert it in the Project Manual. Acknowledge receipt of this Addendum in the space provided on the Bid Form.

CONSTRUCTION CONTRACT SPECIFICATIONS

1. REFER TO SECTION - 072100 Building Insulation, Part-2, paragraph 2.01, A, Materials.
 - A. Delete entire paragraph –“A” and replace with the following paragraph –“A”. Rigid (Board) insulation: Rigid cellular polyurethane thermal insulation boards; ASTM C1289 of type and minimum compressive strength indicated below, with maximum flame-spread and smoked developed indexes of 75 and 450 Respectively. Aged R-value: 4 inches Thick: R= 28 (R-7 per inch minimum) @ 40 degrees F and 27 @ 75 degrees F.
3. Comprehensive strength: Delete “Type XVI” and replace with “Type “Type XIV”.

CONSTRUCTION CONTRACT DRAWINGS

1. REFER TO DRAWING A-102, PARTIAL FLOOR PLANS AND ELEVATIONS, PROPOSED PARTIAL FLOOR PLAN.
 - a. REFER TO LOADING DOCK: Construction Note -19, revise to read 17.
 - b. REFER TO DISHWASHER ROOM 009: Construction Note-19, revise to read Note -17.
 - c. REFER TO CONSTRUCTION NOTES: Delete Construction Note - 19.
2. REFER TO DRAWING S-101 - FLOOR REINFORCEMENT, LOADING DOCK & CANOPY, FOUNDATIONS; PLAN DETAIL 1 – PARTIAL FOUNDATION PLANS FOR FLOOR REINFORCEMENT, DOCK, AND CANOPIES:
 - a. REVISE the Foundation Plan per attached sketch D-01 – Floor Reinforcement; Partial Foundation Plan.

3. REFER TO DRAWING S-102 - FLOOR REINFORCEMENT, LOADING DOCK & CANOPIES, FRAMING PLANS & DETAILS; PLAN DETAIL 1 – PARTIAL FIRST FLOOR FRAMING PLAN, FLOOR REINFORCEMENT AND DOCK:
 - a. REVISE the First Floor Framing Plan per attached sketch D-02 – Floor Reinforcement; Partial First Floor Framing Plan.

HVAC CONTRACT SPECIFICATIONS

1. REFER TO SPECIFICATION SECTION 23600 “REFRIGERATION” page 23600-7, Delete paragraph 2.15 B Alarm Panel in its entirety.
2. REFER TO SPECIFICATIONS SECTION 23600 “REFRIGERATION” page 23600-11, Delete Paragraph 3.07 Alarm Panel in its entirety.

HVAC CONTRACT DRAWINGS

1. REFER TO DRAWING H-101, “PARTIAL FLOOR PLAN” – 1. PARTIAL FLOOR PLAN REMOVALS, Dashed ductwork east exterior wall. Add the following Note: Disconnect and remove supply ductwork, hangars, hardware, accessories, dampers, grilles, insulation, etc. located within soffit along proposed loading dock area. Cap remaining open end of existing duct, refer to 2-Partial Floor Plan for duct cap location.
2. REFER TO DRAWING H-101, “PARTIAL FLOOR PLAN” – 2. PARTIAL FLOOR PLAN REMOVALS. Refer to note referring to the existing freezer and cooler. The removal of the freezer and cooler is the responsibility of the “C” Contractor.
3. REFER TO DRAWING H-102, “EVAPORATOR AND CONDENSING UNIT SCHEDULE”. CLARIFICATION: Electrical disconnects are not provided under this contract. Electrical disconnects and connections are to be provided under “E” contract.
4. REFER TO DRAWING H-102,
ADD: Zone Pump Schedule (BP-1). See attachment. Provide labor, piping, fittings, and materials to install an inline booster pump to serve air curtain AC-1. Provide aqua-stat to cycle pump based on return water temp from air curtain. Interlock 2-way control valve serving air curtain to open when pump runs. Disconnect switch and branch circuit provided by “E” contract.
5. REFER TO DRAWING H-101 “PARTIAL FLOOR PLAN”-2.PARTIAL FLOOR PLAN REMOVALS, dishwasher room.
ADD: Disconnect and remove all associated piping back to mains to include, but not limited to, steam, condensate, hot and cold water, sanitary, and floor drains, hangers, supports, hardware, accessories etc... related to the dishwasher and the dishwashing room floor drain(s) within the crawl space. Patch floor at removed floor drain(s) to match existing construction. Cap piping runouts at mains.

ELECTRICAL CONTRACT SPECIFICATIONS

1. SPECIFICATION SECTION 283105:
 - a. Add the following par. 1.04.D: “Relocate fire alarm notification device”.
 - b. Delete par. 1.06.B, C, and G.2.
 - c. Revise sub-par. 1.07.B.1 from “24 hours” to “16 hours” on site.
 - d. Delete par. 2.01.B.

- e. Delete par. 2.05.
- f. Delete par. 2.06.
- g. Delete sub-par. 3.01.A.1.a, and c.
- h. Delete par. 3.03.B, D, and E.
- i. Delete sub-paragraphs: 3.04.B.3.a.1)and 2) and 3.04.B.3.b.
- j. Delete sub-par. : 3.04.B.4.a.
- k. Delete par. 3.05.B and C.

ELECTRICAL CONTRACT DRAWINGS

1. REFER TO DRAWING: E-103, 1ST FLOOR PARTIAL PLANS LIGHTING, POWER AND SYSTEMS:

- a. **NOTES:**
 - i. Note#11: Revise first sentence by removing the following last words: “and synchronized with existing visual alarms.”
 - ii. Add Note #25: “Relocate existing fire alarm audiovisual device onto the adjacent north wall next to the exit. Reroute and extend the existing notification circuit to the device new location. Coordinate relocation of the device with removal of the existing wall. Coordinate work with Director’s Representative and demolition contractor.”
- b. **DETAIL 1:** Relocate existing fire alarm audiovisual device indicated on new east wall between loading dock door and window onto the adjacent north wall next to the exit access. Remove subscript “ETR” and indicate Note#25 hexagon at the device.
- c. **DETAIL 1:** Delete from Detail 1 the emergency light E1 located on east wall.
- d. **DETAIL 2:** Indicate emergency light E1 on Detail 2 in same location.
- e. **DETAIL 2:** Delete subscript E1 at relocated emergency light at north wall.

2. REFER TO DRAWING: E-104, BASEMENT PARTIAL PLAN LIGHTING AND POWER


- a. **DETAIL 1:** Provide 120V branch circuit from 1ST floor panel KDP6 to air curtain booster pump BP-1 located in basement at east wall. Provide safety disconnect for the booster pump motor wall mounted next to the pump.

3. REFER TO DRAWING: E-103, 1ST FLOOR PARTIAL PLANS LIGHTING, POWER AND SYSTEMS:

- a. **DETAIL 1:** Provide fractional horsepower manual controller located on 1st floor next to the air curtain disconnect. Provide 25A-1P HACR rated circuit breaker in Panel KDP6.

END OF ADDENDUM

James Dirolf, P.E.
Director of Design

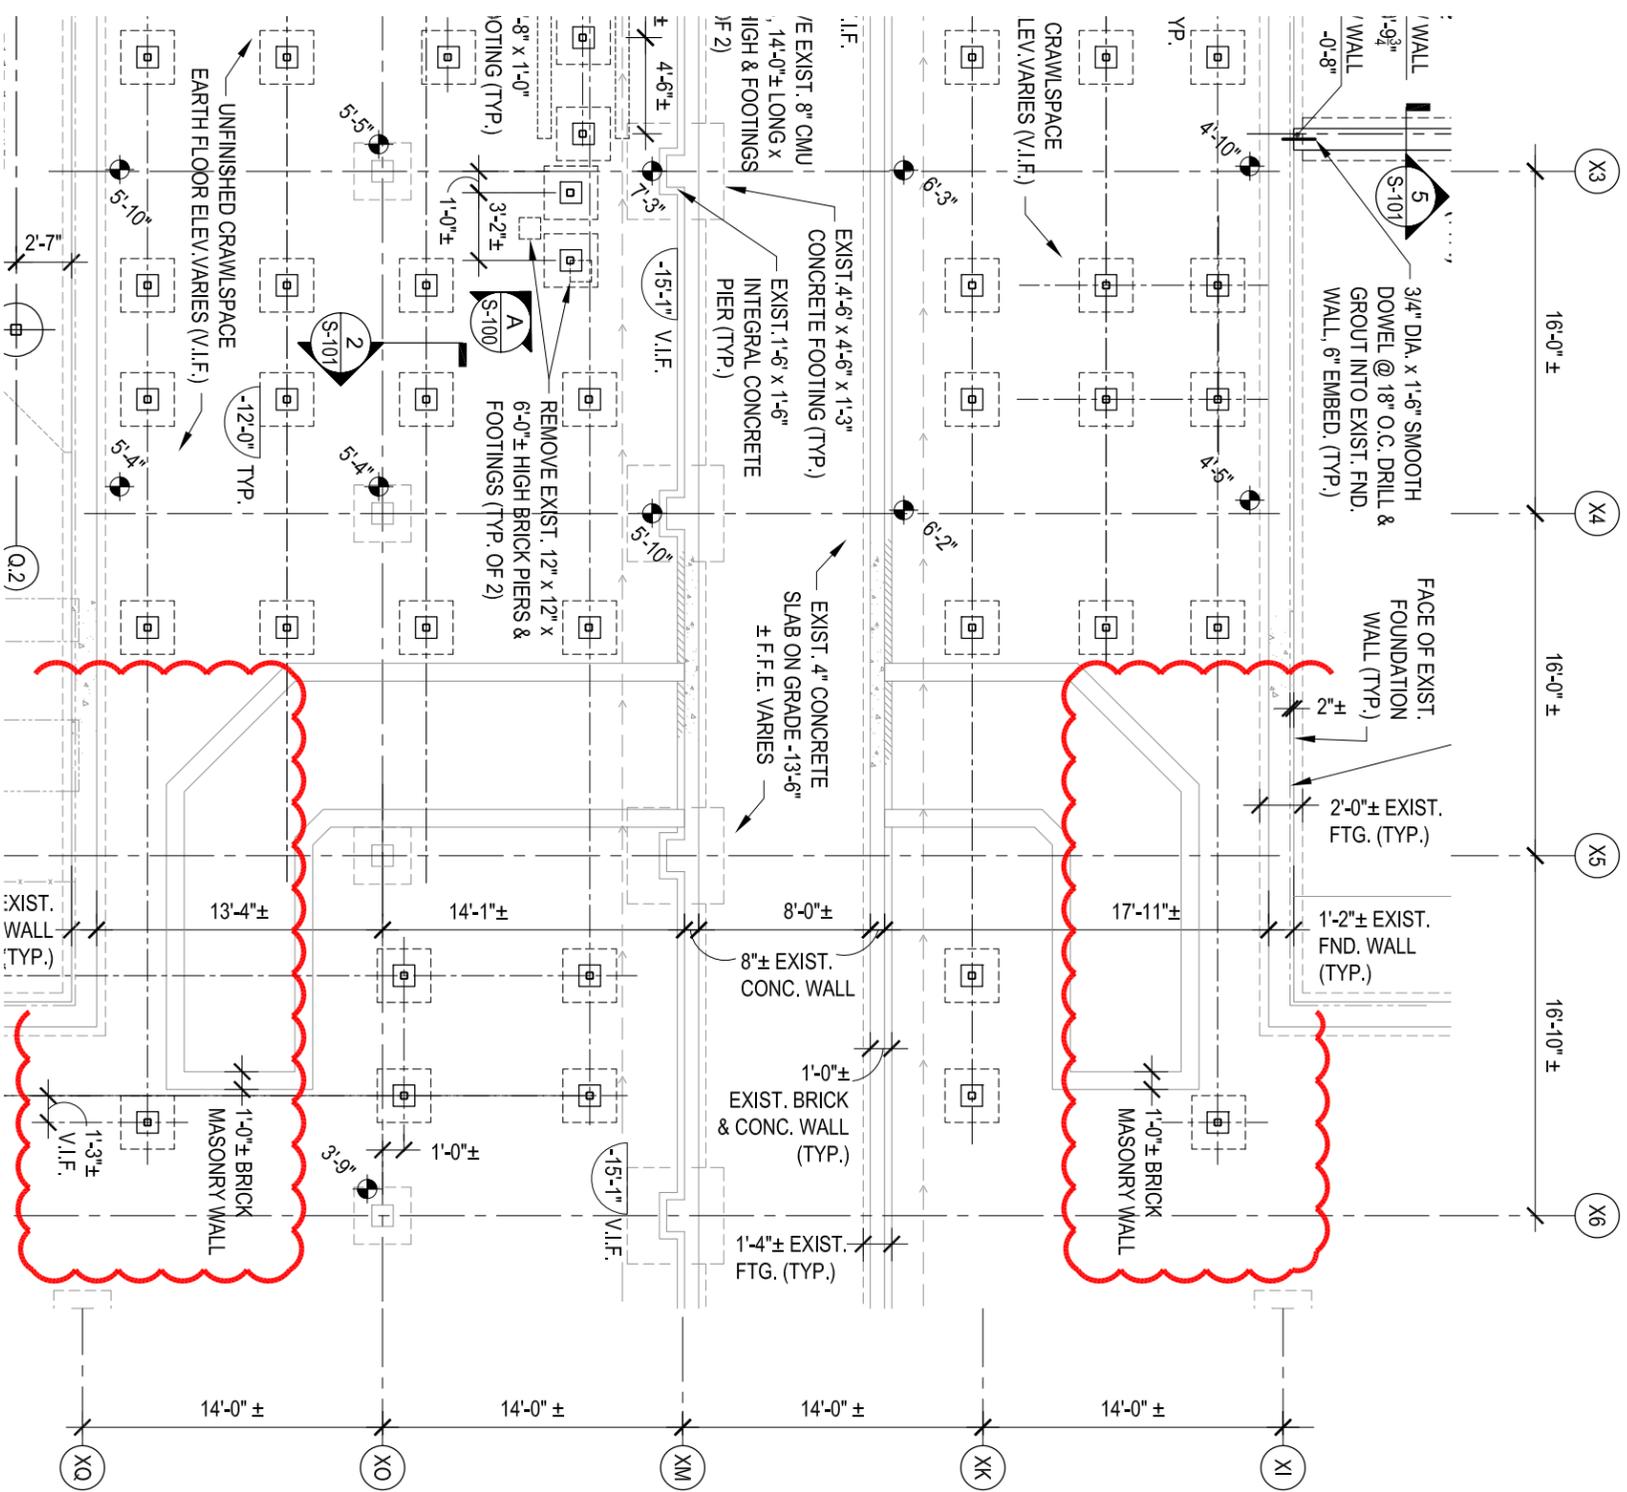

1 PARTIAL FOUNDATION PLAN

1/8" = 1'-0"

NOTES:

1. WORK THIS SKETCH WITH SKETCH D-02 AND PARTIAL FOUNDATION PLAN ON DRAWING S-101.
2. CONTRACTOR SHALL FIELD VERIFY SIZE AND LOCATION OF EXISTING CRAWLSPACE PIPING PRIOR TO PREPARATION OF SHOP DRAWINGS AND NOTIFY THE DIRECTOR'S REPRESENTATIVE OF DISCREPANCIES.



OSS
 NYS OFFICE OF GENERAL SERVICES
 Spring New York
 ANDREW M. CUOMO
 Governor
 ROBERTA A. WALKER
 Commissioner

CONSULTANT
TRAUTMAN ASSOCIATES
 ARCHITECTS / ENGINEERS
 275 FRANKLIN STREET
 SUITE 100
 RIVER HAVEN, NY 10595
 PHONE: (716) 884-4400
 FAX: (716) 884-4208

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS APPROVED BY THE ARCHITECT, IS UNLAWFUL. THIS DOCUMENT IS THE PROPERTY OF TRAUTMAN ASSOCIATES. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN. IT IS NOT TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF TRAUTMAN ASSOCIATES. ANY VIOLATION OF THESE TERMS SHALL BE CONSIDERED A MISDEMEANOR.

CONTRACTOR:
CONSTRUCTION

TITLE:
 PROVIDE FREEZER & COOLER BUILDING 3, DINING ROOM 1

LOCATION:
 MID-STATE CORRECTIONAL FACILITY
 RIVER ROAD
 MARCY, NEW YORK

CLIENT:
 DEPARTMENT OF CORRECTIONS AND COMMUNITY SUPERVISION

DATE	SUBMISSION / PHASE
01/28/2013	FINAL SUBMISSION
06/21/2013	ADDENDUM NO. 1

PROJECT NUMBER: **44549 - C**


DESIGNED BY: MJF
 DRAWN BY: LLL
 FIELD CHECK:
 APPROVED:

SCALE: AS NOTED

SHEET TITLE:
 FLOOR REINFORCEMENT
 PARTIAL FOUNDATION PLAN

DRAWING NUMBER: **D-01**

SHEET OF 12

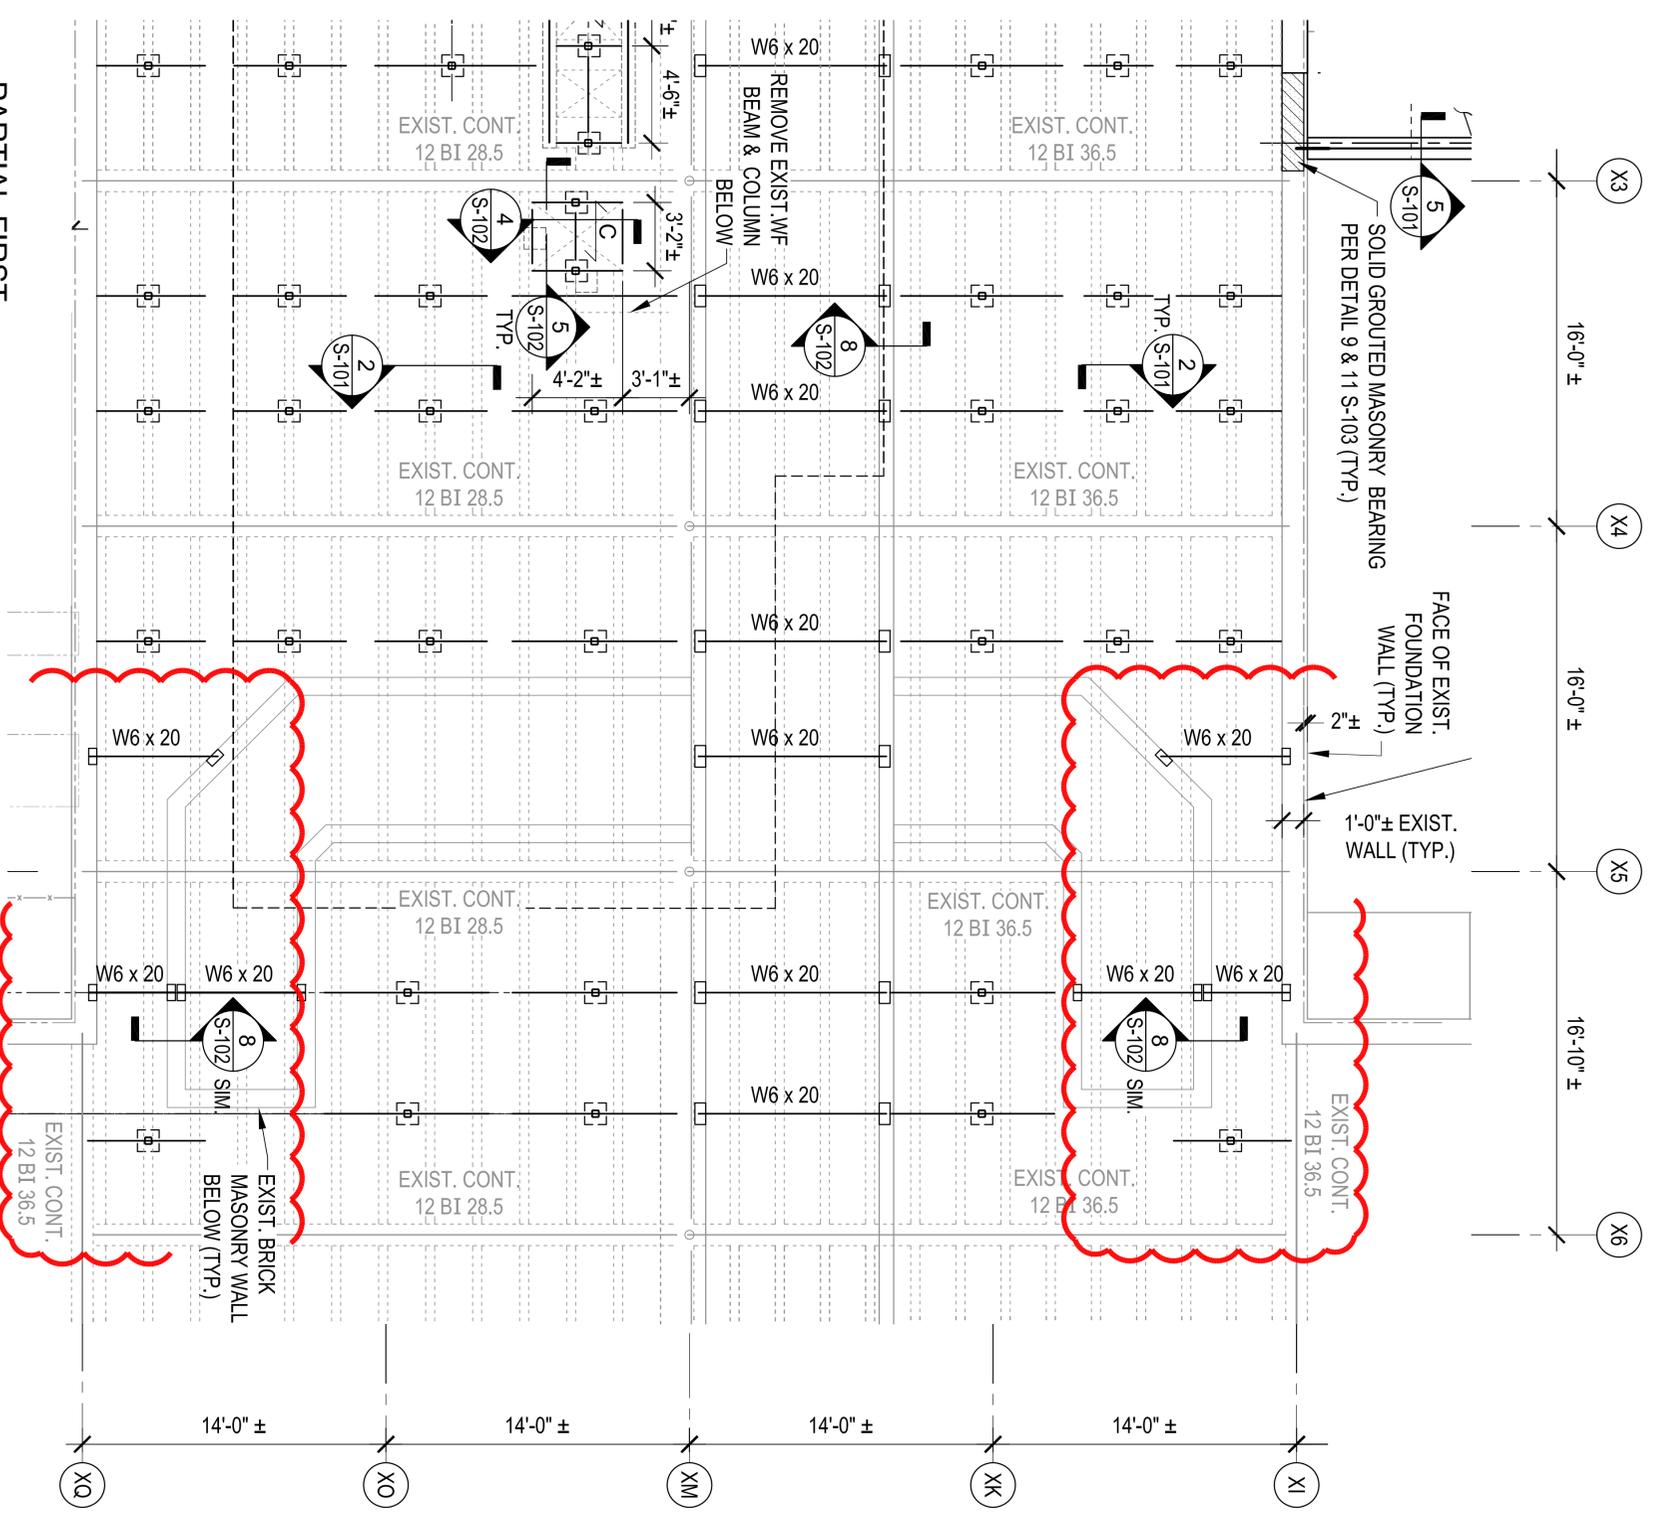

1 PARTIAL FIRST FLOOR FRAMING PLAN

- NOTES:
 1/8" = 1'-0"
1. WORK THIS SKETCH WITH SKETCH D-01 AND PARTIAL FIRST FLOOR FRAMING PLAN ON DRAWING S-102.
 2. CONTRACTOR SHALL FIELD VERIFY SIZE AND LOCATION OF EXISTING CRAWL SPACE PIPING PRIOR TO PREPARATION OF SHOP DRAWINGS AND NOTIFY THE DIRECTOR'S REPRESENTATIVE OF DISCREPANCIES.



OCS
 NYS OFFICE OF GENERAL SERVICES
Serving New York
 ANDREW M. CUOMO
 Governor
 ROYANN M. DESTITO
 Commissioner

TRAUTMAN ASSOCIATES
 ARCHITECTS / ENGINEERS
 410 FRANKLIN STREET
 BUFFALO, NY 14202
 PHONE: 716.882.4400
 FAX: 716.882.4408

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPAREABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.

CONTRACT:
CONSTRUCTION
 TITLE:
 PROVIDE FREEZER & COOLER
 BUILDING 3, DINING ROOM 1
 LOCATION:
 MID-STATE CORRECTIONAL FACILITY
 RIVER ROAD
 MARCY, NEW YORK

CLIENT:
 DEPARTMENT OF CORRECTIONS
 AND COMMUNITY SUPERVISION

DATE	SUBMISSION / PHASE
01/28/2013	FINAL SUBMISSION
06/21/2013	ADDENDUM NO. 1

PROJECT NUMBER: **44549 - C**
 DESIGNED BY: JMF
 DRAWN BY: LLL
 FIELD CHECK:
 APPROVED:
 SCALE: AS NOTED

SHEET TITLE:
 FLOOR REINFORCEMENT
 PARTIAL FIRST FLOOR
 FRAMING PLAN
 DRAWING NUMBER:
D-02
 SHEET OF 12

BOOSTER PUMP SCHEDULE

UNIT NO.	SERVICE/ LOCATION	GPM	FT. HD. (IN-W.C.)	H.P.	RPM	POWER	TYPE	"BELL & GOSSETT" MODEL No. (BASIS OF DESIGN)
BP-1	AC-1 CRAWL SPACE	20	15	0.40	3200	120-1-60	INLINE BOOSTER	PL-130

REMARKS:

NOTE: MANUFACTURERS INDICATED ARE BASIS OF DESIGN. CONTRACTOR MAY SUBMIT EQUAL FOR APPROVAL.