



STATE OF NEW YORK
OFFICE OF GENERAL SERVICES
DESIGN AND CONSTRUCTION GROUP
THE GOVERNOR NELSON A. ROCKEFELLER
EMPIRE STATE PLAZA
ALBANY, NY 12242



ADDENDUM NO. 8 TO PROJECT NO. 44611

**ELECTRICAL WORK WITH ASBESTOS ABATEMENT
PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT
VARIOUS BUILDINGS
Hutchings Psychiatric Center
620 Madison Avenue
Syracuse, NY 13210**

June 4, 2014

NOTE: This Addendum forms a part of the Contract Documents. Insert it in the Project Manual. Acknowledge receipt of this Addendum in the space provided on the Bid Form.

DRAWINGS

1. Revised Drawings:
 - a. Drawing No. G-002, which reads "**INDEX OF DRAWINGS**"; the revised drawing list dated 5/13/2014 accompany this Addendum and supersede the same numbered original issued drawing.

2. The following **ACM ABATEMENT** drawings read as follows:
 - a. H-001 ASBESTOS ABATEMENT LEGEND
 - b. H-101 BUILDING 6 ASBESTOS REMOVAL PLAN – 1ST FLOOR
 - c. H-102 BUILDING 11 ASBESTOS REMOVAL PLAN – 1ST FLOOR
 - d. H-103 BUILDING 11 ASBESTOS REMOVAL PLAN – 2ND FLOOR
 - e. H-104 BUILDING 12 ASBESTOS REMOVAL PLAN – 1ST FLOOR
 - f. H-105 BUILDING 12 ASBESTOS REMOVAL PLAN – 2ND FLOOR
 - g. H-106 BUILDING 14 ASBESTOS REMOVAL PLAN – 1ST FLOOR
 - h. H-107 BUILDING 14 ASBESTOS REMOVAL PLAN – 3RD FLOOR
 - i. H-108 BUILDING 15 ASBESTOS REMOVAL PLAN – 1ST FLOOR
 - j. H-109 BUILDING 15 ASBESTOS REMOVAL PLAN – 2ND FLOOR
 - k. H-110 BUILDING 15 ASBESTOS REMOVAL PLAN – 3RD FLOOR
 - l. H-111 BUILDING 17 ASBESTOS REMOVAL PLAN – 3RD FLOOR
 - m. H-501 ASBESTOS REMOVAL DETAILS

ADDENDUM NO. 8 TO PROJECT NO. 44611

3. Addendum Drawings:

- a. Drawing No. E-128 has been added to the PAS drawing list and reads “ **BUILDING No. 17 SECURITY LAYOUT – FIRST FLOOR PLAN** “.
- b. Drawing No. E-131 has been added to the PAS drawing list and reads “ **BUILDING No. 12 SECURITY LAYOUT – FIRST FLOOR PLAN** “.
- c. Drawing No. E-132 has been added to the PAS drawing list and reads “ **BUILDING No. 15 SECURITY LAYOUT – FIRST FLOOR PLAN** “.
- d. Drawing No. E-133 has been added to the PAS drawing list and reads “ **BUILDING No. 15 SECURITY LAYOUT – SECOND FLOOR PLAN** “.
- e. Drawing No. E-134 has been added to the PAS drawing list and reads “ **BUILDING No. 15 SECURITY LAYOUT – THIRD FLOOR PLAN** “.
- f. These drawing accompany this addendum and forms part of the contract documents.

4. Revised Drawings:

- a. Drawing No. H-104, which reads “ **BUILDING 12 ASBESTOS REMOVAL PLAN – 1ST FLOOR** ”; The revised drawing dated 5/29/2014 accompanies this Addendum and supersedes the same numbered original issued drawing.

END OF ADDENDUM

Margaret F. Larkin
Acting Executive Director

HUTCHINGS PSYCHIATRIC CENTER

O.G.S. PROJECT No. 44611 - E

INDEX OF DRAWINGS

GENERAL

G-001 COVER SHEET
G-002 SHEET LIST

PAS

ELECTRICAL LEGEND AND GENERAL NOTES

E-001	BUILDING No. 2 SECURITY DEMOLITION – BASEMENT PLAN
ED-101	BUILDING No. 2 SECURITY DEMOLITION – FIRST FLOOR PLAN
ED-102	BUILDING No. 2 SECURITY DEMOLITION – SECOND FLOOR PLAN
ED-103	BUILDING No. 2 SECURITY DEMOLITION – THIRD FLOOR PLAN
ED-104	BUILDING No. 2 SECURITY DEMOLITION – THIRD FLOOR PLAN
ED-105	BUILDING No. 4 SECURITY DEMOLITION – BASEMENT PLAN
ED-106	BUILDING No. 4 SECURITY DEMOLITION – FIRST FLOOR PLAN
ED-107	BUILDING No. 4 SECURITY DEMOLITION – SECOND FLOOR PLAN
ED-108	BUILDING No. 4 SECURITY DEMOLITION – THIRD FLOOR PLAN
ED-109	BUILDING No. 5 SECURITY DEMOLITION – FIRST FLOOR PLAN
ED-110	BUILDING No. 5 SECURITY DEMOLITION – SECOND FLOOR PLAN
ED-111	BUILDING No. 5 SECURITY DEMOLITION – THIRD FLOOR PLAN
ED-112	BUILDING No. 6 SECURITY DEMOLITION – SECOND FLOOR PLAN
ED-113	BUILDING No. 6 SECURITY DEMOLITION – THIRD FLOOR PLAN
ED-114	BUILDING No. 11 SECURITY DEMOLITION – BASEMENT PLAN
ED-115	BUILDING No. 16 SECURITY DEMOLITION – BASEMENT PLAN
ED-116	BUILDING No. 16 SECURITY DEMOLITION – FIRST FLOOR PLAN
ED-119	BUILDING No. 17 SECURITY DEMOLITION – BASEMENT PLAN
ED-120	BUILDING No. 17 SECURITY DEMOLITION – FIRST FLOOR PLAN
ED-121	BUILDING No. 17 SECURITY DEMOLITION – SECOND FLOOR PLAN
ED-122	BUILDING No. 17 SECURITY DEMOLITION – THIRD FLOOR PLAN
E-104	BUILDING No. 2 SECURITY LAYOUT – BASEMENT PLAN
E-105	BUILDING No. 2 SECURITY LAYOUT – FIRST FLOOR PLAN
E-106	BUILDING No. 2 SECURITY LAYOUT – SECOND FLOOR PLAN
E-107	BUILDING No. 2 SECURITY LAYOUT – THIRD FLOOR PLAN
E-108	BUILDING No. 4 SECURITY LAYOUT – BASEMENT PLAN
E-109	BUILDING No. 4 SECURITY LAYOUT – FIRST FLOOR PLAN
E-110	BUILDING No. 4 SECURITY LAYOUT – SECOND FLOOR PLAN
E-111	BUILDING No. 4 SECURITY LAYOUT – THIRD FLOOR PLAN
E-112	BUILDING No. 5 SECURITY LAYOUT – BASEMENT PLAN
E-113	BUILDING No. 5 SECURITY LAYOUT – FIRST FLOOR PLAN
E-114	BUILDING No. 5 SECURITY LAYOUT – SECOND FLOOR PLAN
E-115	BUILDING No. 5 SECURITY LAYOUT – THIRD FLOOR PLAN
E-116	BUILDING No. 6 SECURITY LAYOUT – BASEMENT PLAN
E-117	BUILDING No. 6 SECURITY LAYOUT – FIRST FLOOR PLAN
E-118	BUILDING No. 6 SECURITY LAYOUT – SECOND FLOOR PLAN
E-119	BUILDING No. 6 SECURITY LAYOUT – THIRD FLOOR PLAN
E-120	BUILDING No. 11 SECURITY LAYOUT – BASEMENT PLAN
E-121	BUILDING No. 11 SECURITY LAYOUT – FIRST FLOOR PLAN
E-122	BUILDING No. 11 SECURITY LAYOUT – SECOND FLOOR PLAN
E-123	BUILDING No. 12 SECURITY LAYOUT – BASEMENT PLAN
E-124	BUILDING No. 15 SECURITY LAYOUT – BASEMENT PLAN
E-125	BUILDING No. 16 SECURITY LAYOUT – BASEMENT PLAN
E-126	BUILDING No. 16 SECURITY LAYOUT – FIRST FLOOR PLAN
E-127	BUILDING No. 17 SECURITY LAYOUT – BASEMENT PLAN
E-128	BUILDING No. 17 SECURITY LAYOUT – FIRST FLOOR PLAN
E-129	BUILDING No. 17 SECURITY LAYOUT – SECOND FLOOR PLAN
E-130	BUILDING No. 17 SECURITY LAYOUT – THIRD FLOOR PLAN
E-131	BUILDING No. 12 SECURITY LAYOUT – FIRST FLOOR PLAN
E-132	BUILDING No. 15 SECURITY LAYOUT – FIRST FLOOR PLAN
E-133	BUILDING No. 15 SECURITY LAYOUT – SECOND FLOOR PLAN
E-134	BUILDING No. 15 SECURITY LAYOUT – THIRD FLOOR PLAN
E-301	BUILDING Nos. 2 & 6 ELECTRICAL WIRING DIAGRAMS

PAS (CONT.)

E-502 BUILDING Nos. 4, 5 & 11 ELECTRICAL DIAGRAMS
E-503 BUILDING Nos. 12 & 15 ELECTRICAL DIAGRAMS
E-504 BUILDING Nos. 16 & 17 ELECTRICAL DIAGRAMS
E-505 ELECTRICAL DETAILS
E-900 SITE PLAN

FIRE PROTECTION

FA0-01	FIRE ALARM NOTES
FA0-02	FIRE ALARM LEGENDS
FA1-01	CAMPUS SITE FIBER PLAN
FA1-02	PEER TO PEER NETWORK DIAGRAM
FA-501	FIRE ALARM DETAILS
FA-502	FIRE ALARM DETAILS
FA-503	FIRE ALARM DETAILS
FA-504	FIRE ALARM DETAILS
FA-505	FIRE ALARM DETAILS
FA-506	FIRE ALARM DETAILS
FD2-1-01	BUILDING 2 FIRE ALARM DEMOLITION BASEMENT PLAN
FD2-1-02	BUILDING 2 FIRE ALARM DEMOLITION FIRST FLOOR PLAN
FD2-1-03	BUILDING 2 FIRE ALARM DEMOLITION SECOND FLOOR PLAN
FD2-1-04	BUILDING 2 FIRE ALARM DEMOLITION THIRD FLOOR PLAN
FA2-1-01	BUILDING 2 FIRE ALARM FIRST FLOOR PLAN
FA2-1-02	BUILDING 2 FIRE ALARM SECOND FLOOR PLAN
FA2-1-03	BUILDING 2 FIRE ALARM THIRD FLOOR PLAN
FA2-1-04	BUILDING 2 FIRE ALARM THIRD FLOOR PLAN
FA2-3-01	BUILDING 2 FIRE ALARM WIRING DIAGRAM
FA2-5-01	BUILDING 2 FACU WIRING DETAIL
FA2-6-01	BUILDING 2 FIRE ALARM SCHEDULES
FA2-6-02	BUILDING 2 FIRE ALARM CALCULATIONS
FD4-1-01	BUILDING 4 FIRE ALARM DEMOLITION BASEMENT PLAN
FD4-1-02	BUILDING 4 FIRE ALARM DEMOLITION FIRST FLOOR PLAN
FD4-1-03	BUILDING 4 FIRE ALARM DEMOLITION SECOND FLOOR PLAN
FD4-1-04	BUILDING 4 FIRE ALARM DEMOLITION THIRD FLOOR PLAN
FA4-1-01	BUILDING 4 FIRE ALARM BASEMENT PLAN
FA4-1-02	BUILDING 4 FIRE ALARM FIRST FLOOR PLAN
FA4-1-03	BUILDING 4 FIRE ALARM SECOND FLOOR PLAN
FA4-1-04	BUILDING 4 FIRE ALARM THIRD FLOOR PLAN
FA4-3-01	BUILDING 4 FIRE ALARM WIRING DIAGRAM
FA4-5-01	BUILDING 4 FACU WIRING DETAIL
FA4-6-01	BUILDING 4 FIRE ALARM SCHEDULES
FA4-6-02	BUILDING 4 FIRE ALARM CALCULATIONS
FD5-1-01	BUILDING 5 FIRE ALARM DEMOLITION BASEMENT PLAN
FD5-1-02	BUILDING 5 FIRE ALARM DEMOLITION FIRST FLOOR PLAN
FD5-1-03	BUILDING 5 FIRE ALARM DEMOLITION SECOND FLOOR PLAN
FD5-1-04	BUILDING 5 FIRE ALARM DEMOLITION THIRD FLOOR PLAN
FA5-1-01	BUILDING 5 FIRE ALARM BASEMENT PLAN
FA5-1-02	BUILDING 5 FIRE ALARM FIRST FLOOR PLAN
FA5-1-03	BUILDING 5 FIRE ALARM SECOND FLOOR PLAN
FA5-1-04	BUILDING 5 FIRE ALARM THIRD FLOOR PLAN
FA5-3-01	BUILDING 5 FIRE ALARM WIRING DIAGRAM
FA5-5-01	BUILDING 5 FACU WIRING DETAIL
FA5-6-01	BUILDING 5 FIRE ALARM SCHEDULES
FA5-6-02	BUILDING 5 FIRE ALARM CALCULATIONS
FD6-1-01	BUILDING 6 FIRE ALARM DEMOLITION BASEMENT PLAN
FD6-1-02	BUILDING 6 FIRE ALARM DEMOLITION FIRST FLOOR PLAN
FD6-1-03	BUILDING 6 FIRE ALARM DEMOLITION SECOND FLOOR PLAN
FD6-1-04	BUILDING 6 FIRE ALARM DEMOLITION THIRD FLOOR PLAN

FIRE PROTECTION (CONT.)

FA6-1-01	BUILDING 6 FIRE ALARM BASEMENT PLAN
FA6-1-02	BUILDING 6 FIRE ALARM FIRST FLOOR PLAN
FA6-1-03	BUILDING 6 FIRE ALARM SECOND FLOOR PLAN
FA6-1-04	BUILDING 6 FIRE ALARM THIRD FLOOR PLAN
FA6-5-01	BUILDING 6 FACU WIRING DETAIL
FA6-6-01	BUILDING 6 FIRE ALARM CALCULATIONS
FD10-1-01	BUILDING 10 FIRE ALARM DEMOLITION PARTIAL BASEMENT PLAN
FD10-1-02	BUILDING 10 FIRE ALARM DEMOLITION PARTIAL BASEMENT PLAN
FD10-1-03	BUILDING 10 FIRE ALARM DEMOLITION PARTIAL FIRST FLOOR PLAN
FD10-1-04	BUILDING 10 FIRE ALARM DEMOLITION PARTIAL FIRST FLOOR PLAN
FA10-1-01	BUILDING 10 FIRE ALARM PARTIAL BASEMENT PLAN
FA10-1-02	BUILDING 10 FIRE ALARM PARTIAL BASEMENT PLAN
FA10-1-03	BUILDING 10 FIRE ALARM PARTIAL FIRST FLOOR PLAN
FA10-1-04	BUILDING 10 FIRE ALARM PARTIAL FIRST FLOOR PLAN
FA10-5-01	BUILDING 10 FACU WIRING DETAIL
FA10-6-01	BUILDING 10 FIRE ALARM CALCULATIONS
FD11-1-01	BUILDING 11 FIRE ALARM DEMOLITION BASEMENT PLAN
FD11-1-02	BUILDING 11 FIRE ALARM DEMOLITION SECOND FLOOR PLAN
FA11-1-01	BUILDING 11 FIRE ALARM BASEMENT PLAN
FA11-1-02	BUILDING 11 FIRE ALARM FIRST FLOOR PLAN
FA11-1-03	BUILDING 11 FIRE ALARM SECOND FLOOR PLAN
FA11-5-01	BUILDING 11 FACU WIRING DETAIL
FA11-6-01	BUILDING 11 FIRE ALARM CALCULATIONS
FD12-1-01	BUILDING 12 FIRE ALARM DEMOLITION PARTIAL BASEMENT PLAN
FD12-1-02	BUILDING 12 FIRE ALARM DEMOLITION PARTIAL BASEMENT PLAN
FD12-1-03	BUILDING 12 FIRE ALARM DEMOLITION PARTIAL FIRST FLOOR PLAN
FD12-1-04	BUILDING 12 FIRE ALARM DEMOLITION PARTIAL FIRST FLOOR PLAN
FD12-1-05	BUILDING 12 FIRE ALARM DEMOLITION PARTIAL SECOND FLOOR PLAN
FD12-1-06	BUILDING 12 FIRE ALARM DEMOLITION PARTIAL SECOND FLOOR PLAN
FA12-1-01	BUILDING 12 FIRE ALARM PARTIAL BASEMENT PLAN
FA12-1-02	BUILDING 12 FIRE ALARM PARTIAL BASEMENT PLAN
FA12-1-03	BUILDING 12 FIRE ALARM PARTIAL FIRST FLOOR PLAN
FA12-1-04	BUILDING 12 FIRE ALARM PARTIAL FIRST FLOOR PLAN
FA12-1-05	BUILDING 12 FIRE ALARM PARTIAL SECOND FLOOR PLAN
FA12-1-06	BUILDING 12 FIRE ALARM PARTIAL SECOND FLOOR PLAN
FA12-5-01	BUILDING 12 FACU WIRING DETAIL
FA12-6-01	BUILDING 12 FIRE ALARM CALCULATIONS
FD14-1-01	BUILDING 14 FIRE ALARM DEMOLITION BASEMENT PLAN
FD14-1-02	BUILDING 14 FIRE ALARM DEMOLITION FIRST FLOOR PLAN
FD14-1-03	BUILDING 14 FIRE ALARM DEMOLITION SECOND FLOOR PLAN
FD14-1-04	BUILDING 14 FIRE ALARM DEMOLITION THIRD FLOOR PLAN
FD14-1-05	BUILDING 14 FIRE ALARM DEMOLITION THIRD FLOOR PLAN
FA14-1-01	BUILDING 14 FIRE ALARM BASEMENT PLAN
FA14-1-02	BUILDING 14 FIRE ALARM FIRST FLOOR PLAN
FA14-1-03	BUILDING 14 FIRE ALARM SECOND FLOOR PLAN
FA14-1-04	BUILDING 14 FIRE ALARM THIRD FLOOR PLAN
FA14-1-05	BUILDING 14 FIRE ALARM PERTHOUSE PLAN
FA14-5-01	BUILDING 14 FACU WIRING DETAIL
FA14-6-01	BUILDING 14 FIRE ALARM CALCULATIONS
FD15-1-01	BUILDING 15 FIRE ALARM DEMOLITION BASEMENT PLAN
FD15-1-02	BUILDING 15 FIRE ALARM DEMOLITION FIRST FLOOR
FD15-1-03	BUILDING 15 FIRE ALARM DEMOLITION SECOND FLOOR PLAN
FD15-1-04	BUILDING 15 FIRE ALARM DEMOLITION THIRD FLOOR PLAN
FA15-1-01	BUILDING 15 FIRE ALARM BASEMENT PLAN
FA15-1-02	BUILDING 15 FIRE ALARM FIRST FLOOR PLAN
FA15-1-03	BUILDING 15 FIRE ALARM SECOND FLOOR PLAN
FA15-1-04	BUILDING 15 FIRE ALARM THIRD FLOOR PLAN


FIRE PROTECTION (CONT.)

FA15-5-01	BUILDING 15 FACU WIRING DETAIL
FA15-6-01	BUILDING 15 FIRE ALARM CALCULATIONS
FA15-6-02	BUILDING 15 FIRE ALARM CALCULATIONS
FA16-1-01	BUILDING 16 FIRE ALARM BASEMENT PLAN
FA16-1-02	BUILDING 16 FIRE ALARM FIRST FLOOR PLAN
FA16-5-01	BUILDING 16 FACU WIRING DETAIL
FA16-5-02	BUILDING 16 NDU WIRING DETAIL
FA16-6-01	BUILDING 16 FIRE ALARM CALCULATIONS
FD17-1-01	BUILDING 17 FIRE ALARM DEMOLITION BASEMENT PLAN
FD17-1-02	BUILDING 17 FIRE ALARM DEMOLITION FIRST FLOOR PLAN
FD17-1-03	BUILDING 17 FIRE ALARM DEMOLITION SECOND FLOOR PLAN
FD17-1-04	BUILDING 17 FIRE ALARM DEMOLITION THIRD FLOOR PLAN
FD17-1-05	BUILDING 17 FIRE ALARM DEMOLITION PERTHOUSE PLAN
FA17-1-01	BUILDING 17 FIRE ALARM BASEMENT PLAN
FA17-1-02	BUILDING 17 FIRE ALARM FIRST FLOOR PLAN
FA17-1-03	BUILDING 17 FIRE ALARM SECOND FLOOR PLAN
FA17-1-04	BUILDING 17 FIRE ALARM THIRD FLOOR PLAN
FA17-1-05	BUILDING 17 FIRE ALARM PERTHOUSE PLAN
FA17-5-01	BUILDING 17 FACU WIRING DETAIL
FA17-6-01	BUILDING 17 FIRE ALARM CALCULATIONS

ACM ABATEMENT

H-001	ASBESTOS ABATEMENT LEGEND
H-101	BUILDING 6 ASBESTOS REMOVAL PLAN – 1ST FLOOR
H-102	BUILDING 11 ASBESTOS REMOVAL PLAN – 1ST FLOOR
H-103	BUILDING 11 ASBESTOS REMOVAL PLAN – 2ND FLOOR
H-104	BUILDING 12 ASBESTOS REMOVAL PLAN – 1ST FLOOR
H-105	BUILDING 12 ASBESTOS REMOVAL PLAN – 2ND FLOOR
H-106	BUILDING 14 ASBESTOS REMOVAL PLAN – 1ST FLOOR
H-107	BUILDING 14 ASBESTOS REMOVAL PLAN – 3RD FLOOR
H-108	BUILDING 15 ASBESTOS REMOVAL PLAN – 1ST FLOOR
H-109	BUILDING 15 ASBESTOS REMOVAL PLAN – 2ND FLOOR
H-110	BUILDING 15 ASBESTOS REMOVAL PLAN – 3RD FLOOR
H-111	BUILDING 17 ASBESTOS REMOVAL PLAN – 3RD FLOOR
H-301	ASBESTOS REMOVAL DETAILS


G-002

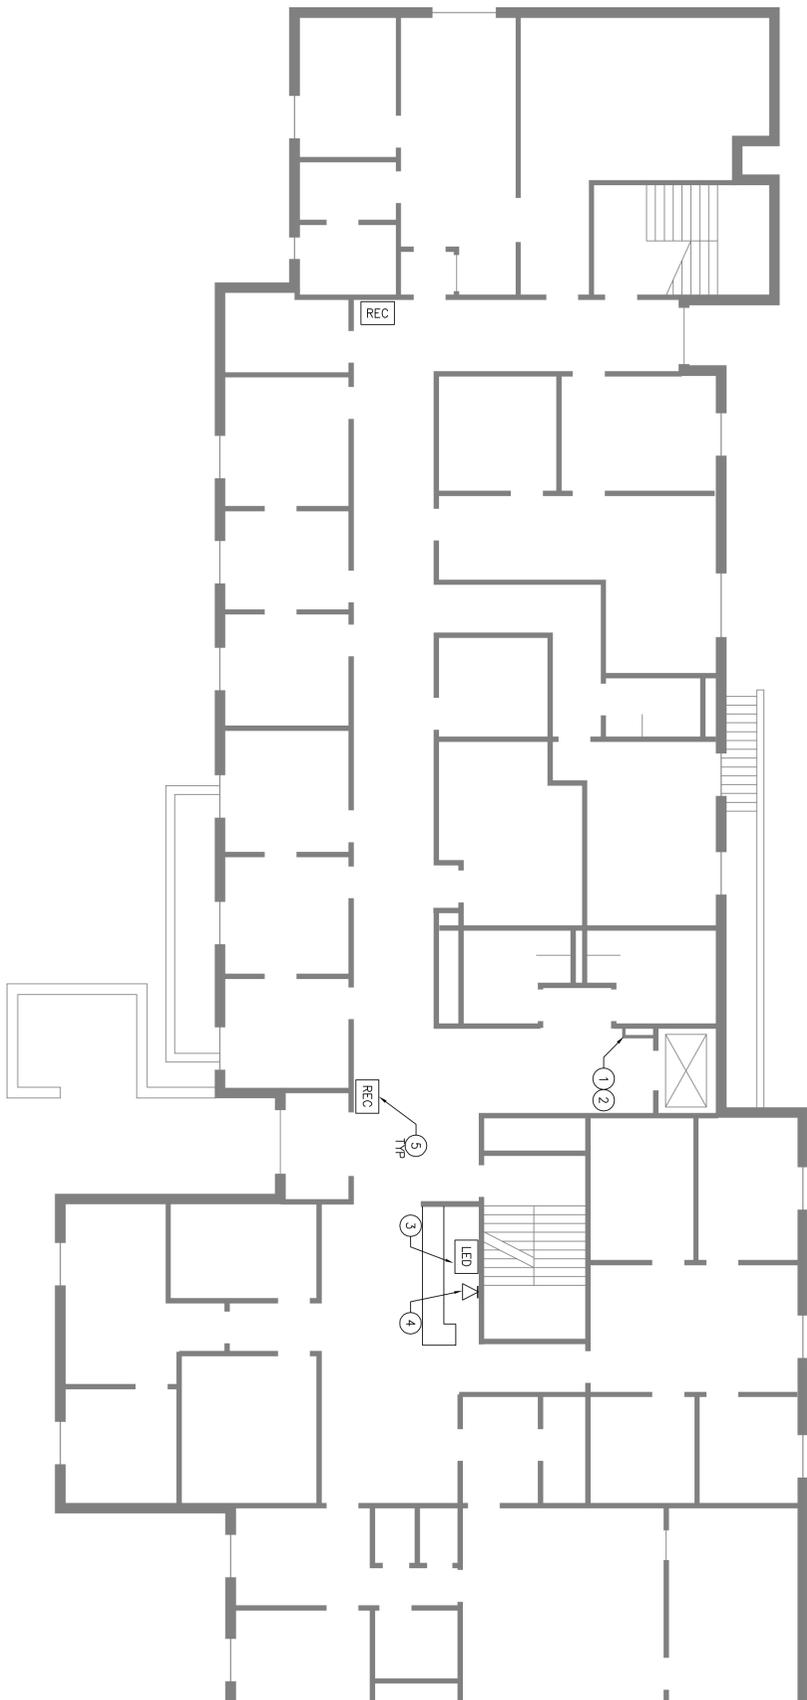

FIRST FLOOR SECURITY PLAN
 SCALE: 1/8" = 1'-0"

- GENERAL NOTES**
- REFER TO DETAIL 2 PAS RISER DIAGRAM BEING MADE ON DRAWING E-04 FOR WIRING REQUIREMENTS OF THE PAS.
 - CABLE SHALL BE ROUTED ABOVE CEILING. PROVIDE PLENUM RATED CABLE ABOVE CEILING. UTILIZE ACCESS PANELS FOR ROUTING OF CABLE.
 - PROVIDE SURFACE MOUNT RACEWAY WITH WIRING FROM SURFACE MOUNTED LED NOTIFICATION PANELS, ALERT CHIMES AND RECEIVERS TO ABOVE ACCESSIBLE CEILING.

- CODED NOTES**
- EXISTING CONDUIT CHASE WITH (1) EXISTING 3" CONDUIT SLEEVES WHICH PENETRATE FLOOR/CEILING. REUSE FOR INSTALLATION OF BOSCH PAS BUS, LED NOTIFICATION AND AUDIBLE SIGNAL CABLES.
 - EXISTING ACCESS PANEL FOR ACCESSING CONDUIT CHASE. PROVIDE ADDITIONAL CABLE SUPPORT FOR ALL BOSCH PAS BUS, LED NOTIFICATION AND AUDIBLE SIGNAL CABLES.
 - PROVIDE LED NOTIFICATION PANEL, MOUNT INDICATOR AT 84" AFF TO BOTTOM OF UNIT. PROVIDE LED NOTIFICATION PANEL, MOUNT INDICATOR TO BEID NO. LED AT 51" AFF AND 17" ON DRAWING E-505 FOR ADDITIONAL INFORMATION.
 - PROVIDE ALERT CHIME, MOUNT ALERT CHIME AT 84" AFF TO BOTTOM OF UNIT.
 - PROVIDE BOSCH RECEIVER, MOUNT RECEIVER ON WALL AT 72" AFF TO BOTTOM OF UNIT.



OOS
 NYS OFFICE OF GENERAL SERVICES
Spring New York
ANDREW M. CUOMO
 Governor
ROBERT M. DENTINO
 Commissioner

CH2M
 111 Warren Circle, PO Box 5288, Albany, NY 12205-0288
 Main: (518) 453-4500 www.ch2m.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCIAL DRIVE | SUITE 817
 BALTIMORE, MARYLAND | 21227
 P 410.731.8977 | F 410.536.5016
 www.hallie.com

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT PROFESSIONAL ENGINEER, IS PROHIBITED. ANY ALTERATION FOR ANY PURPOSE, INCLUDING THE REVISION OF THIS DRAWING FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.

CONTRACT:
ELECTRICAL

TITLE:
 PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT

LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210

CLIENT:
 NYS OFFICE OF MENTAL HEALTH

MARK	DATE	DESCRIPTION
NO.2	05/29/14	ADDENDUM
NO.1	05/13/14	ADDENDUM
A	03/03/14	FINAL BID DOCUMENTS

PROJECT NUMBER: 44611

DESIGNED BY: FI

DRAWN BY: DAS

FIELD CHECK: -


APPROVED: FI

SHEET TITLE:

BUILDING NO. 17
SECURITY LAYOUT -
FIRST FLOOR

DRAWING NUMBER: E-128

SHEET # OF 29

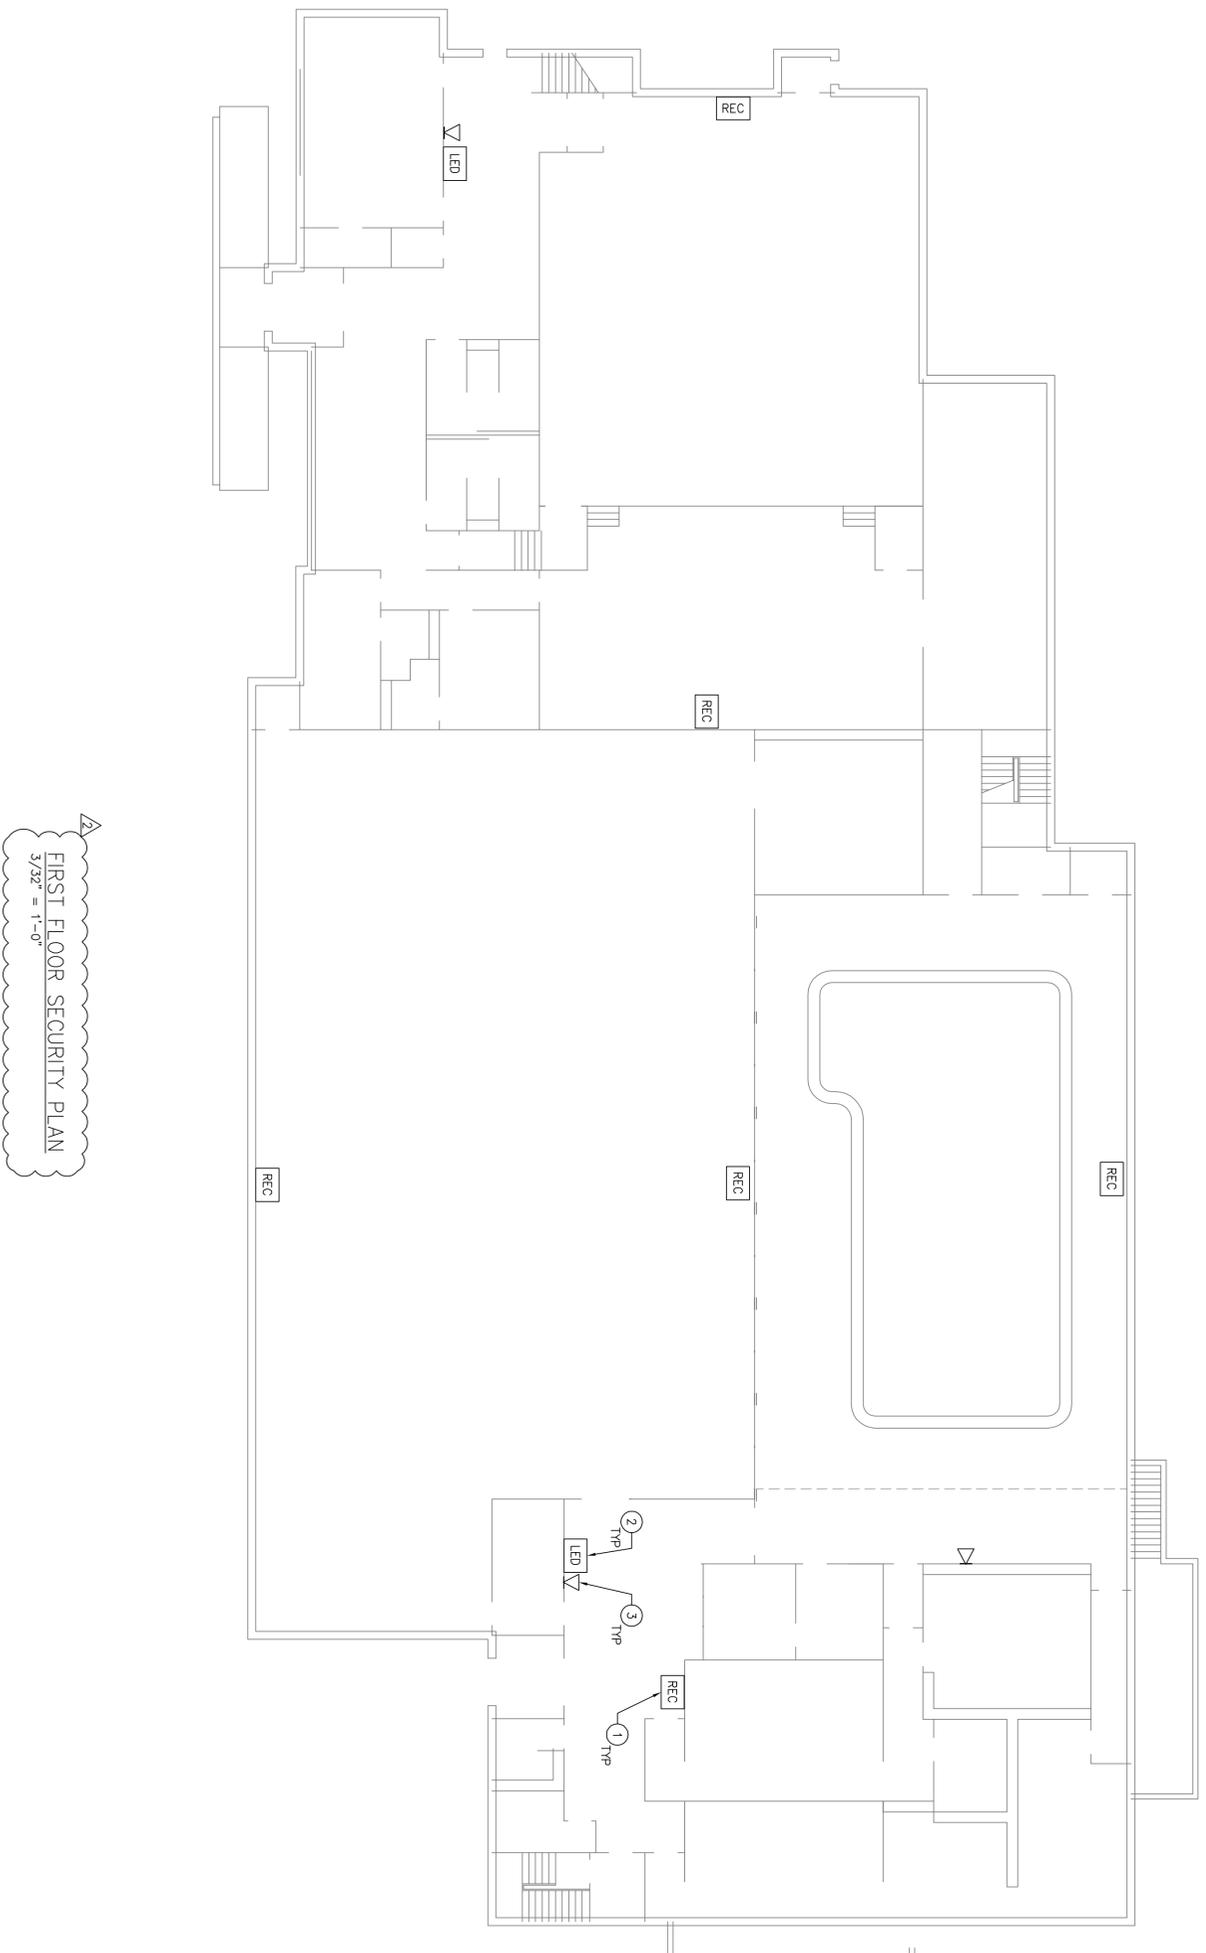

FIRST FLOOR SECURITY PLAN
 3/32" = 1'-0"

GENERAL NOTES
 A. REFER TO DETAIL 1, PAS RISER DIAGRAM BUILDING NO. 12, ON DRAWING E-503 FOR WIRING REQUIREMENTS OF THE PAS.

CODED NOTES
 1. PROVIDE BOSCH RECEIVER MOUNT IN HOUSING AT 72" AFF TO BOTTOM OF UNIT.
 2. PROVIDE LED NOTIFICATION PANEL, MOUNT AT 72" AFF TO BOTTOM OF UNIT. REFER TO DETAIL 1, PAS RISER DIAGRAM INDICATOR BUILDING NO. 12 ON DRAWING E-505 FOR ADDITIONAL INFORMATION.
 3. PROVIDE ALERT CHIME MOUNT AT 78" AFF TO BOTTOM OF UNIT.





OOS
 NYS OFFICE OF GENERAL SERVICES
Spring New York

ANDREW M. CUOMO
 Governor
ROBERT M. DESSITTO
 Commissioner

CHA
 111 Warren Circle, PO Box 5286 Albany, NY 12205-0286
 Main: (518) 455-4500 www.chanyc.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE | SUITE 817
 BALTIMORE | MARYLAND | 21227
 P 410.731.8977 | F 410.536.5016
 www.hughes.com

WARNING:
 THE ATTENTION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER, IS NOT TO BE CONSIDERED AS A PROFESSIONAL ENGINEER'S SEAL OR SIGNATURE. ANY UNLAWFUL USE OF THIS SEAL OR SIGNATURE FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.

CONTRACT:
ELECTRICAL

TITLE:
 PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT

LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210

CLIENT:
 NYS OFFICE OF MENTAL HEALTH

No.	DATE	DESCRIPTION
No. 2	05/29/14	ADDENDUM
No. 1	05/13/14	ADDENDUM
A	03/03/14	FINAL BD DOCUMENTS

PROJECT NUMBER: 44611

DESIGNED BY: DS

DRAWN BY: KL

FIELD CHECK: -


APPROVED: GC

SHEET TITLE:

BUILDING NO. 12 SECURITY LAYOUT - FIRST FLOOR PLAN

DRAWING NUMBER: E-131

SHEET # 29 **OF** 29

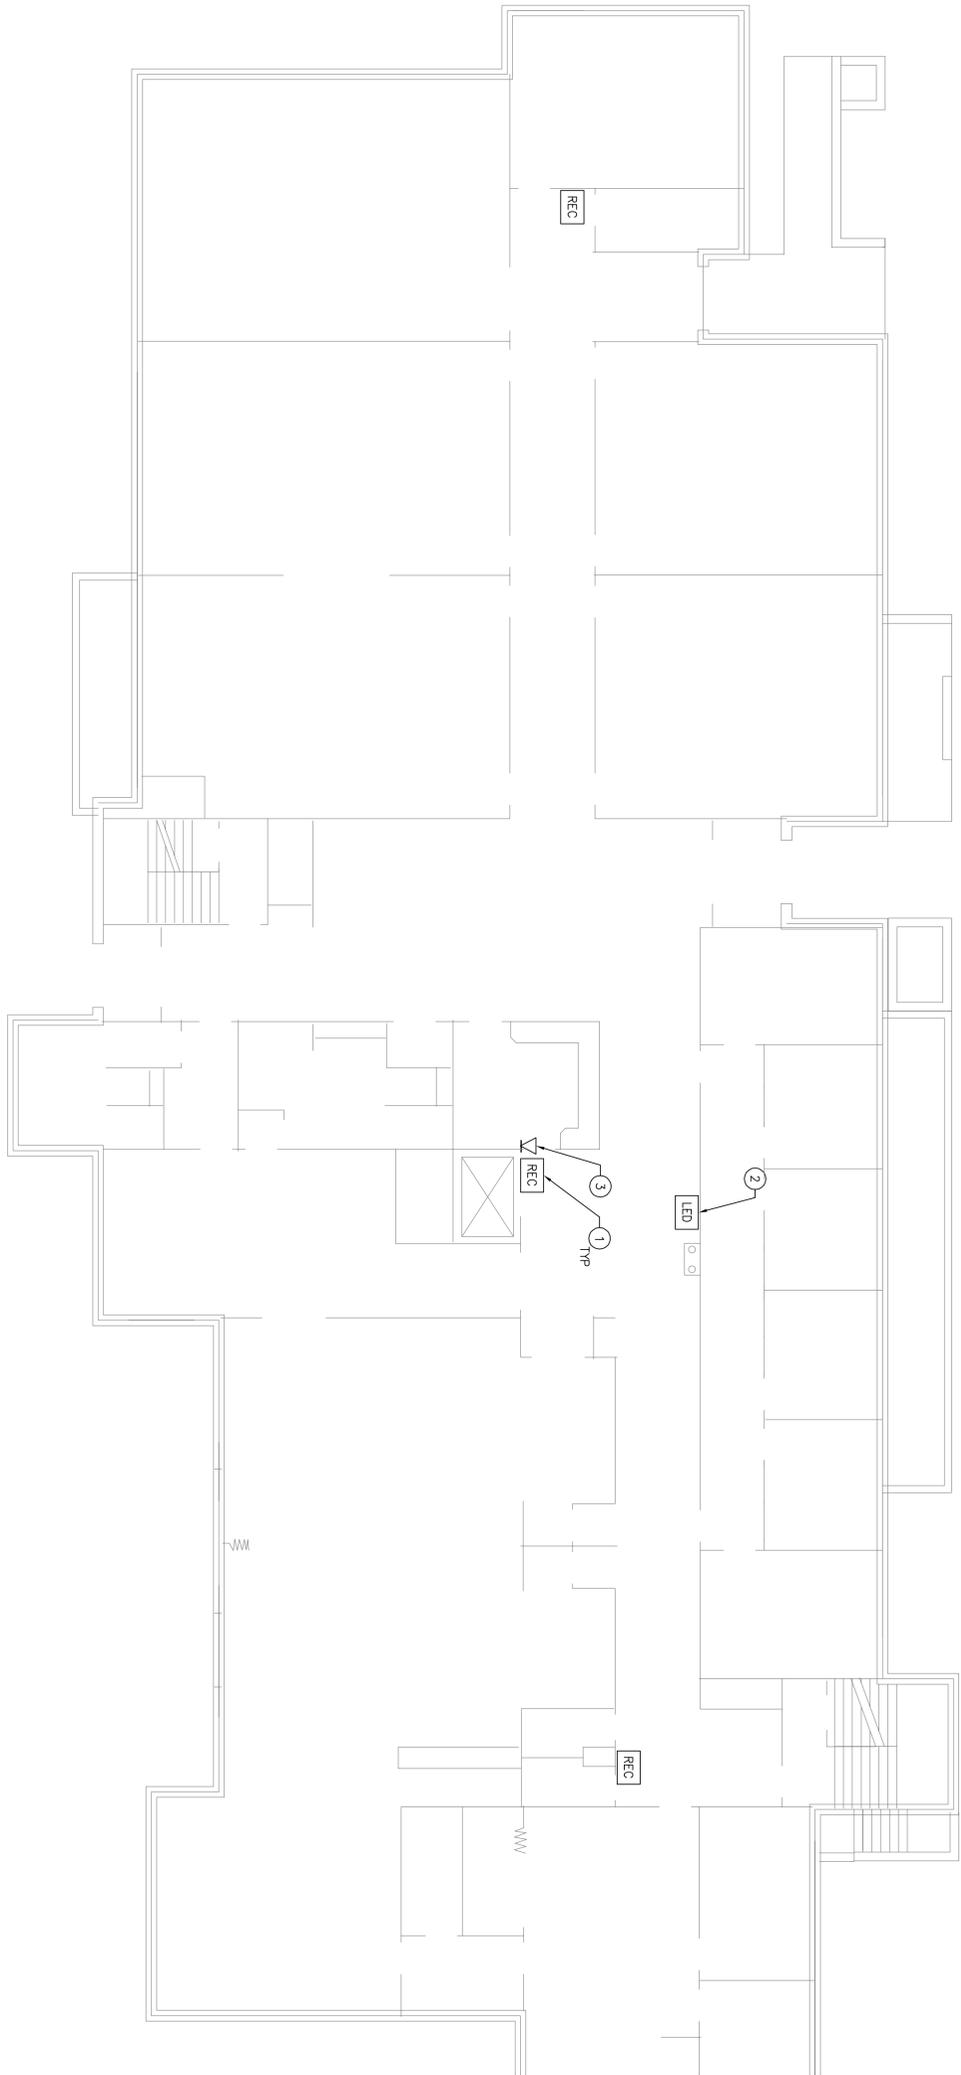

FIRST FLOOR SECURITY PLAN
 1/8" = 1'-0"

- GENERAL NOTES**
- A. REFER TO DETAIL 2, PAS RISER DIAGRAM BUILDING NO. 15, ON DRAWING E-503 FOR WIRING REQUIREMENTS OF THE PAS.
- CODED NOTES**
- 1 PROVIDE BOSCH RECEIVER, MOUNT AT 72" AFF TO BOTTOM OF UNIT.
 - 2 MOUNT AT 84" AFF TO BOTTOM OF UNIT, REFER TO DETAIL 7, LED NOTIFICATION INDICATOR BLDG NO. 15, ON DRAWING E-505 FOR ADDITIONAL INFORMATION.
 - 3 PROVIDE ALERT CHIME, MOUNT AT 78" AFF TO BOTTOM OF UNIT.



OOS
 NYS OFFICE OF GENERAL SERVICES
Spring New York
ANDREW M. CUOMO
 Governor
RODOLFO DESITTO
 Commissioner

CH2A
 111 Warren Circle, PO Box 5288 Albany, NY 12205-0288
 Main: (518) 453-4500 www.ch2a.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCIAL DRIVE | SUITE 817
 BALTIMORE | MARYLAND | 21227
 P 410.731.8977 | F 410.536.5016
 www.hughes.com

WARNING:
 THE ATTENTION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER, IS NOT TO BE CONSIDERED AS A PROFESSIONAL ENGINEER'S SEAL OR AS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.

CONTRACT:
ELECTRICAL

TITLE:
 PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT

LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210


CLIENT:
 NYS OFFICE OF MENTAL HEALTH

NO.2	05/29/14	ADDENDUM
NO.1	05/13/14	ADDENDUM
A	03/03/14	FINAL BD DOCUMENTS
MARK	DATE	DESCRIPTION
PROJECT NUMBER	44611	
DESIGNED BY:	DS	
DRAWN BY:	KL	
FIELD CHECK:	-	
APPROVED:	GC	

BUILDING NO. 15 SECURITY LAYOUT - FIRST FLOOR PLAN

DRAWING NUMBER: **E-132**

SHEET # OF 29

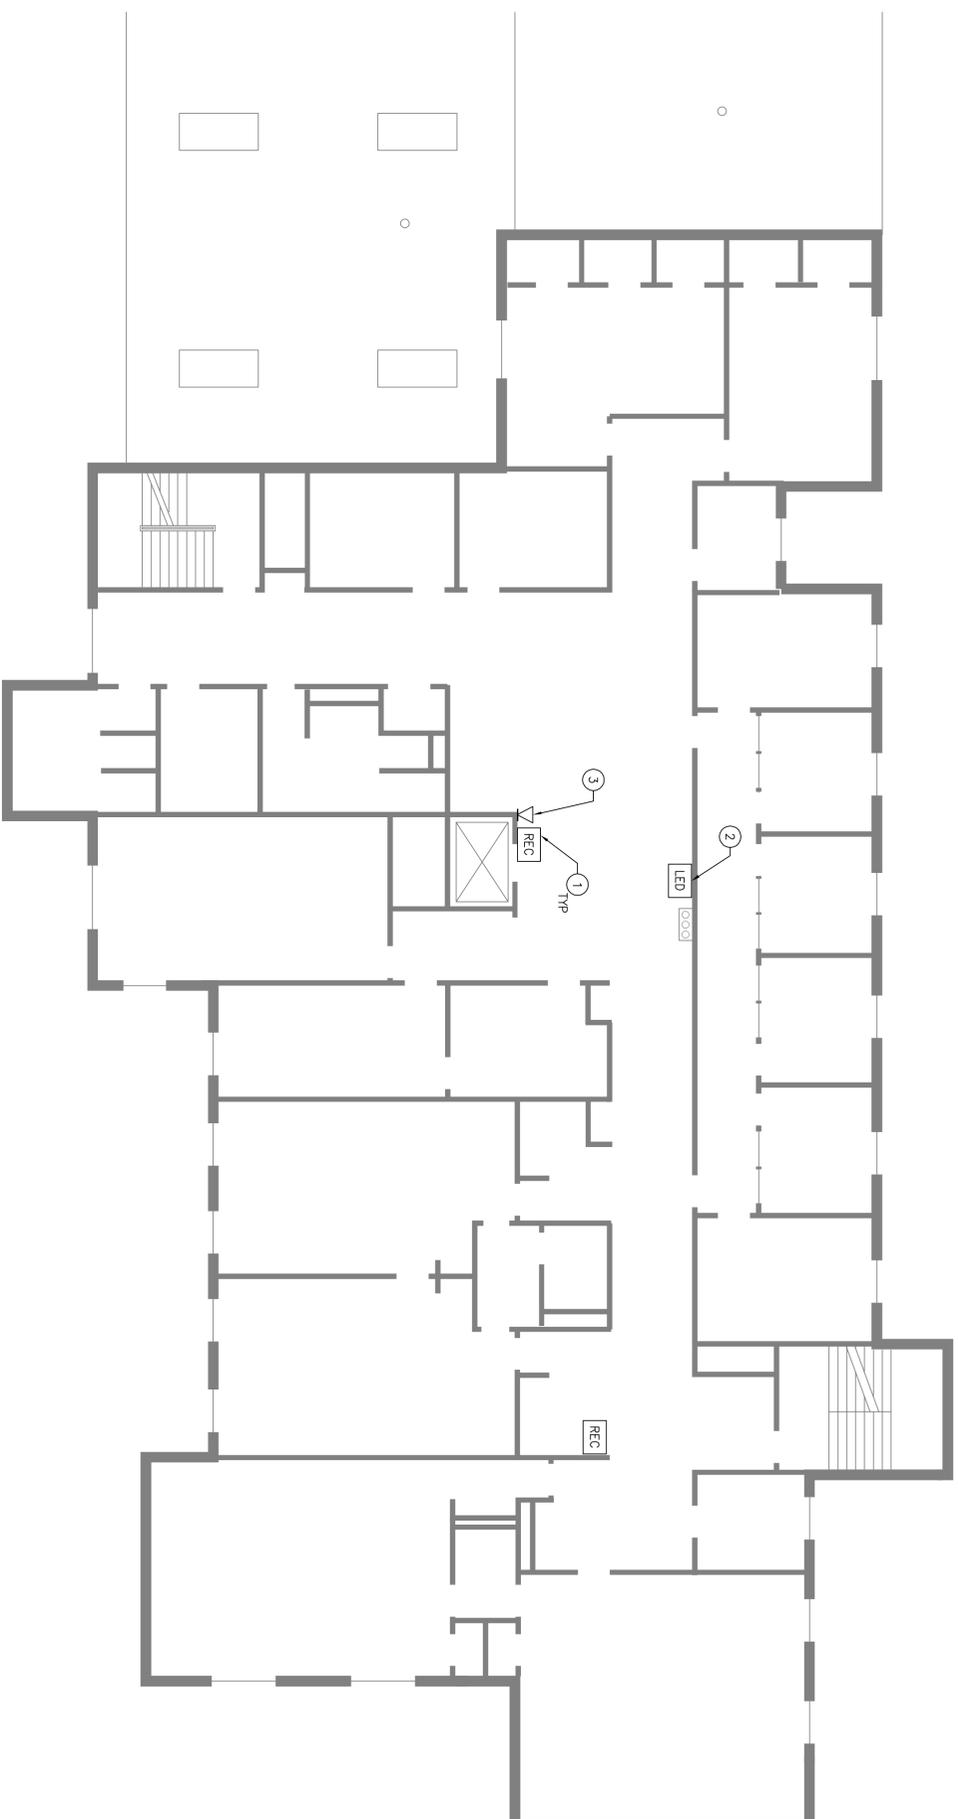

SECOND FLOOR SECURITY PLAN
 1/8" = 1'-0"

GENERAL NOTES
 A. REFER TO DETAIL 2, PAS RISER DIAGRAM BUILDING NO. 15, ON DRAWING E-503 FOR WIRING REQUIREMENTS OF THE PAS.

CODED NOTES
 1. PROVIDE BOSCH RECEIVER, MOUNT AT 72" AFF TO BOTTOM OF UNIT.
 2. PROVIDE LED NOTIFICATION PANEL, MOUNT AT 84" AFF TO BOTTOM OF UNIT. REFER TO DETAIL 7, LED NOTIFICATION INDICATOR BLDG NO. 15, ON DRAWING E-505 FOR ADDITIONAL INFORMATION.
 3. PROVIDE ALERT CHIME, MOUNT AT 78" AFF TO BOTTOM OF UNIT.



OOS
 NYS OFFICE OF GENERAL SERVICES
Spring New York
ANDREW M. CUOMO
 Governor
RODAN M. DESITTO
 Commissioner

CHM
 111 Warren Circle, PO Box 5286 Albany, NY 12205-0286
 Main: (518) 453-4500 www.chmny.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE | SUITE 817
 BALTIMORE | MARYLAND | 21227
 P 410.731.8977 | F 410.536.5016
 www.hughes.com

WARNING:
 THE ATTENTION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER, IS FOR INFORMATION ONLY. IT IS NOT TO BE USED FOR AN ENGINEER OF ARCHITECT OR LANDSCAPE ARCHITECT. FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.

CONTRACT:
ELECTRICAL

TITLE:
 PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT

LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210


CLIENT:
 NYS OFFICE OF MENTAL HEALTH

NO.	DATE	DESCRIPTION
NO. 2	05/29/14	ADDENDUM
NO. 1	05/13/14	ADDENDUM
A	03/03/14	FINAL BD DOCUMENTS
MARK	DATE	DESCRIPTION
PROJECT NUMBER	44611	
DESIGNED BY:	DS	
DRAWN BY:	KL	
FIELD CHECK:	-	
APPROVED:	GC	

SHEET TITLE:
 BUILDING NO. 15 SECURITY LAYOUT - SECOND FLOOR PLAN

DRAWING NUMBER:
E-133

SHEET # OF 29

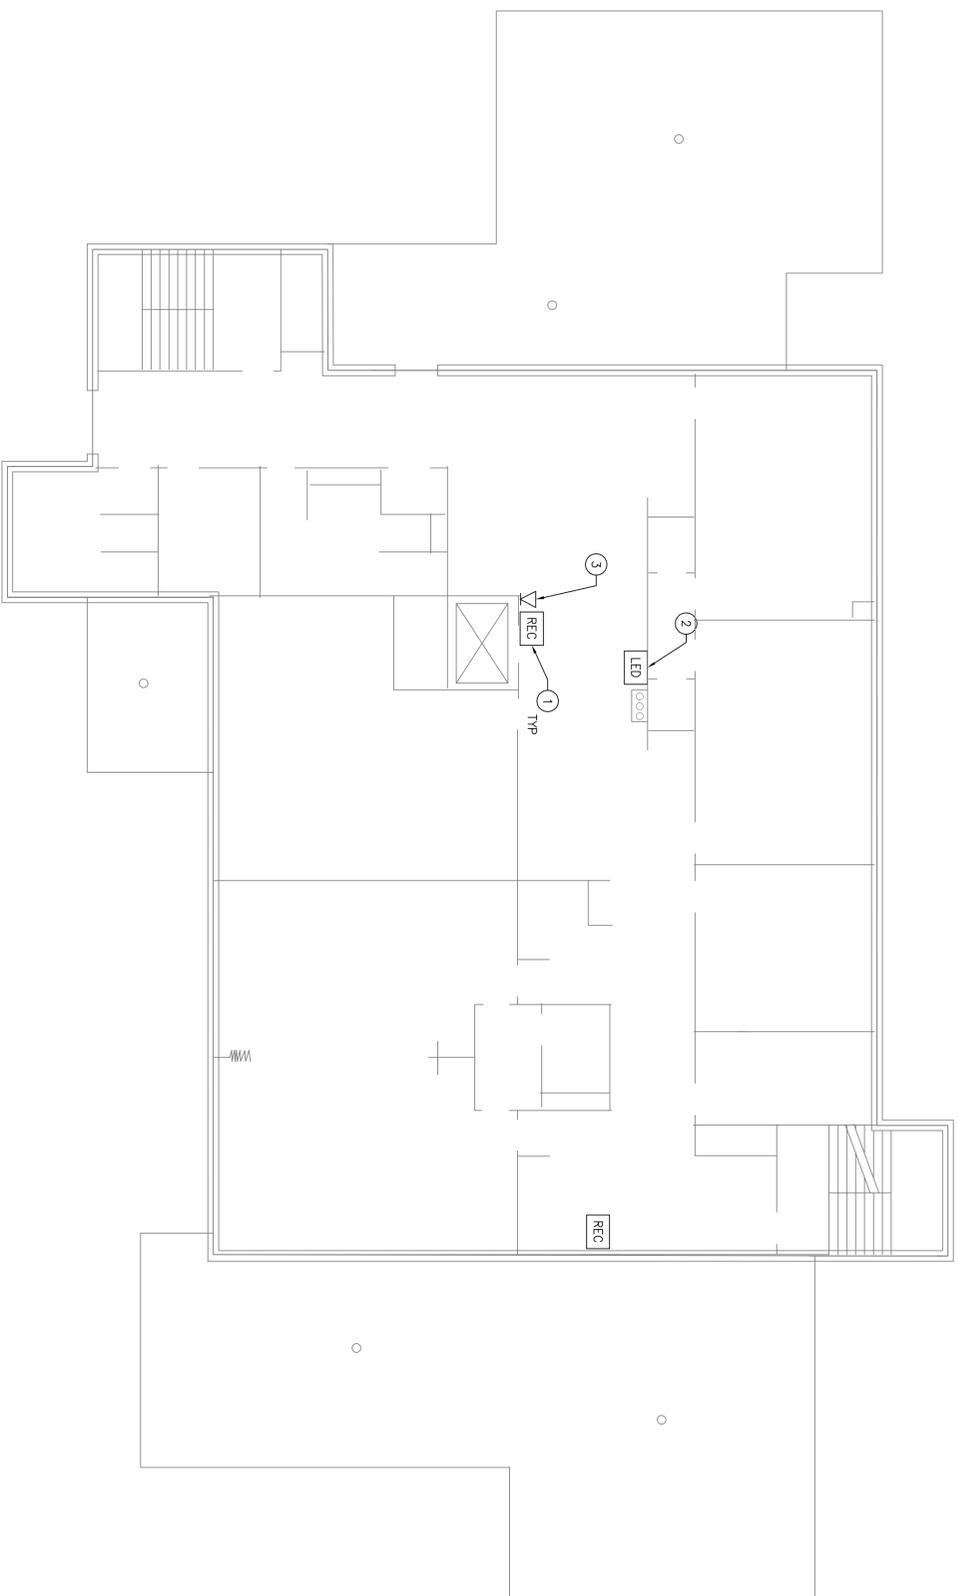

THIRD FLOOR SECURITY PLAN
 1/8" = 1'-0"

- GENERAL NOTES**
- REFER TO DETAIL 2, PAS RISER DIAGRAM BUILDING NO. 15, ON DRAWING E-503 FOR WIRING REQUIREMENTS OF THE PAS.
- CODED NOTES**
- PROVIDE BOSCH RECEIVER, MOUNT AT 72" AFF TO BOTTOM OF UNIT.
 - MOUNT AT 84" AFF TO BOTTOM OF UNIT, REFER TO DETAIL 7, LED NOTIFICATION INDICATOR BLDG NO. 15, ON DRAWING E-505 FOR ADDITIONAL INFORMATION.
 - PROVIDE ALERT CHIME, MOUNT AT 78" AFF TO BOTTOM OF UNIT.



OOS
 NYS OFFICE OF GENERAL SERVICES
Spring New York
ANDREW M. CUOMO
 Governor
RODOLFO DESITTO
 Commissioner

CH2M
 111 Warren Circle, PO Box 5286 Albany, NY 12205-0286
 Main: (518) 453-4500 www.ch2m.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE | SUITE 817
 BALTIMORE | MARYLAND | 21227
 P 410.737.8977 | F 410.536.5016
 www.hughes.com

WARNING:
 THE ATTENTION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER, IS NOT TO BE CONSIDERED AN AUTHORIZED REPRESENTATION OF AN ENGINEER OF ARCHITECTS OR A LANDSCAPE ARCHITECT. IT IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.

CONTRACT:
ELECTRICAL

TITLE:
 PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT

LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210

CLIENT:
 NYS OFFICE OF MENTAL HEALTH

NO.	DATE	DESCRIPTION
NO.2	05/29/14	ADDENDUM
NO.1	05/13/14	ADDENDUM
A	03/03/14	FINAL BID DOCUMENTS

PROJECT NUMBER: 44611

DESIGNED BY: DS


DRAWN BY: KL

FIELD CHECK: -

APPROVED: GC

SHEET TITLE:
 BUILDING NO. 15
 SECURITY LAYOUT -
 THIRD FLOOR PLAN

DRAWING NUMBER: E-134
 SHEET # OF 29

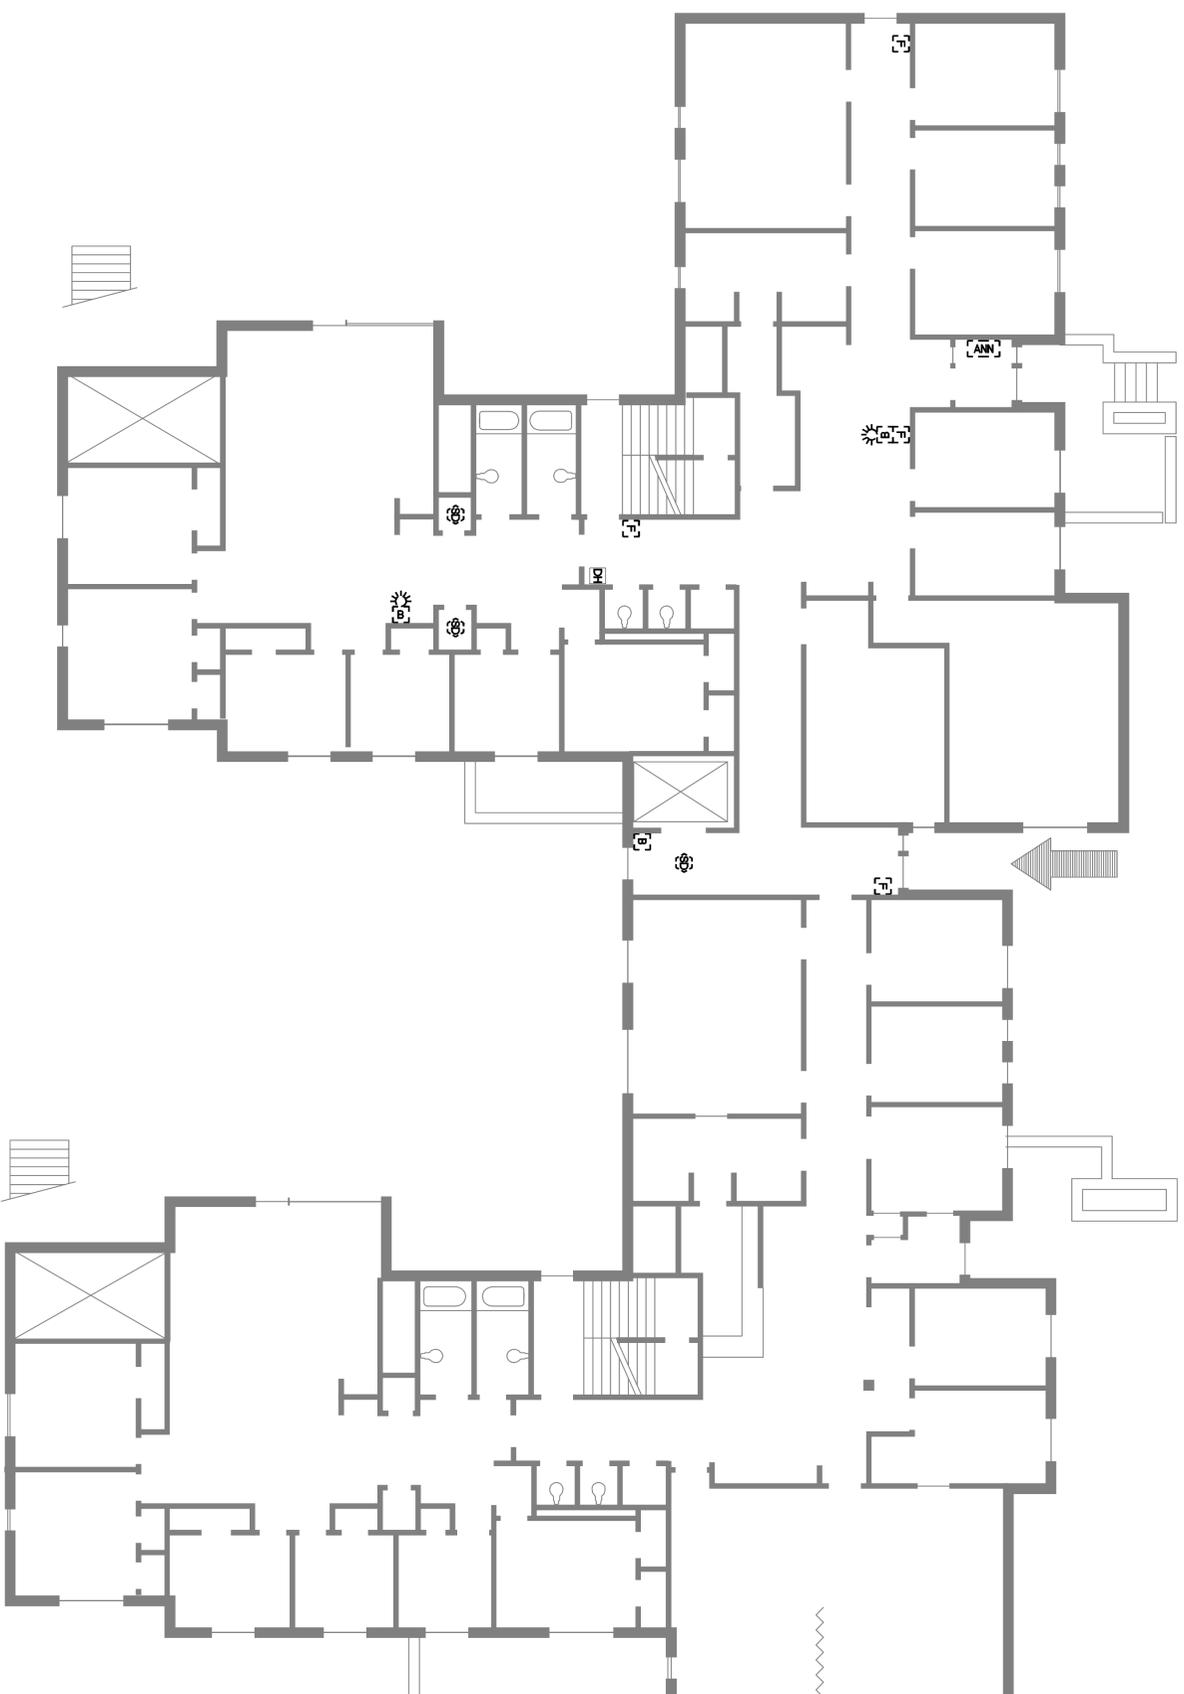


FIRST FLOOR ASBESTOS REMOVAL PLAN
 1/8" = 1'-0"

- GENERAL NOTES**
- 1 ALL WORK SHALL COMPLY WITH APPLICABLE FEDERAL, STATE, AND LOCAL REGULATIONS AND ALL WORK OF THIS CONTRACT SHALL BE COMPLETED BY A LICENSED ASBESTOS ABATEMENT CONTRACTOR USING APPROPRIATELY TRAINED AND CERTIFIED ASBESTOS ABATEMENT WORKERS.
 - 2 REFER TO SPECIFICATION SECTION 003126 FOR ASBESTOS TEST RESULTS. REFER TO SPECIFICATION SECTION 028213 - ASBESTOS ABATEMENT FOR REQUIREMENTS.
 - 3 DUE TO THE MINIMAL OVERALL QUANTITIES OF THE DISTURBANCE TO WALLS, CEILINGS, AND FLOORS PLANNED IN EACH BUILDING, ALL WORK OF THIS PROJECT IS CONSIDERED A MINOR ASBESTOS ABATEMENT PROJECT.
 - 4 ALL FIRE SYSTEM DEMOLITION SYMBOLS SHOWN ON THE H-SERIES DRAWINGS ARE TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. EACH OF THESE FIRE SYSTEM REMOVAL LOCATIONS ALSO REPRESENTS A REPLACEMENT LOCATION WHERE BACKBOX INSTALLATION MUST BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. REFER TO FA & FD SERIES DRAWINGS TO CONFIRM AND COORDINATE LOCATIONS. CODED NOTES SHOWN ON EACH OF THE H-SERIES DRAWINGS CORRELATE TO THE PAS REMOVALS AND INSTALLATIONS AND ARE ALSO ALL TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS.
 - 5 INSTALLATION DETAILS ARE SHOWN ON DRAWINGS H-501, FA-501, FA-502, AND FA-503. ALL INSTALLATIONS SHALL BE SURFACE MOUNT AND MINIMIZE DISTURBANCE TO WALL AND CEILING SURFACES TO THAT OF MOUNTING SCREWS/BOLTS.
 - 6 ALL ABOVE CEILING WORK THAT DOES NOT INVOLVE ACTIVE ABATEMENT SHALL TAKE ALL PRECAUTIONS TO AVOID CONTACT WITH, AND DAMAGE TO, ASBESTOS-CONTAINING JOINT COMPOUND ON THE TOP OF SHEETROCK WALLS.
 - 7 FOLLOWING REMOVALS, PENETRATIONS AND HOLES LEFT BEHIND SHALL BE SEALED AND PATCHED. PATCHING SHALL ENCAPSULATE THE ROUGH OPENING/S AND SHALL NOT INCLUDE ANY SANDING OR OTHER ACTIVITIES THAT COULD CREATE ADDITIONAL FIBER RELEASE. FINISH BY PAINTING TO MATCH EXISTING PAINT.
 - 8

FIRE SYSTEM DEMOLITION AND INSTALLATION LEGEND

	EXISTING BELL
	EXISTING BELL/STROBE
	EXISTING SMOKE DETECTOR
	EXISTING MANUAL PULL STATION
	EXISTING REMOTE ANNUNCIATOR



OOS
 NYS'S OFFICE OF GENERAL SERVICES
Spring New York
ANDREW M. CUOMO
 Governor
ROANN M. DESTITO
 Commissioner

CHA
 111 Warren Circle, PO Box 5286 Albany, NY 12205-0286
 Main: (518) 455-4500 www.chaonline.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE SUITE 817
 BALTIMORE, MARYLAND 21227
 P 410.731.8977 F 410.536.5016
 www.hughes.com

WARNING:
 THE ATTENTION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER OR ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.

ELECTRICAL
 PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT

CLIENT:
 NYS OFFICE OF MENTAL HEALTH

LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210

NO.	DATE	DESCRIPTION
NO.2	05/29/14	ADDENDUM
NO.1	05/13/14	ADDENDUM
A	03/03/14	FINAL BID DOCUMENTS

PROJECT NUMBER: 44611

DESIGNED BY: SHF

DRAWN BY: DMS

FIELD CHECK: -


APPROVED: MH

SHEET TITLE:
 BUILDING 6 ASBESTOS REMOVAL PLAN - 1ST FLOOR

DRAWING NUMBER: H-101

SHEET: 185 of 196

	EXISTING STROBE
	EXISTING BELL/STROBE
	CHIME
	EXISTING SMOKE DETECTOR
	EXISTING HEAT DETECTOR
	EXISTING MANUAL PULL STATION
	EXISTING REMOTE ANNUNCIATOR

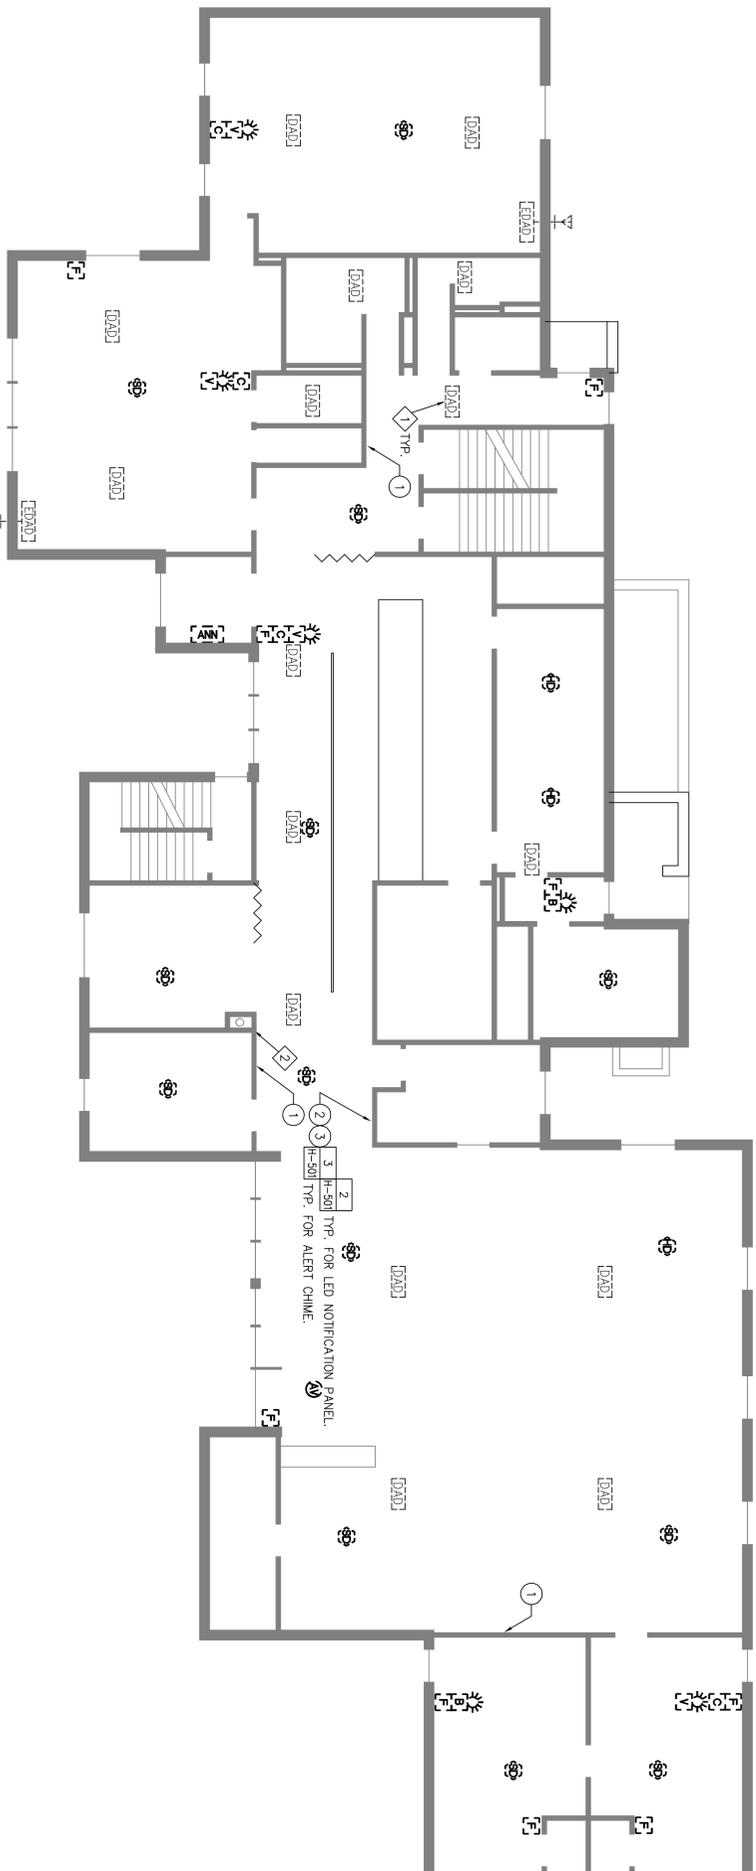

FIRST FLOOR ASBESTOS REMOVAL PLAN
 1/8" = 1'-0"

GENERAL NOTES

- ALL WORK SHALL COMPLY WITH APPLICABLE FEDERAL, STATE, AND LOCAL REGULATIONS AND ALL WORK OF THIS CONTRACT SHALL BE COMPLETED BY A LICENSED ASBESTOS ABATEMENT CONTRACTOR USING APPROPRIATELY TRAINED AND CERTIFIED ASBESTOS ABATEMENT WORKERS.
- REFER TO SPECIFICATION SECTION 003126 FOR ASBESTOS TEST RESULTS. REFER TO SPECIFICATION SECTION 028213 - ASBESTOS ABATEMENT FOR REQUIREMENTS.
- DUE TO THE MINIMAL OVERALL QUANTITIES OF THE DISTURBANCE TO WALLS, CEILINGS, AND FLOORS PLANNED IN EACH BUILDING, ALL WORK OF THIS PROJECT IS CONSIDERED A MINOR ASBESTOS ABATEMENT PROJECT.
- ALL FIRE SYSTEM DEMOLITION SYMBOLS SHOWN ON THE H-SERIES DRAWINGS ARE TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. EACH OF THESE FIRE SYSTEM REMOVAL LOCATIONS ALSO REPRESENTS A REPLACEMENT LOCATION WHERE BACKBOX INSTALLATION MUST BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. REFER TO FA & FD SERIES DRAWINGS TO CONFIRM AND COORDINATE LOCATIONS.
- CODED NOTES SHOWN ON EACH OF THE H-SERIES DRAWINGS CORRELATE TO THE PAS REMOVALS AND INSTALLATIONS AND ARE ALSO ALL TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS.
- INSTALLATION DETAILS ARE SHOWN ON DRAWINGS H-501, FA-501, FA-502, AND FA-503. ALL INSTALLATIONS SHALL BE SURFACE MOUNT AND MINIMIZE DISTURBANCE TO WALL AND CEILING SURFACES TO THAT OF MOUNTING SCREWS/BOLTS.
- ALL ABOVE CEILING WORK THAT DOES NOT INVOLVE ACTIVE ABATEMENT SHALL TAKE ALL PRECAUTIONS TO AVOID CONTACT WITH, AND DAMAGE TO, ASBESTOS-CONTAINING JOINT COMPOUND ON THE TOP OF SHEETROCK WALLS.
- FOLLOWING REMOVALS, PENETRATIONS AND HOLES LEFT BEHIND SHALL BE SEALED AND PATCHED. PATCHING SHALL ENCAPSULATE THE ROUGH OPENING/S AND SHALL NOT INCLUDE ANY SANDING OR OTHER ACTIVITIES THAT COULD CREATE ADDITIONAL FIBER RELEASE. FINISH BY PAINTING TO MATCH EXISTING PAINT.

DEMOLITION CODED NOTES

- DISCONNECT AND REMOVE DEVICE ACTIVATED DETECTORS (DAD). REMOVAL SHALL INCLUDE ALL CONDUIT, SURFACE RACEWAY AND JUNCTION BOXES ASSOCIATED WITH THE DEVICES. MARKS SHALL BE COLORED ABOVE CEILING AS ABANDONED IN PLACE. PLACE LABEL THAT INDICATES ABANDONED.
- EXISTING CONDUIT TERMINAL BOARD AND BACK BOARD TO SEAL ALL COMMUNICATION WIRING FROM SOURCE TO ABANDONED IN PLACE. PLACE LABEL THAT INDICATES 'ABANDONED'.

CODED NOTES

- MOUNT PAS RECEIVER HOUSING, PROVIDED BY OTHERS, TO THE WALL. PRIOR TO THE INSTALLATION OF THE HOUSING, WHICH SHALL BE TIGHT AGAINST THE CEILING, A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT RACEWAY COVER INSTALLATION/CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.
- MOUNT ALERT CHIME HOUSING, PROVIDED BY OTHERS, TO WALL. SURFACE RACEWAY SHALL BE INSTALLED AND A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT RACEWAY COVER INSTALLATION/CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.
- MOUNT ALERT CHIME HOUSING, PROVIDED BY OTHERS, TO ASBESTOS-CONTAINING WALL. SURFACE RACEWAY SHALL BE INSTALLED AND A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT RACEWAY COVER INSTALLATION/CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.



OOS
 NYS OFFICE OF GENERAL SERVICES
Spring New York
ANDREW M. CUOMO
 Governor
ROANN M. DESTITO
 Commissioner

CHA
 111 Warren Circle, PO Box 5288 - Albany, NY 12205-0288
 Main: (518) 455-4500 • www.chaonline.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE | SUITE 817
 BALTIMORE | MARYLAND | 21227
 P 410.737.8977 | F 410.536.5016
 www.hughes.com

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER OR AN ENGINEER OF ARCHITECTURE, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.

ELECTRICAL

CLIENT:
 NYS OFFICE OF MENTAL HEALTH

LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210

NO.	DATE	DESCRIPTION
NS2	05/29/14	ADDENDUM
NS1	05/13/14	ADDENDUM
A	03/03/14	FINAL BD DOCUMENTS

PROJECT NUMBER: 44611

DESIGNED BY: SHF

DRAWN BY: DMS

FIELD CHECK: -


APPROVED: MH

BUILDING 11 ASBESTOS REMOVAL PLAN - 1ST FLOOR

DRAWING NUMBER: H-102

SHEET 186 OF 196

FIRE SYSTEM DEMOLITION AND INSTALLATION LEGEND	
	EXISTING STROBE
	CHIME
	EXISTING SMOKE DETECTOR
	EXISTING HEAT DETECTOR
	EXISTING MANUAL PULL STATION

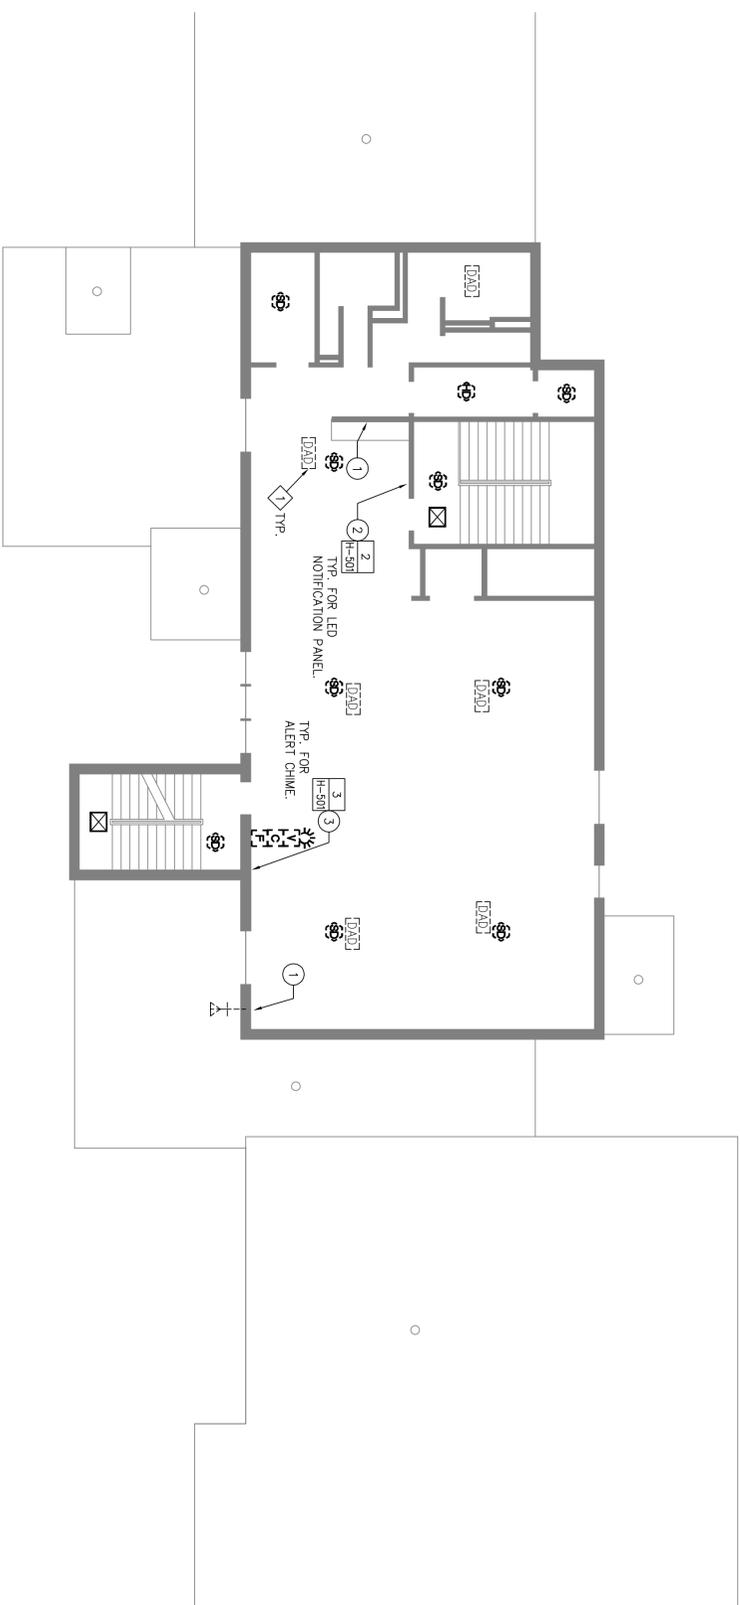

SECOND FLOOR ASBESTOS REMOVAL PLAN
 1/8" = 1'-0"

- GENERAL NOTES**
- ALL WORK SHALL COMPLY WITH APPLICABLE FEDERAL, STATE, AND LOCAL REGULATIONS AND ALL WORK OF THIS CONTRACT SHALL BE COMPLETED BY A LICENSED ASBESTOS ABATEMENT CONTRACTOR USING APPROPRIATELY TRAINED AND CERTIFIED ASBESTOS ABATEMENT WORKERS.
 - REFER TO SPECIFICATION SECTION 003126 FOR ASBESTOS TEST RESULTS. REFER TO SPECIFICATION SECTION 028213 - ASBESTOS ABATEMENT FOR REQUIREMENTS.
 - DUE TO THE MINIMAL OVERALL QUANTITIES OF THE DISTURBANCE TO WALLS, CEILINGS, AND FLOORS PLANNED IN EACH BUILDING, ALL WORK OF THIS PROJECT IS CONSIDERED A MINOR ASBESTOS ABATEMENT PROJECT.
 - ALL FIRE SYSTEM DEMOLITION SYMBOLS SHOWN ON THE H-SERIES DRAWINGS ARE TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. EACH OF THESE FIRE SYSTEM REMOVAL LOCATIONS ALSO REPRESENTS A REPLACEMENT LOCATION WHERE BACKBOX INSTALLATION MUST BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. REFER TO FA & FD SERIES DRAWINGS TO CONFIRM AND COORDINATE LOCATIONS.
 - CODED NOTES SHOWN ON EACH OF THE H-SERIES DRAWINGS CORRELATE TO THE PAS REMOVALS AND INSTALLATIONS AND ARE ALSO ALL TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS.
 - INSTALLATION DETAILS ARE SHOWN ON DRAWINGS H-501, FA-501, FA-502, AND FA-503. ALL INSTALLATIONS SHALL BE SURFACE MOUNT AND MINIMIZE DISTURBANCE TO WALL AND CEILING SURFACES TO THAT OF MOUNTING SCREWS/BOLTS.
 - ALL ABOVE CEILING WORK THAT DOES NOT INVOLVE ACTIVE ABATEMENT SHALL TAKE ALL PRECAUTIONS TO AVOID CONTACT WITH, AND DAMAGE TO, ASBESTOS-CONTAINING JOINT COMPOUND ON THE TOP OF SHEETROCK WALLS.
 - FOLLOWING REMOVALS, PENETRATIONS AND HOLES LEFT BEHIND SHALL BE SEALED AND PATCHED. PATCHING SHALL ENCAPSULATE THE ROUGH OPENING/S AND SHALL NOT INCLUDE ANY SANDING OR OTHER ACTIVITIES THAT COULD CREATE ADDITIONAL FIBER RELEASE. FINISH BY PAINTING TO MATCH EXISTING PAINT.

- DEMOLITION CODED NOTES**
- DISCONNECT AND REMOVE DEVICE ACTIVATED DETECTORS (OAD). REMOVAL SHALL INCLUDE ALL CONDUIT, SURFACE RACEWAY AND JUNCTION BOXES ASSOCIATED WITH THE DEVICES. WIRING SHALL BE COILED ABOVE CEILING AS ABANDONED IN PLACE. PLACE LABEL THAT INDICATES ABANDONED.
- CODED NOTES**
- MOUNT PAS RECEIVER HOUSING, PROVIDED BY OTHERS, TO THE WALL. PRIOR TO THE INSTALLATION OF THE HOUSING, WHICH SHALL BE TIGHT AGAINST THE CEILING, A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.
 - MOUNT ALERT CHIME HOUSING, PROVIDED BY OTHERS, TO WALL. SURFACE RACEWAY SHALL BE INSTALLED AND A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT RACEWAY COVER INSTALLATION/CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.
 - MOUNT ALERT CHIME HOUSING, PROVIDED BY OTHERS, TO ASBESTOS-CONTAINING WALL. SURFACE RACEWAY SHALL BE INSTALLED AND A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT RACEWAY COVER INSTALLATION/CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.



OOS
 NYS OFFICE OF GENERAL SERVICES
Striving New York
ANDREW M. CUOMO
 Governor
ROANN M. DESTITO
 Commissioner

CH2M
 111 Warren Circle, PO Box 5286 Albany, NY 12205-0286
 Main: (518) 453-4500 www.ch2m.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE | SUITE 817
 BALTIMORE, MARYLAND | 21227
 P 410.371.8977 | F 410.536.5016
 www.hallie.com

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER, MAY BE CONSIDERED A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.


ELECTRICAL

TITLE: PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT
LOCATION: HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210
CLIENT: NYS OFFICE OF MENTAL HEALTH

NO.	DATE	DESCRIPTION
NO.1	05/13/14	ADDENDUM
NO.2	05/29/14	ADDENDUM
MARK	03/03/14	FINAL BID DOCUMENTS
PROJECT NUMBER	44611	
DESIGNED BY:	SHF	
DRAWN BY:	DMS	
FIELD CHECK:	-	
APPROVED:	MH	

SHEET TITLE: BUILDING 11 ASBESTOS REMOVAL PLAN - 2ND FLOOR
DRAWING NUMBER: H-103
 SHEET 187 of 196

FIRE SYSTEM DEMOLITION AND INSTALLATION LEGEND	
	EXISTING STROBE
	EXISTING BELL/STROBE
	CHIME
	EXISTING SMOKE DETECTOR
	EXISTING HEAT DETECTOR
	EXISTING MANUAL PULL STATION
	EXISTING REMOTE ANNUNCIATOR

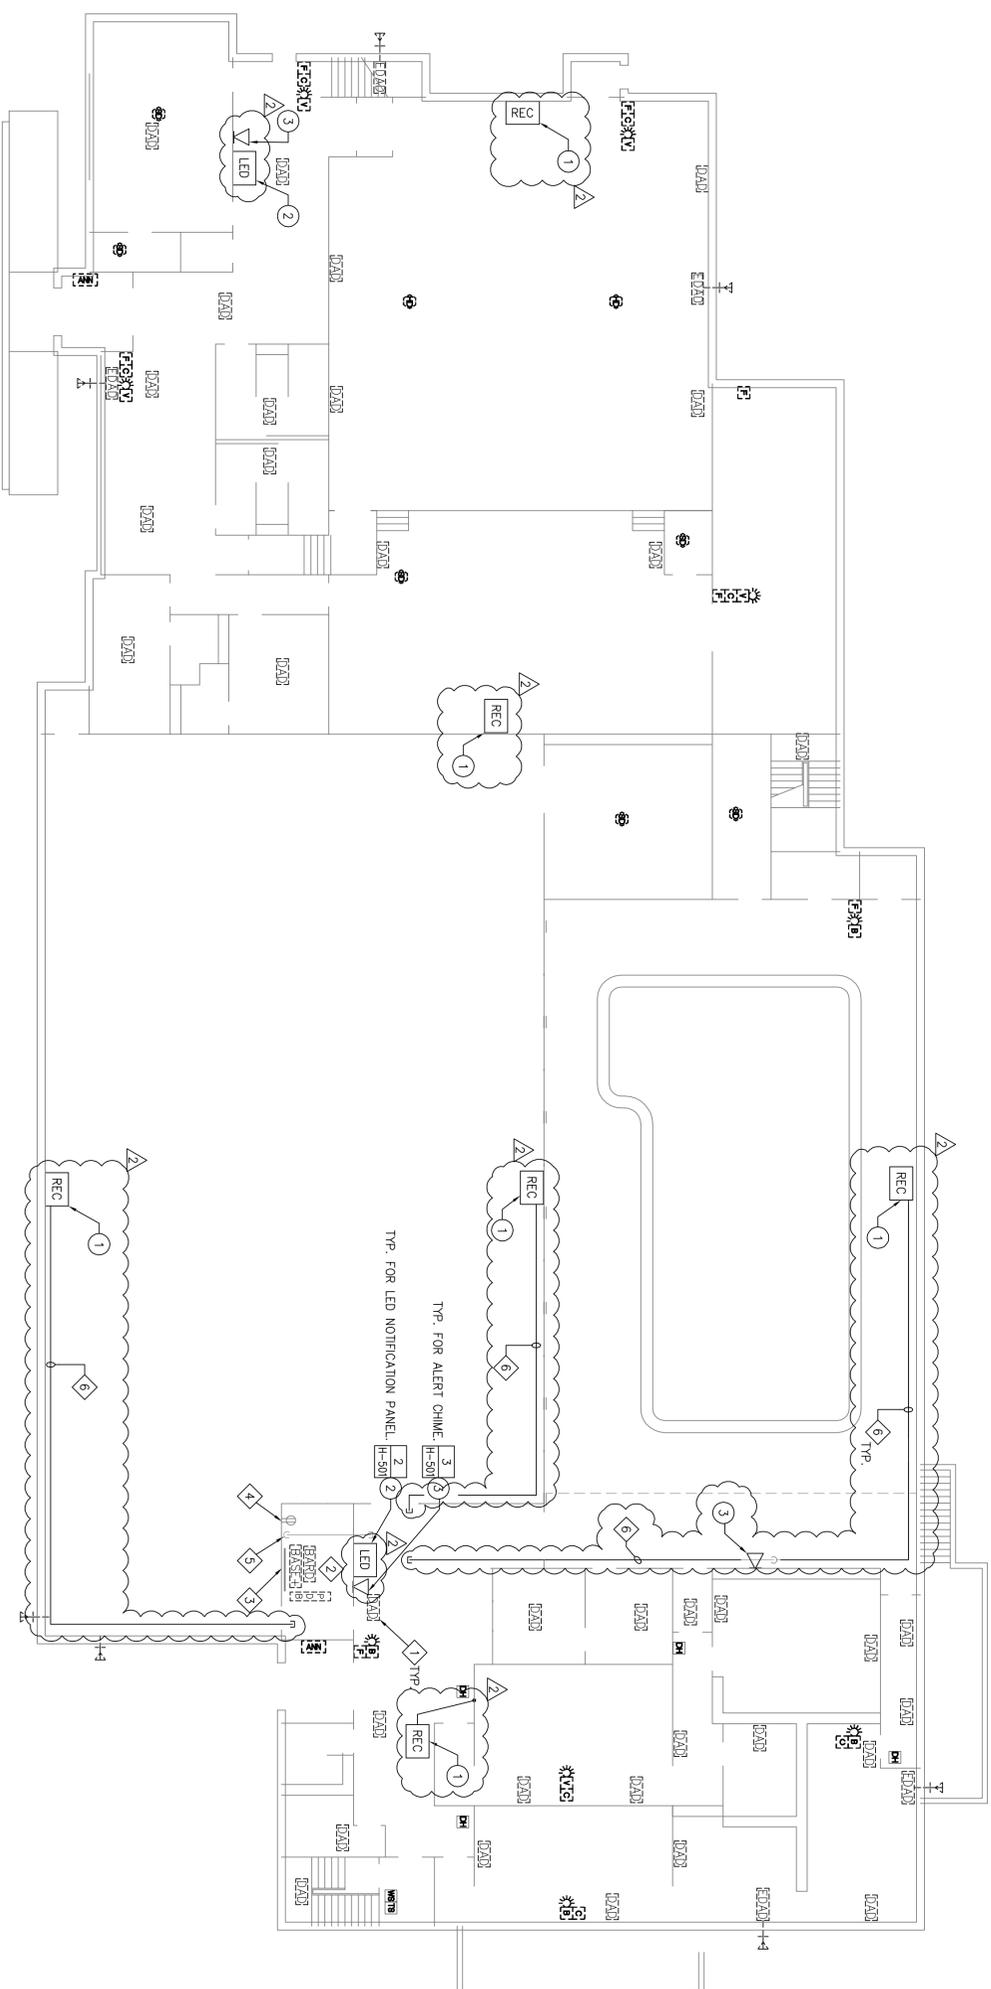

FIRST FLOOR ASBESTOS REMOVAL PLAN
 3/32" = 1'-0"

- GENERAL NOTES**
- ALL WORK SHALL COMPLY WITH APPLICABLE FEDERAL, STATE, AND LOCAL REGULATIONS AND ALL WORK OF THIS CONTRACT SHALL BE COMPLETED BY A LICENSED ASBESTOS ABATEMENT CONTRACTOR USING APPROPRIATELY TRAINED AND CERTIFIED ASBESTOS ABATEMENT WORKERS.
 - REFER TO SPECIFICATION SECTION 003126 FOR ASBESTOS TEST RESULTS. REFER TO SPECIFICATION SECTION 028213 - ASBESTOS ABATEMENT FOR REQUIREMENTS.
 - DUE TO THE MINIMAL OVERALL QUANTITIES OF THE DISTURBANCE TO WALLS, CEILINGS, AND FLOORS PLANNED IN EACH BUILDING, ALL WORK OF THIS PROJECT IS CONSIDERED A MINOR ASBESTOS ABATEMENT PROJECT.
 - ALL FIRE SYSTEM DEMOLITION SYMBOLS SHOWN ON THE H-SERIES DRAWINGS ARE TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. EACH OF THESE FIRE SYSTEM REMOVAL LOCATIONS ALSO REPRESENTS A REPLACEMENT LOCATION WHERE BACKBOX INSTALLATION MUST BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. REFER TO FA & FD SERIES DRAWINGS TO CONFIRM AND COORDINATE LOCATIONS.
 - CODED NOTES SHOWN ON EACH OF THE H-SERIES DRAWINGS CORRELATE TO THE PAS REMOVALS AND INSTALLATIONS AND ARE ALSO ALL TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS.
 - INSTALLATION DETAILS ARE SHOWN ON DRAWINGS H-501, FA-501, FA-502, AND FA-503. ALL INSTALLATIONS SHALL BE SURFACE MOUNT AND MINIMIZE DISTURBANCE TO WALL AND CEILING SURFACES TO THAT OF MOUNTING SCREWS/BOLTS.
 - ALL ABOVE CEILING WORK THAT DOES NOT INVOLVE ACTIVE ABATEMENT SHALL TAKE ALL PRECAUTIONS TO AVOID CONTACT WITH, AND DAMAGE TO, ASBESTOS-CONTAINING JOINT COMPOUND ON THE TOP OF SHEETROCK WALLS.
 - FOLLOWING REMOVALS, PENETRATIONS AND HOLES LEFT BEHIND SHALL BE SEALED AND PATCHED. PATCHING SHALL ENCAPSULATE THE ROUGH OPENING/S AND SHALL NOT INCLUDE ANY SANDING OR OTHER ACTIVITIES THAT COULD CREATE ADDITIONAL FIBER RELEASE. FINISH BY PAINTING TO MATCH EXISTING PAINT.

DEMOLITION CODED NOTES

- DISCONNECT AND REMOVE DEVICE ACTIVATED DETECTORS (DAD) AND EXTERNAL DEVICE ACTIVATED DETECTORS (DAES). REMOVAL SHALL INCLUDE ALL CONDUIT, SURFACE RACEWAY AND JUNCTION BOXES ASSOCIATED WITH THE DEVICES. WIRING SHALL BE COILED ABOVE CEILING AS ABANDONED IN PLACE. PLACE LABEL THAT INDICATES ABANDONED.
- DISCONNECT AND REMOVE ALL BARD, RBASE, AND BASE. REMOVAL SHALL INCLUDE ALL TERMINAL BOARDS, AND TERMINATIONS. WIRING SHALL BE COILED ABOVE CEILING AS ABANDONED IN PLACE. PLACE LABEL THAT INDICATES ABANDONED.
- REMOVE BACKBOARD, MAINTAIN BACKBOARD DURING REMOVAL OF EXISTING PERSONAL ASSISTANCE SYSTEM.
- EXISTING DUPLEX RECEPTACLES TO REMAIN.
- EXISTING 3" RIGID STEEL CONDUIT SHALL REMAIN.
- EXISTING 3/4" CONDUIT TO REMAIN. RE-USE FOR INSTALLATION OF WIRING FOR RECEIVERS.

CODED NOTES

- MOUNT PAS RECEIVER HOUSING, PROVIDED BY OTHERS, TO THE WALL. PRIOR TO THE INSTALLATION OF THE HOUSING, WHICH SHALL BE TIGHT AGAINST THE CEILING, A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.
- MOUNT LED NOTIFICATION PANEL, HOUSING, PROVIDED BY OTHERS, TO WALL. SURFACE RACEWAY SHALL BE INSTALLED AND A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT RACEWAY COVER INSTALLATION/CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.
- MOUNT ALERT CHIME HOUSING, PROVIDED BY OTHERS, TO ASBESTOS-CONTAINING WALL. SURFACE RACEWAY SHALL BE INSTALLED AND A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT RACEWAY COVER INSTALLATION/CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.



OOS
 NEW YORK STATE OFFICE OF GENERAL SERVICES
 Spring New York

ANDREW M. CUOMO
 Governor
ROBERT M. DESSITO
 Commissioner

CHA
 111 Warren Circle, P.O. Box 5208 - Albany, NY 12205-0208
 Main: (518) 455-4500 www.cha.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE | SUITE 817
 BALTIMORE, MARYLAND | 21227
 P 410.737.8977 | F 410.536.5016
 www.hughes.com

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER OR AN ARCHITECT OR AN INDICATED PROFESSIONAL ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.

ELECTRICAL

CLIENT:
 NYS OFFICE OF MENTAL HEALTH

LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210

NO.	DATE	DESCRIPTION
NS2	05/29/14	ADDENDUM
NS1	05/13/14	ADDENDUM
A	03/03/14	FINAL BID DOCUMENTS
MARK	DATE	DESCRIPTION
PROJECT NUMBER	44611	
DESIGNED BY:	SJF	
DRAWN BY:	DMS	
FIELD CHECK:	-	
APPROVED:	MH	

SHEET TITLE:
 BUILDING 12 ASBESTOS REMOVAL PLAN - 1ST FLOOR

DRAWING NUMBER:
 H-104

SHEET 188 **OF** 196



SECOND FLOOR ASBESTOS REMOVAL PLAN
 3/32" = 1'-0"

- GENERAL NOTES**
- A. ALL WORK SHALL COMPLY WITH APPLICABLE FEDERAL, STATE, AND LOCAL REGULATIONS AND ALL WORK OF THIS CONTRACT SHALL BE COMPLETED BY A LICENSED ASBESTOS ABATEMENT CONTRACTOR USING APPROPRIATELY TRAINED AND CERTIFIED ASBESTOS ABATEMENT WORKERS.
 - B. REFER TO SPECIFICATION SECTION 003126 FOR ASBESTOS TEST RESULTS. REFER TO SPECIFICATION SECTION 028213 - ASBESTOS ABATEMENT FOR REQUIREMENTS.
 - C. DUE TO THE MINIMAL OVERALL QUANTITIES OF THE DISTURBANCE TO WALLS, CEILINGS, AND FLOORS PLANNED IN EACH BUILDING, ALL WORK OF THIS PROJECT IS CONSIDERED A MINOR ASBESTOS ABATEMENT PROJECT.
 - D. ALL FIRE SYSTEM DEMOLITION SYMBOLS SHOWN ON THE H-SERIES DRAWINGS ARE TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. EACH OF THESE FIRE SYSTEM REMOVAL LOCATIONS ALSO REPRESENTS A REPLACEMENT LOCATION WHERE BACKBOX INSTALLATION MUST BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. REFER TO FA & FD SERIES DRAWINGS TO CONFIRM AND COORDINATE LOCATIONS.
 - E. CODED NOTES SHOWN ON EACH OF THE H-SERIES DRAWINGS CORRELATE TO THE PAS REMOVALS AND INSTALLATIONS AND ARE ALSO ALL TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS.
 - F. INSTALLATION DETAILS ARE SHOWN ON DRAWINGS H-501, FA-501, FA-502, AND FA-503. ALL INSTALLATIONS SHALL BE SURFACE MOUNT AND MINIMIZE DISTURBANCE TO WALL AND CEILING SURFACES TO THAT OF MOUNTING SCREWS/BOLTS.
 - G. ALL ABOVE CEILING WORK THAT DOES NOT INVOLVE ACTIVE ABATEMENT SHALL TAKE ALL PRECAUTIONS TO AVOID CONTACT WITH, AND DAMAGE TO, ASBESTOS-CONTAINING JOINT COMPOUND ON THE TOP OF SHEETROCK WALLS.
 - H. FOLLOWING REMOVALS, PENETRATIONS AND HOLES LEFT BEHIND SHALL BE SEALED AND PATCHED. PATCHING SHALL ENCAPSULATE THE ROUGH OPENING/S AND SHALL NOT INCLUDE ANY SANDING OR OTHER ACTIVITIES THAT COULD CREATE ADDITIONAL FIBER RELEASE. FINISH BY PAINTING TO MATCH EXISTING PAINT.

FIRE SYSTEM DEMOLITION AND INSTALLATION LEGEND

	EXISTING BELL/STROBE
	EXISTING SMOKE DETECTOR
	EXISTING DUCT DETECTOR




OOS
 NYS'S OFFICE OF GENERAL SERVICES
Spring New York
ANDREW M. CUOMO
 Governor
ROSA M. DESIATTO
 Commissioner

CHA
 111 Warren Drive, PO Box 5286 - Albany, NY 12205-0286
 Main: (518) 455-4500 www.chaconline.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE | SUITE 817
 BALTIMORE, MARYLAND 21227
 P 410.731.8977 | F 410.536.5016
 www.hughes.com

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER, MAY BE SUBJECT TO PENALTY UNDER THE PROFESSIONAL ENGINEER OR ARCHITECT ACT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.




ELECTRICAL
 TITLE: PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT
 CONTRACTOR:
 LOCATION: HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210
 CLIENT: NYS OFFICE OF MENTAL HEALTH

NO.	DATE	DESCRIPTION
NO.2	05/29/14	ADDENDUM
NO.1	05/13/14	ADDENDUM
A	03/03/14	FINAL BD DOCUMENTS

PROJECT NUMBER: 44611
 DESIGNED BY: SHF
 DRAWN BY: DMS
 FIELD CHECK: -
 APPROVED: MH

BUILDING 12 ASBESTOS REMOVAL PLAN - 2ND FLOOR
 DRAWING NUMBER: H-105
 SHEET 189 OF 196

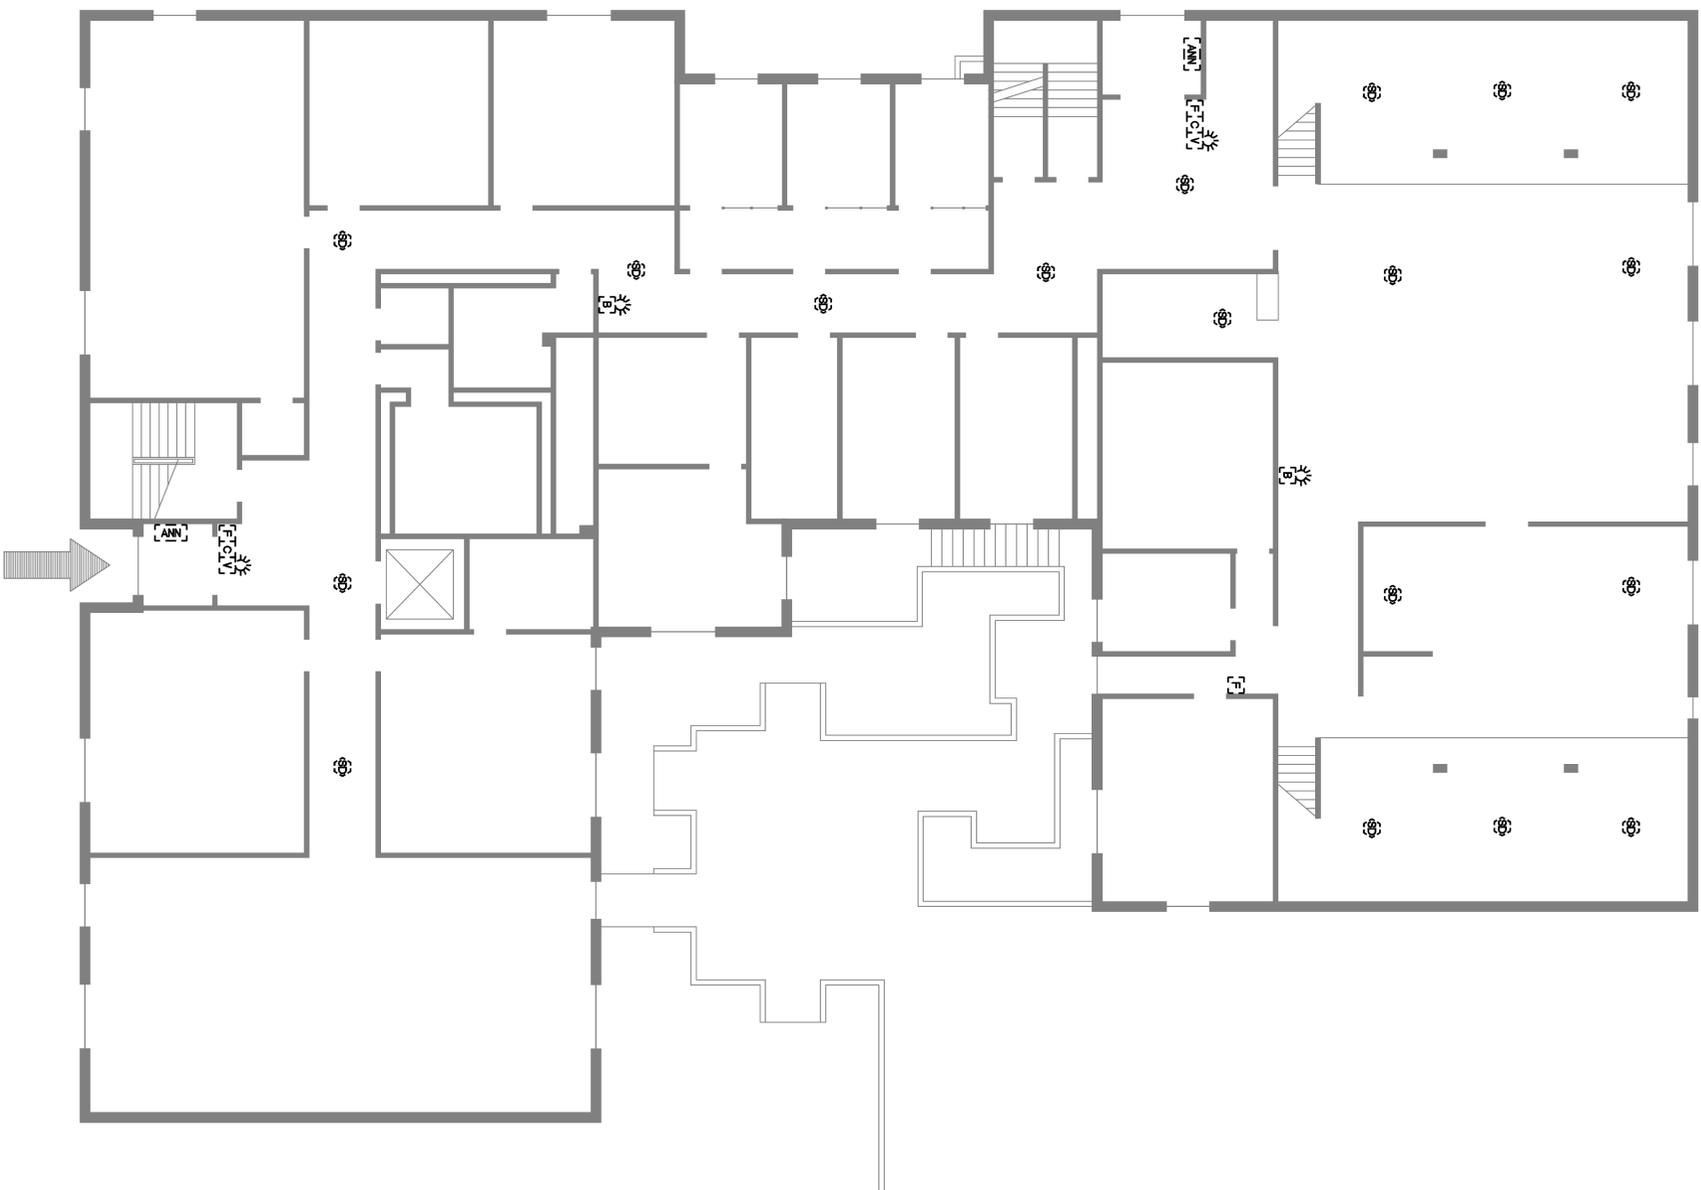


FIRST FLOOR ASBESTOS REMOVAL PLAN
 1/8" = 1'-0"

GENERAL NOTES

- 1 ALL WORK SHALL COMPLY WITH APPLICABLE FEDERAL, STATE, AND LOCAL REGULATIONS AND ALL WORK OF THIS CONTRACT SHALL BE COMPLETED BY A LICENSED ASBESTOS ABATEMENT CONTRACTOR USING APPROPRIATELY TRAINED AND CERTIFIED ASBESTOS ABATEMENT WORKERS.
- 2 REFER TO SPECIFICATION SECTION 003126 FOR ASBESTOS TEST RESULTS. REFER TO SPECIFICATION SECTION 028213 - ASBESTOS ABATEMENT FOR REQUIREMENTS.
- 3 DUE TO THE MINIMAL OVERALL QUANTITIES OF THE DISTURBANCE TO WALLS, CEILINGS, AND FLOORS PLANNED IN EACH BUILDING, ALL WORK OF THIS PROJECT IS CONSIDERED A MINOR ASBESTOS ABATEMENT PROJECT.
- 4 ALL FIRE SYSTEM DEMOLITION SYMBOLS SHOWN ON THE H-SERIES DRAWINGS ARE TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. EACH OF THESE FIRE SYSTEM REMOVAL LOCATIONS ALSO REPRESENTS A REPLACEMENT LOCATION WHERE BACKBOX INSTALLATION MUST BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. REFER TO FA & FD SERIES DRAWINGS TO CONFIRM AND COORDINATE LOCATIONS. CODED NOTES SHOWN ON EACH OF THE H-SERIES DRAWINGS CORRELATE TO THE PAS REMOVALS AND INSTALLATIONS AND ARE ALSO ALL TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS.
- 5 INSTALLATION DETAILS ARE SHOWN ON DRAWINGS H-501, FA-501, FA-502, AND FA-503. ALL INSTALLATIONS SHALL BE SURFACE MOUNT AND MINIMIZE DISTURBANCE TO WALL AND CEILING SURFACES TO THAT OF MOUNTING SCREWS/BOLTS.
- 6 ALL ABOVE CEILING WORK THAT DOES NOT INVOLVE ACTIVE ABATEMENT SHALL TAKE ALL PRECAUTIONS TO AVOID CONTACT WITH, AND DAMAGE TO, ASBESTOS-CONTAINING JOINT COMPOUND ON THE TOP OF SHEETROCK WALLS.
- 7 FOLLOWING REMOVALS, PENETRATIONS AND HOLES LEFT BEHIND SHALL BE SEALED AND PATCHED. PATCHING SHALL ENCAPSULATE THE ROUGH OPENING/S AND SHALL NOT INCLUDE ANY SANDING OR OTHER ACTIVITIES THAT COULD CREATE ADDITIONAL FIBER RELEASE. FINISH BY PAINTING TO MATCH EXISTING PAINT.
- 8

FIRE SYSTEM DEMOLITION AND INSTALLATION LEGEND

	EXISTING STROBE
	EXISTING BELL/STROBE
	CHIME
	EXISTING SMOKE DETECTOR
	EXISTING MANUAL PULL STATION
	EXISTING REMOTE ANNUNCIATOR



OOS
 NYS OFFICE OF GENERAL SERVICES
Serving New York
ANDREW M. CUOMO
 Governor
ROANN M. DESTITO
 Commissioner

CHM
 111 Warren Circle, PO Box 5286 Albany, NY 12205-0286
 Main: (518) 455-4500 www.chmny.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE | SUITE 817
 BALTIMORE, MARYLAND 21227
 P 410.731.8977 | F 410.536.5016
 www.hallie.com

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER, MAY BE CONSIDERED A VIOLATION OF THE PROFESSIONAL ENGINEER'S ETHICS AND A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.

ELECTRICAL
 TITLE:
 PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT
 CONTRACTOR:
 HUGHES ASSOCIATES
 LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210
 CLIENT:
 NYS OFFICE OF MENTAL HEALTH

PROJECT NUMBER	44611
DESIGNED BY:	SHF
DRAWN BY:	DMS
FIELD CHECK:	-
APPROVED:	MH
SHEET TITLE:	BUILDING 14 ASBESTOS REMOVAL PLAN - 1ST FLOOR

DRAWING NUMBER:
H-106
 SHEET 190 of 196



Spring New York
ANDREW M. CUOMO
 Governor
ROBERT M. DESSITO
 Commissioner



WARNING:
 THE ATTENTION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER, SHALL BE CONSIDERED AS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.



ELECTRICAL

CONTRACT:
 PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT

LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210

CLIENT:
 NYS OFFICE OF MENTAL HEALTH

NO.	DATE	DESCRIPTION
NO.2	05/29/14	ADDENDUM
NO.1	05/13/14	ADDENDUM
A	03/03/14	FINAL BID DOCUMENTS

PROJECT NUMBER: 44611
DESIGNED BY: SHF
DRAWN BY: DMS
FIELD CHECK: -
APPROVED: MH

BUILDING 14 ASBESTOS REMOVAL PLAN - 3RD FLOOR


DRAWING NUMBER: H-107
SHEET: 191 of 196

GENERAL NOTES


- ALL WORK SHALL COMPLY WITH APPLICABLE FEDERAL, STATE, AND LOCAL REGULATIONS AND ALL WORK OF THIS CONTRACT SHALL BE COMPLETED BY A LICENSED ASBESTOS ABATEMENT CONTRACTOR USING APPROPRIATELY TRAINED AND CERTIFIED ASBESTOS ABATEMENT WORKERS.
- REFER TO SPECIFICATION SECTION 003126 FOR ASBESTOS TEST RESULTS. REFER TO SPECIFICATION SECTION 028213 - ASBESTOS ABATEMENT FOR REQUIREMENTS.
- DUE TO THE MINIMAL OVERALL QUANTITIES OF THE DISTURBANCE TO WALLS, CEILINGS, AND FLOORS PLANNED IN EACH BUILDING, ALL WORK OF THIS PROJECT IS CONSIDERED A MINOR ASBESTOS ABATEMENT PROJECT.
- ALL FIRE SYSTEM DEMOLITION SYMBOLS SHOWN ON THE H-SERIES DRAWINGS ARE TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. EACH OF THESE FIRE SYSTEM REMOVAL LOCATIONS ALSO REPRESENTS A REPLACEMENT LOCATION WHERE BACKBOX INSTALLATION MUST BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. REFER TO FA & FD SERIES DRAWINGS TO CONFIRM AND COORDINATE LOCATIONS.
- CODED NOTES SHOWN ON EACH OF THE H-SERIES DRAWINGS CORRELATE TO THE PAS REMOVALS AND INSTALLATIONS AND ARE ALSO ALL TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS.
- INSTALLATION DETAILS ARE SHOWN ON DRAWINGS H-501, FA-501, FA-502, AND FA-503. ALL INSTALLATIONS SHALL BE SURFACE MOUNT AND MINIMIZE DISTURBANCE TO WALL AND CEILING SURFACES TO THAT OF MOUNTING SCREWS/BOLTS.
- ALL ABOVE CEILING WORK THAT DOES NOT INVOLVE ACTIVE ABATEMENT SHALL TAKE ALL PRECAUTIONS TO AVOID CONTACT WITH, AND DAMAGE TO, ASBESTOS-CONTAINING JOINT COMPOUND ON THE TOP OF SHEETROCK WALLS.
- FOLLOWING REMOVALS, PENETRATIONS AND HOLES LEFT BEHIND SHALL BE SEALED AND PATCHED. PATCHING SHALL ENCAPSULATE THE ROUGH OPENING/S AND SHALL NOT INCLUDE ANY SANDING OR OTHER ACTIVITIES THAT COULD CREATE ADDITIONAL FIBER RELEASE. FINISH BY PAINTING TO MATCH EXISTING PAINT.

FIRE SYSTEM DEMOLITION AND INSTALLATION LEGEND

	EXISTING STROBE
	CHIME
	EXISTING SMOKE DETECTOR
	EXISTING MANUAL PULL STATION

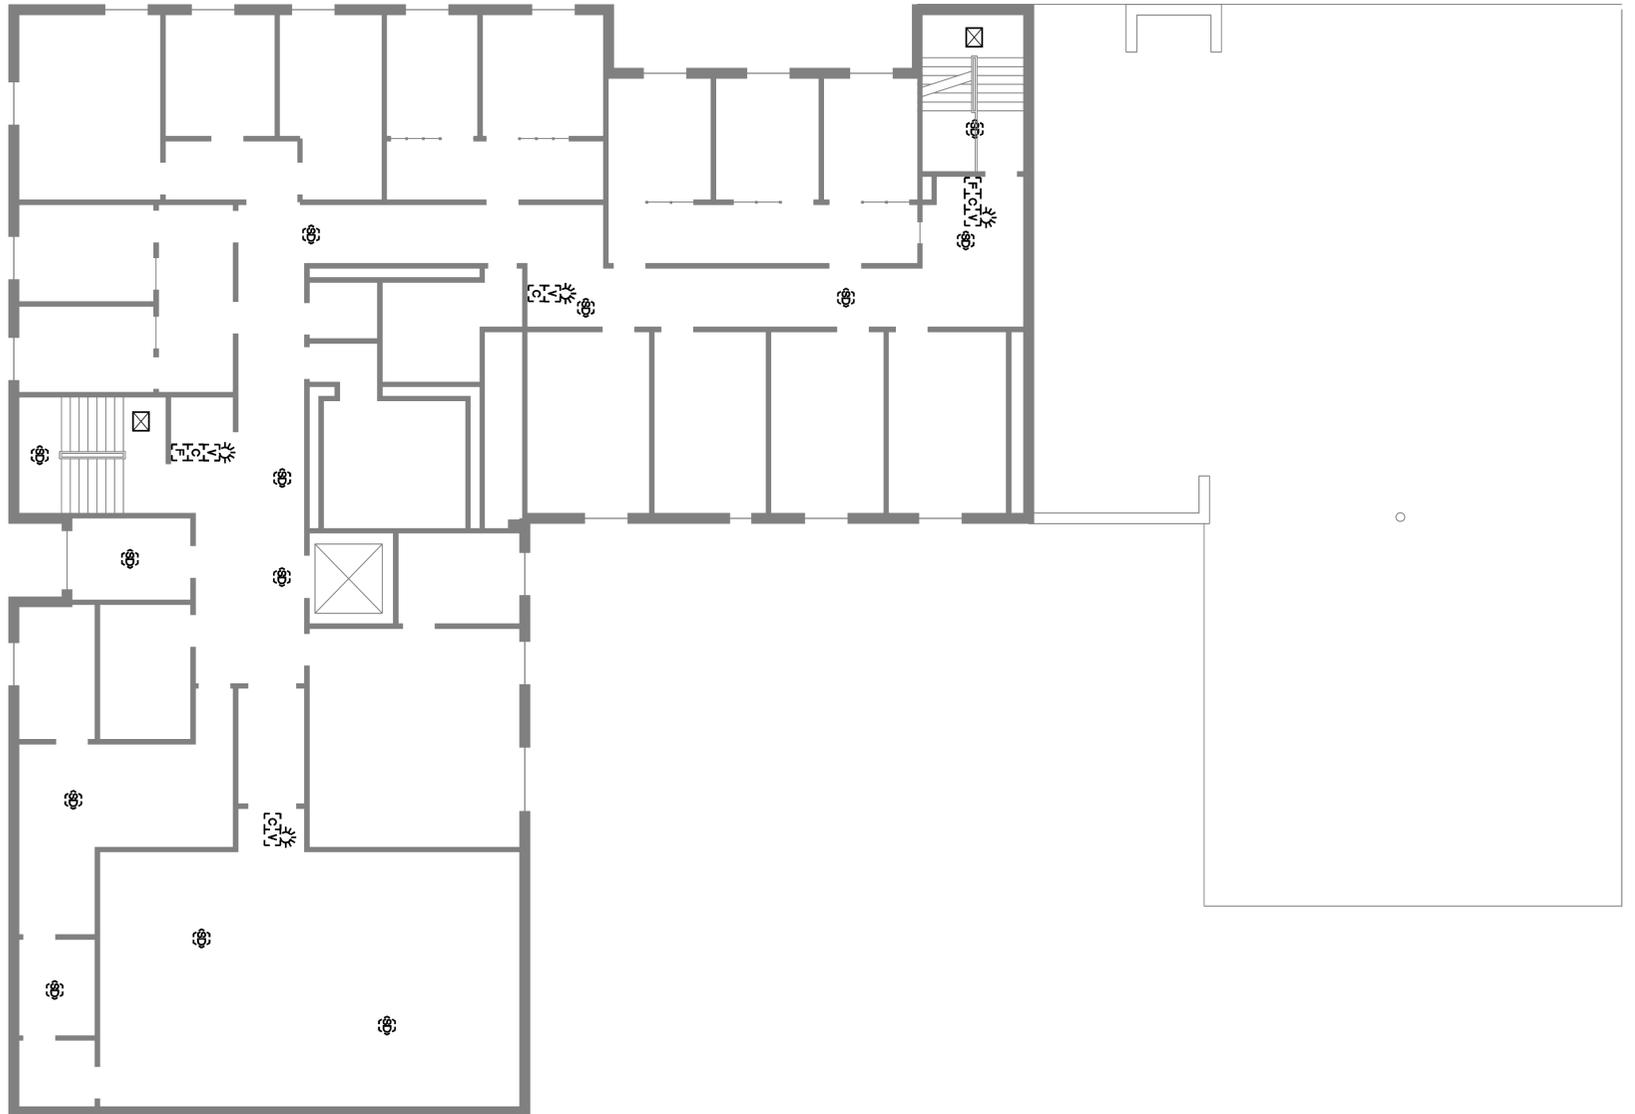

THIRD FLOOR ASBESTOS REMOVAL PLAN
 1/8" = 1'-0"



	EXISTING STROBE
	CHIME
	EXISTING SMOKE DETECTOR
	EXISTING HEAT DETECTOR
	EXISTING MANUAL PULL STATION
	EXISTING DOOR HOLDER - WALL MOUNT MAGNETIC
	EXISTING REMOTE ANNUNCIATOR

- GENERAL NOTES**
- ALL WORK SHALL COMPLY WITH APPLICABLE FEDERAL, STATE AND LOCAL REGULATIONS AND ALL WORK OF THIS CONTRACT SHALL BE COMPLETED BY A LICENSED ASBESTOS ABATEMENT CONTRACTOR USING APPROPRIATELY TRAINED AND CERTIFIED ASBESTOS ABATEMENT WORKERS.
 - REFER TO SPECIFICATION SECTION 003126 FOR ASBESTOS TEST RESULTS. REFER TO SPECIFICATION SECTION 028213 - ASBESTOS ABATEMENT FOR REQUIREMENTS.
 - DUE TO THE MINIMAL OVERALL QUANTITIES OF THE DISTURBANCE TO WALLS, CEILINGS, AND FLOORS PLANNED IN EACH BUILDING, ALL WORK OF THIS PROJECT IS CONSIDERED A MINOR ASBESTOS ABATEMENT PROJECT.
 - ALL FIRE SYSTEM DEMOLITION SYMBOLS SHOWN ON THE H-SERIES DRAWINGS ARE TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. EACH OF THESE FIRE SYSTEM REMOVAL LOCATIONS ALSO REPRESENTS A REPLACEMENT LOCATION WHERE BACKBOX INSTALLATION MUST BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. REFER TO FA & FD SERIES DRAWINGS TO CONFIRM AND COORDINATE LOCATIONS.
 - CODED NOTES SHOWN ON EACH OF THE H-SERIES DRAWINGS CORRELATE TO THE PAS REMOVALS AND INSTALLATIONS AND ARE ALSO ALL TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS.
 - INSTALLATION DETAILS ARE SHOWN ON DRAWINGS H-501, FA-501, FA-502, AND FA-503. ALL INSTALLATIONS SHALL BE SURFACE MOUNT AND MINIMIZE DISTURBANCE TO WALL AND CEILING SURFACES TO THAT OF MOUNTING SCREWS/BOLTS.
 - ALL ABOVE CEILING WORK THAT DOES NOT INVOLVE ACTIVE ABATEMENT SHALL TAKE ALL PRECAUTIONS TO AVOID CONTACT WITH, AND DAMAGE TO, ASBESTOS-CONTAINING JOINT COMPOUND ON THE TOP OF SHEETROCK WALLS.
 - FOLLOWING REMOVALS, PENETRATIONS AND HOLES LEFT BEHIND SHALL BE SEALED AND PATCHED. PATCHING SHALL ENCAPSULATE THE ROUGH OPENING/S AND SHALL NOT INCLUDE ANY SANDING OR OTHER ACTIVITIES THAT COULD CREATE ADDITIONAL FIBER RELEASE. FINISH BY PAINTING TO MATCH EXISTING PAINT.

- DEMOLITION CODED NOTES**
- DISCONNECT AND REMOVE DEVICE ACTIVATED DETECTORS (DAO) AND EXTERNAL DEVICE ACTIVATED DETECTORS (EDAD). REMOVAL SHALL INCLUDE ALL CONDUIT, SURFACE RACEWAY AND JUNCTION BOXES ASSOCIATED WITH THE DEVICES. WIRING SHALL BE COILED ABOVE CEILING AS ABANDONED IN PLACE. PLACE LABEL THAT INDICATES 'ABANDONED'.
 - EXISTING CONDUIT, TERMINAL BOARD AND BACK BOARD TO REMAIN. WIRING SHALL BE COILED ABOVE CEILING AS ABANDONED IN PLACE. PLACE LABEL THAT INDICATES 'ABANDONED'.
 - DISCONNECT AND REMOVE CABINET AND P.C. REMOVE ALL WIRING TO P.C. BACK TO SOURCE.
 - DISCONNECT AND REMOVE P.A. TESTER. REMOVAL SHALL INCLUDE ALL CONDUIT, SURFACE RACEWAY AND JUNCTION BOXES ASSOCIATED WITH THE DEVICE. WIRING SHALL BE COILED ABOVE CEILING AS ABANDONED IN PLACE. PLACE LABEL THAT INDICATES 'ABANDONED'.

- CODED NOTES**
- MOUNT PAS RECEIVER HOUSING, PROVIDED BY OTHERS, TO THE WALL. PRIOR TO THE INSTALLATION OF THE HOUSING, WHICH SHALL BE TIGHT AGAINST THE CEILING, A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL. PRIOR TO SECURING THE HOUSING THE KNOCK OUT TAB ON THE TOP OF THE HOUSING IS TO BE REMOVED TO ALLOW FOR CABLE INSTALLATION BY OTHERS.
 - MOUNT LED NOTIFICATION PANEL HOUSING, PROVIDED BY OTHERS, TO WALL. SURFACE RACEWAY SHALL BE INSTALLED AND A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT RACEWAY COVER INSTALLATION/CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.
 - MOUNT ALERT CHIME HOUSING, PROVIDED BY OTHERS, TO ASBESTOS-CONTAINING WALL. SURFACE RACEWAY SHALL BE INSTALLED AND A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT RACEWAY COVER INSTALLATION/CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.

FIRST FLOOR ASBESTOS REMOVAL PLAN
 1/8" = 1'-0"



OOS
 NYS OFFICE OF GENERAL SERVICES
Setting New York
ANDREW M. CUOMO
 Governor
ROANN M. DESITTO
 Commissioner

CHA
 111 Warren Circle, PO Box 5286 Albany, NY 12205-0286
 Main: (518) 455-4500 www.chaonline.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE | SUITE 817
 BALTIMORE, MARYLAND 21227
 P 410.371.8977 | F 410.536.5016
 www.hallie.com

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER, MAY BE CONSIDERED A VIOLATION OF THE PROFESSIONAL ENGINEER'S ETHICS AND OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.

ELECTRICAL

PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT

CLIENT:
 NYS OFFICE OF MENTAL HEALTH

LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210

DRAWING NUMBER:
H-108

SHEET NUMBER:
 SHEET 192 OF 196


PROJECT NUMBER:
 44611

NO.	DATE	DESCRIPTION
NS2	08/29/14	ADDENDUM
NS1	05/13/14	ADDENDUM
A	03/03/14	FINAL BID DOCUMENTS

DESIGNED BY: SHF
DRAWN BY: DMS
FIELD CHECK: -
APPROVED: MH

SHEET TITLE:
BUILDING 15 ASBESTOS REMOVAL PLAN - 1ST FLOOR

	EXISTING BELL
	EXISTING BELL/STROBE
	CHIME
	EXISTING SMOKE DETECTOR
	EXISTING MANUAL PULL STATION

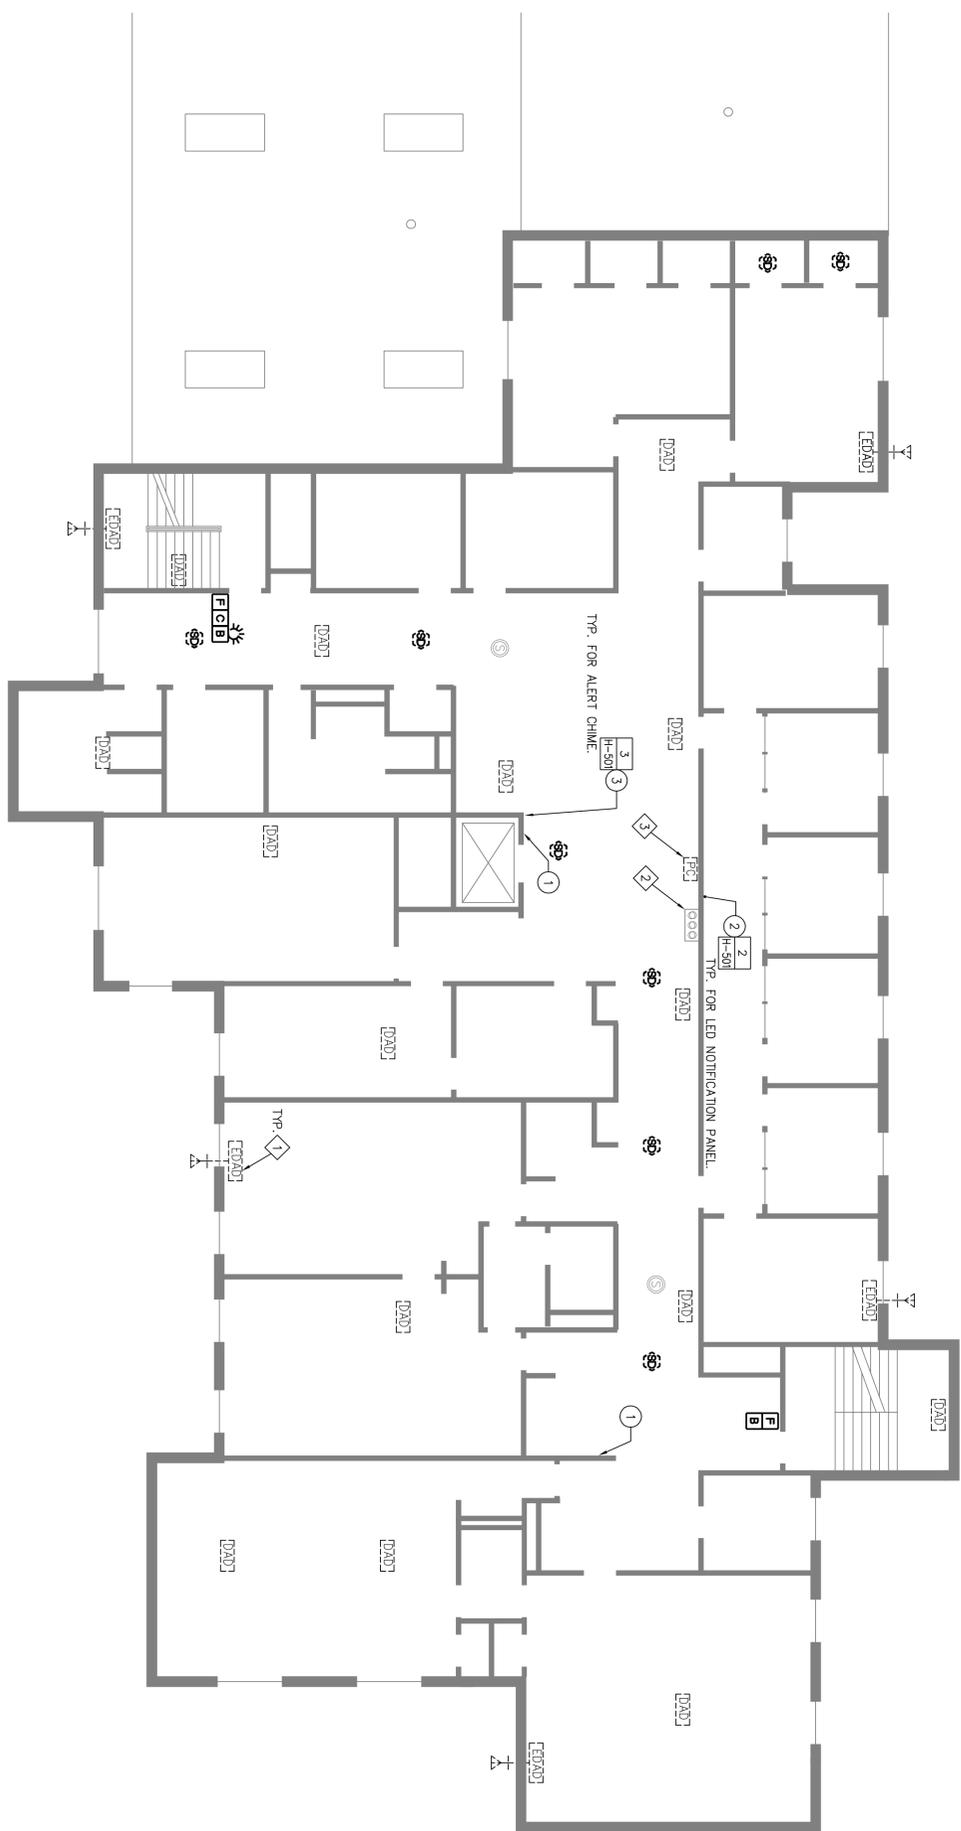

SECOND FLOOR ASBESTOS REMOVAL PLAN
 1/8" = 1'-0"



- GENERAL NOTES**
- ALL WORK SHALL COMPLY WITH APPLICABLE FEDERAL, STATE, AND LOCAL REGULATIONS AND ALL WORK OF THIS CONTRACT SHALL BE COMPLETED BY A LICENSED ASBESTOS ABATEMENT CONTRACTOR USING APPROPRIATELY TRAINED AND CERTIFIED ASBESTOS ABATEMENT WORKERS.
 - REFER TO SPECIFICATION SECTION 003126 FOR ASBESTOS TEST RESULTS. REFER TO SPECIFICATION SECTION 028213 - ASBESTOS ABATEMENT FOR REQUIREMENTS.
 - DU TO THE MINIMAL OVERALL QUANTITIES OF THE DISTURBANCE TO WALLS, CEILINGS, AND FLOORS PLANNED IN EACH BUILDING, ALL WORK OF THIS PROJECT IS CONSIDERED A MINOR ASBESTOS ABATEMENT PROJECT.
 - ALL FIRE SYSTEM DEMOLITION SYMBOLS SHOWN ON THE H-SERIES DRAWINGS ARE TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. EACH OF THESE FIRE SYSTEM REMOVAL LOCATIONS ALSO REPRESENTS A REPLACEMENT LOCATION WHERE BACKBOX INSTALLATION MUST BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. REFER TO FA & FD SERIES DRAWINGS TO CONFIRM AND COORDINATE LOCATIONS.
 - CODED NOTES SHOWN ON EACH OF THE H-SERIES DRAWINGS CORRELATE TO THE PAS REMOVALS AND INSTALLATIONS AND ARE ALSO ALL TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS.
 - INSTALLATION DETAILS ARE SHOWN ON DRAWINGS H-501, FA-501, FA-502, AND FA-503. ALL INSTALLATIONS SHALL BE SURFACE MOUNT AND MINIMIZE DISTURBANCE TO WALL AND CEILING SURFACES TO THAT OF MOUNTING SCREWS/BOLTS.
 - ALL ABOVE CEILING WORK THAT DOES NOT INVOLVE ACTIVE ABATEMENT SHALL TAKE ALL PRECAUTIONS TO AVOID CONTACT WITH, AND DAMAGE TO, ASBESTOS-CONTAINING JOINT COMPOUND ON THE TOP OF SHEETROCK WALLS.
 - FOLLOWING REMOVALS, PENETRATIONS AND HOLES LEFT BEHIND SHALL BE SEALED AND PATCHED. PATCHING SHALL ENCAPSULATE THE ROUGH OPENING/S AND SHALL NOT INCLUDE ANY SANDING OR OTHER ACTIVITIES THAT COULD CREATE ADDITIONAL FIBER RELEASE. FINISH BY PAINTING TO MATCH EXISTING PAINT.

DEMOLITION CODED NOTES

- DISCONNECT AND REMOVE DEVICE ACTIVATED DETECTORS (DAD) AND EXTERNAL DEVICE ACTIVATED DETECTORS (EDAD). REMOVAL SHALL INCLUDE ALL CONDUIT, SURFACE RACEWAY AND JUNCTION BOXES ASSOCIATED WITH THE DEVICES. ALL ASSOCIATED WIRING SHALL BE COILED AND LABELLED AS ABANDONED IN PLACE. FLAG LABEL THAT INDICATES ABANDONED.
- EXISTING CONDUIT, TERMINAL BOARD AND BACK BOARD TO REMAIN. WIRING SHALL BE COILED AND LABELLED AS ABANDONED IN PLACE. FLAG LABEL THAT INDICATES ABANDONED.
- DISCONNECT AND REMOVE CABINET AND PC. ALL WIRING SHALL BE COILED ABOVE CEILING AS ABANDONED IN PLACE. FLAG LABEL THAT INDICATES ABANDONED.

CODED NOTES

- MOUNT PAS RECEIVER HOUSING, PROVIDED BY OTHERS, TO THE WALL. PRIOR TO THE INSTALLATION OF THE HOUSING, WHICH SHALL BE TIGHT AGAINST THE CEILING, A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL. PRIOR TO SECURING THE HOUSING THE KNOCK OUT TAB ON THE TOP OF THE HOUSING IS TO BE REMOVED TO ALLOW FOR CABLE INSTALLATION BY OTHERS.
- MOUNT LED NOTIFICATION PANEL HOUSING, PROVIDED BY OTHERS, TO WALL. SURFACE RACEWAY SHALL BE INSTALLED AND A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.
- MOUNT ALERT CHIME HOUSING, PROVIDED BY OTHERS, TO ASBESTOS-CONTAINING WALL. SURFACE RACEWAY SHALL BE INSTALLED AND A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.

OOS
 NYS OFFICE OF GENERAL SERVICES
Striving New York
ANDREW M. CUOMO
 Governor
ROANN M. DESTITO
 Commissioner

CHM
 111 Warren Circle, PO Box 5208 Albany, NY 12205-0208
 Main: (518) 452-4500 www.chmny.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE | SUITE 817
 BALTIMORE, MARYLAND | 21227
 P 410.737.8977 | F 410.536.5016
 www.hughes.com

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER OR ARCHITECT, IS A VIOLATION OF THE PROFESSIONAL ETHICS OF THE REGISTERED PROFESSIONAL ENGINEER OR ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.

ELECTRICAL
 PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT

CLIENT:
 NYS OFFICE OF MENTAL HEALTH

LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210

PROJECT NUMBER	44611	
DESIGNED BY:	SJF	
DRAWN BY:	DMS	
FIELD CHECK:	-	
APPROVED:	MH	
MARK	DESCRIPTION	
NO.1	05/13/14	ADDENDUM
NO.2	05/29/14	ADDENDUM
NO.3	03/03/14	FINAL BD DOCUMENTS

BUILDING 15 ASBESTOS REMOVAL PLAN - 2ND FLOOR

DRAWING NUMBER: **H-109**
 SHEET 193 OF 196

	EXISTING STROBE
	EXISTING BELL
	CHIME
	EXISTING SMOKE DETECTOR
	EXISTING MANUAL PULL STATION
	EXISTING HATCH

- GENERAL NOTES**
- ALL WORK SHALL COMPLY WITH APPLICABLE FEDERAL, STATE, AND LOCAL REGULATIONS AND ALL WORK OF THIS CONTRACT SHALL BE COMPLETED BY A LICENSED ASBESTOS ABATEMENT CONTRACTOR USING APPROPRIATELY TRAINED AND CERTIFIED ASBESTOS ABATEMENT WORKERS.
 - REFER TO SPECIFICATION SECTION 003126 FOR ASBESTOS TEST RESULTS. REFER TO SPECIFICATION SECTION 028213 - ASBESTOS ABATEMENT FOR REQUIREMENTS.
 - DUE TO THE MINIMAL OVERALL QUANTITIES OF THE DISTURBANCE TO WALLS, CEILINGS, AND FLOORS PLANNED IN EACH BUILDING, ALL WORK OF THIS PROJECT IS CONSIDERED A MINOR ASBESTOS ABATEMENT PROJECT.
 - ALL FIRE SYSTEM DEMOLITION SYMBOLS SHOWN ON THE H-SERIES DRAWINGS ARE TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. EACH OF THESE FIRE SYSTEM REMOVAL LOCATIONS ALSO REPRESENTS A REPLACEMENT LOCATION WHERE BACKBOX INSTALLATION MUST BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. REFER TO FA & FD SERIES DRAWINGS TO CONFIRM AND COORDINATE LOCATIONS.
 - CODED NOTES SHOWN ON EACH OF THE H-SERIES DRAWINGS CORRELATE TO THE PAS REMOVALS AND INSTALLATIONS AND ARE ALSO ALL TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS.
 - INSTALLATION DETAILS ARE SHOWN ON DRAWINGS H-501, FA-501, FA-502, AND FA-503. ALL INSTALLATIONS SHALL BE SURFACE MOUNT AND MINIMIZE DISTURBANCE TO WALL AND CEILING SURFACES TO THAT OF MOUNTING SCREWS/BOLTS.
 - ALL ABOVE CEILING WORK THAT DOES NOT INVOLVE ACTIVE ABATEMENT SHALL TAKE ALL PRECAUTIONS TO AVOID CONTACT WITH, AND DAMAGE TO, ASBESTOS-CONTAINING JOINT COMPOUND ON THE TOP OF SHEETROCK WALLS.
 - FOLLOWING REMOVALS, PENETRATIONS AND HOLES LEFT BEHIND SHALL BE SEALED AND PATCHED. PATCHING SHALL ENCAPSULATE THE ROUGH OPENING/S AND SHALL NOT INCLUDE ANY SANDING OR OTHER ACTIVITIES THAT COULD CREATE ADDITIONAL FIBER RELEASE. FINISH BY PAINTING TO MATCH EXISTING PAINT.

DEMOLITION CODED NOTES


- ◇ DISCONNECT AND REMOVE DEVICE ACTIVATED DETECTORS (DAD). REMOVAL SHALL INCLUDE ALL CONDUIT, SURFACE RACEWAY AND JUNCTION BOXES ASSOCIATED WITH THE DEVICE. WIRING SHALL BE COILED ABOVE CEILING AS ABANDONED IN PLACE. PLACE LABEL THAT INDICATES ABANDONED.
- ◇ EXISTING CONDUIT, TERMINAL BOARD AND BACK BOARD TO REMAIN. WIRING SHALL BE COILED ABOVE CEILING AS REMAINING IN PLACE. PLACE LABEL THAT INDICATES ABANDONED.
- ◇ DISCONNECT AND REMOVE CABINET AND P.C. WIRING SHALL BE COILED ABOVE CEILING AS REMAINING IN PLACE. PLACE LABEL THAT INDICATES ABANDONED.

CODED NOTES

- ① MOUNT PAS RECEIVER HOUSING, PROVIDED BY OTHERS, TO THE WALL. PRIOR TO THE INSTALLATION OF THE HOUSING, WHICH SHALL BE TIGHT AGAINST THE CEILING, A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL. PRIOR TO SECURING THE HOUSING THE KNOCK OUT TAB ON THE TOP OF THE HOUSING IS TO BE REMOVED TO ALLOW FOR CABLE INSTALLATION BY OTHERS.
- ② MOUNT LED NOTIFICATION PANEL, HOUSING, PROVIDED BY OTHERS, TO WALL. SURFACE RACEWAY SHALL BE INSTALLED AND A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT RACEWAY COVER INSTALLATION/CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.
- ③ MOUNT ALERT CHIME HOUSING, PROVIDED BY OTHERS, TO ASBESTOS-CONTAINING WALL. SURFACE RACEWAY SHALL BE INSTALLED AND A 1" DIAMETER HOLE SHALL BE CUT IN THE CEILING AGAINST THE WALL TO ALLOW FOR SUBSEQUENT CABLE INSTALLATION BY OTHERS. REFER TO SHEET H-501. THE HOLE SHALL BE CREATED AND ENCAPSULATED IN A MANNER THAT WILL ENSURE SUBSEQUENT RACEWAY COVER INSTALLATION/CABLE INSTALLATION WILL NOT DISTURB THE ASBESTOS-CONTAINING CEILING MATERIAL.

THIRD FLOOR ASBESTOS REMOVAL PLAN

1/8" = 1'-0"

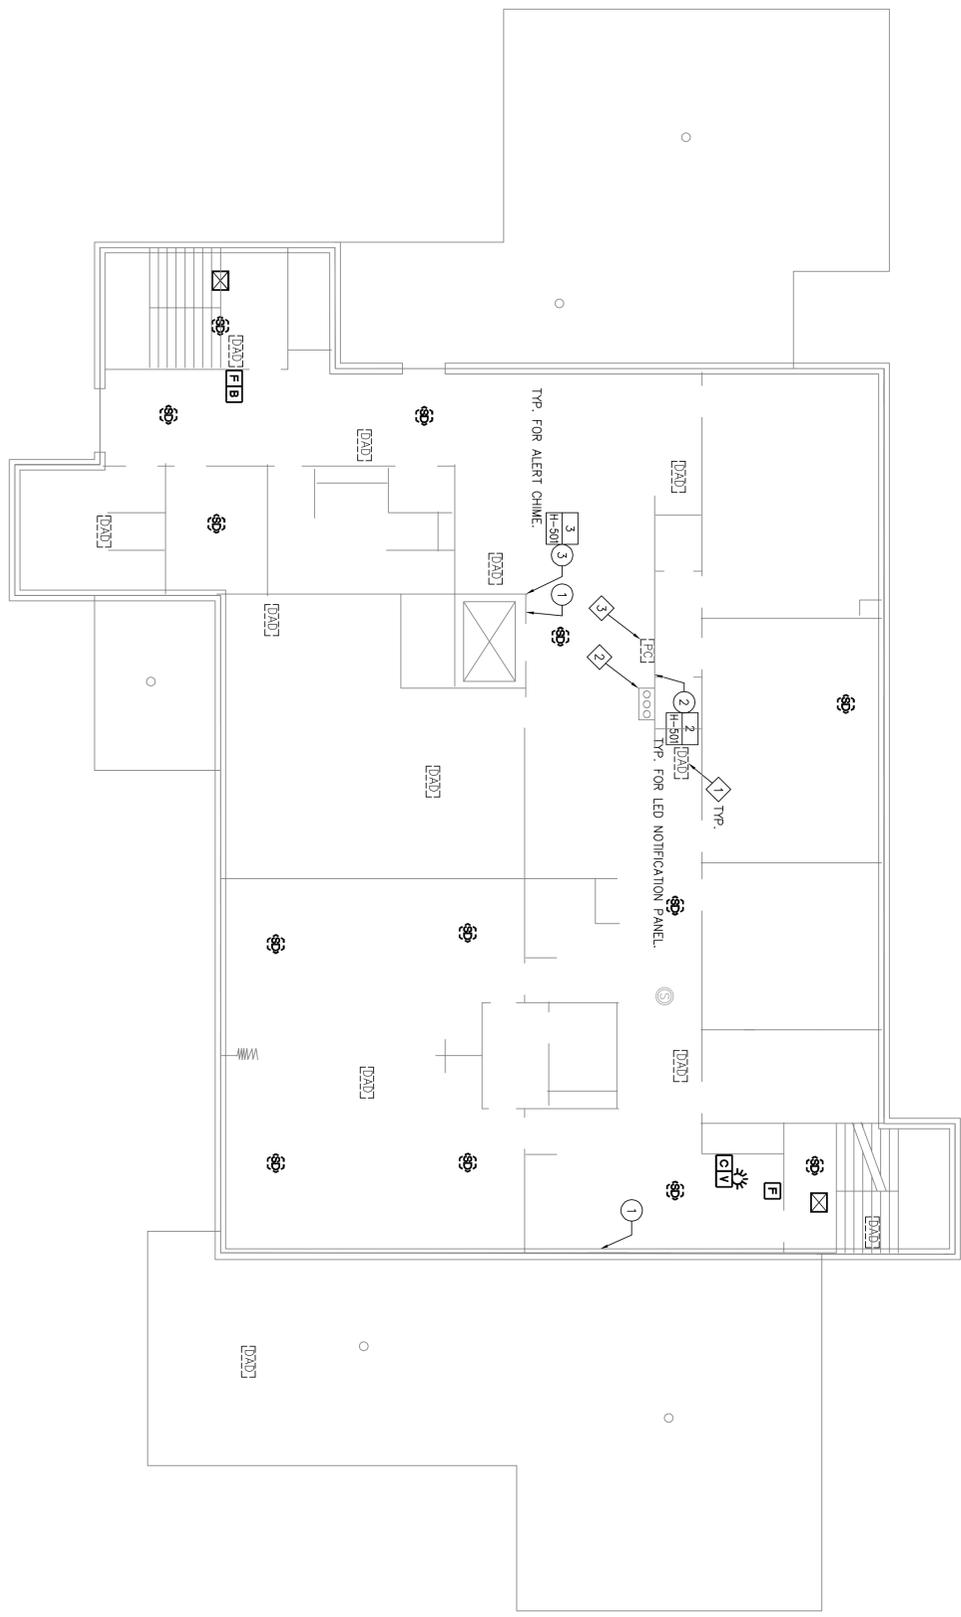

OOS
 NYS OFFICE OF GENERAL SERVICES
Spring New York
ANDREW M. CUOMO
 Governor
ROANN M. DESTITO
 Commissioner

CHA
 111 Warren Circle, PO Box 5208 Albany, NY 12205-0208
 Main: (518) 455-4500 www.chaconline.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE | SUITE 817
 BALTIMORE, MARYLAND 21227
 P 410.371.8977 | F 410.536.5016
 www.hallie.com

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER OR AN ENGINEER OF ARCHITECTURE, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.


ELECTRICAL
 PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT

CLIENT: NYS OFFICE OF MENTAL HEALTH
 LOCATION: HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210

NO.	DATE	DESCRIPTION
NS2	05/29/14	ADDENDUM
NS1	05/13/14	ADDENDUM
A	03/03/14	FINAL BD DOCUMENTS

PROJECT NUMBER:	44611
DESIGNED BY:	SJF
DRAWN BY:	DMS
FIELD CHECK:	-
APPROVED:	MH


SHEET TITLE:
BUILDING 15 ASBESTOS REMOVAL PLAN - 3RD FLOOR
 DRAWING NUMBER:
H-110
 SHEET 194 OF 196

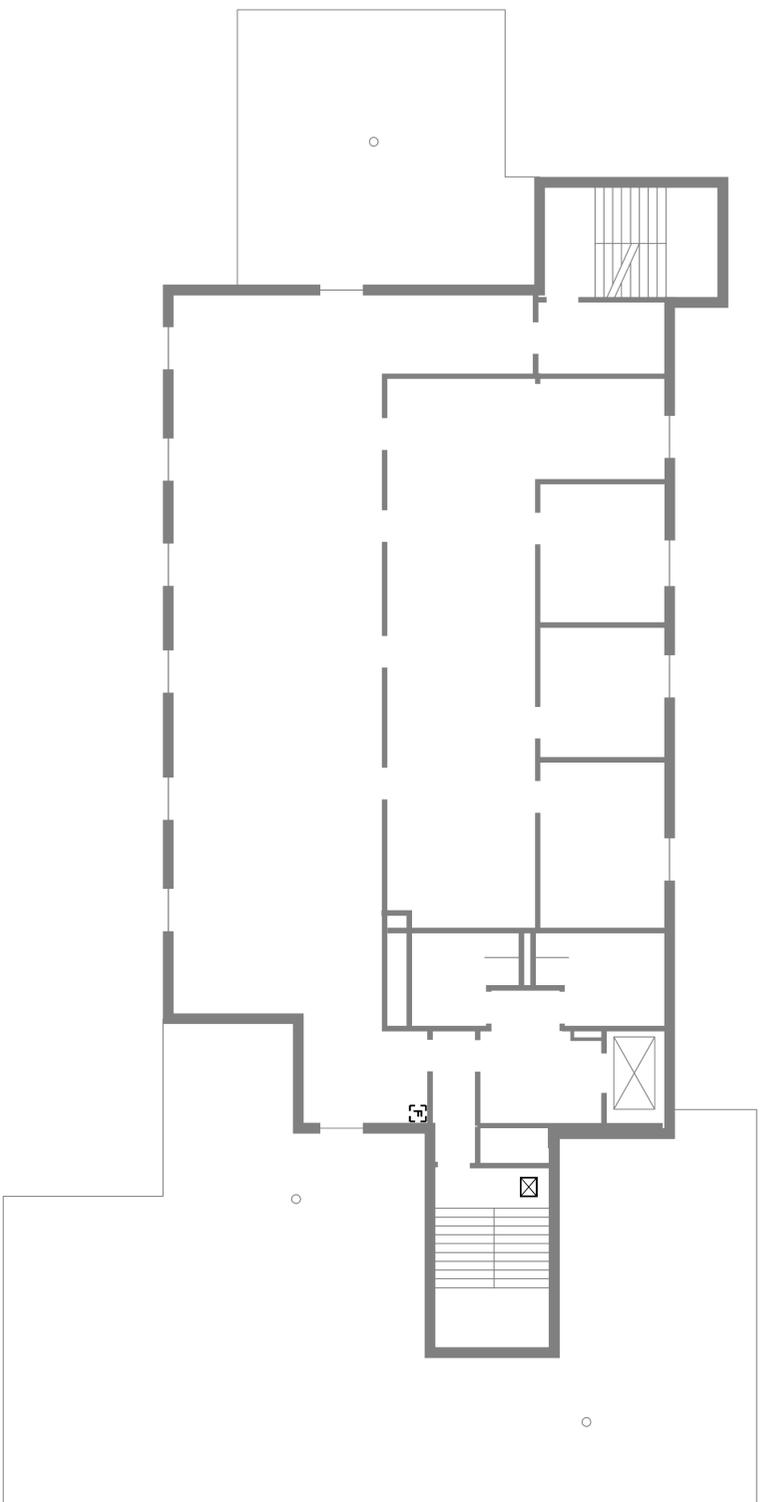

THIRD FLOOR ASBESTOS REMOVAL PLAN
 1/8" = 1'-0"

- GENERAL NOTES**
- A. ALL WORK SHALL COMPLY WITH APPLICABLE FEDERAL, STATE, AND LOCAL REGULATIONS AND ALL WORK OF THIS CONTRACT SHALL BE COMPLETED BY A LICENSED ASBESTOS ABATEMENT CONTRACTOR USING APPROPRIATELY TRAINED AND CERTIFIED ASBESTOS ABATEMENT WORKERS.
 - B. REFER TO SPECIFICATION SECTION 003126 FOR ASBESTOS TEST RESULTS. REFER TO SPECIFICATION SECTION 028213 - ASBESTOS ABATEMENT FOR REQUIREMENTS.
 - C. DUE TO THE MINIMAL OVERALL QUANTITIES OF THE DISTURBANCE TO WALLS, CEILINGS, AND FLOORS PLANNED IN EACH BUILDING, ALL WORK OF THIS PROJECT IS CONSIDERED A MINOR ASBESTOS ABATEMENT PROJECT.
 - D. ALL FIRE SYSTEM DEMOLITION SYMBOLS SHOWN ON THE H-SERIES DRAWINGS ARE TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. EACH OF THESE FIRE SYSTEM REMOVAL LOCATIONS ALSO REPRESENTS A REPLACEMENT LOCATION WHERE BACKBOX INSTALLATION MUST BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS. REFER TO FA & FD SERIES DRAWINGS TO CONFIRM AND COORDINATE LOCATIONS.
 - E. CODED NOTES SHOWN ON EACH OF THE H-SERIES DRAWINGS CORRELATE TO THE PAS REMOVALS AND INSTALLATIONS AND ARE ALSO ALL TO BE COMPLETED UNDER ASBESTOS ABATEMENT CONTROLS BY ASBESTOS CERTIFIED WORKERS.
 - F. INSTALLATION DETAILS ARE SHOWN ON DRAWINGS H-501, FA-501, FA-502, AND FA-503. ALL INSTALLATIONS SHALL BE SURFACE MOUNT AND MINIMIZE DISTURBANCE TO WALL AND CEILING SURFACES TO THAT OF MOUNTING SCREWS/BOLTS.
 - G. ALL ABOVE CEILING WORK THAT DOES NOT INVOLVE ACTIVE ABATEMENT SHALL TAKE ALL PRECAUTIONS TO AVOID CONTACT WITH, AND DAMAGE TO, ASBESTOS-CONTAINING JOINT COMPOUND ON THE TOP OF SHEETROCK WALLS.
 - H. FOLLOWING REMOVALS, PENETRATIONS AND HOLES LEFT BEHIND SHALL BE SEALED AND PATCHED. PATCHING SHALL ENCAPSULATE THE ROUGH OPENING/S AND SHALL NOT INCLUDE ANY SANDING OR OTHER ACTIVITIES THAT COULD CREATE ADDITIONAL FIBER RELEASE. FINISH BY PAINTING TO MATCH EXISTING PAINT.

FIRE SYSTEM DEMOLITION AND INSTALLATION LEGEND
 EXISTING MANUAL PULL STATION



OCS
 NYS'S OFFICE OF GENERAL SERVICES
Spring New York
ANDREW M. CUOMO
 Governor
ROANN M. DESTITO
 Commissioner

CH2M
 111 Warren Circle, PO Box 5286 Albany, NY 12205-0286
 Main: (518) 455-4500 www.ch2m.com

HUGHES ASSOCIATES
 ENGINEERS | CONSULTANTS | SCIENTISTS
 3610 COMMERCE DRIVE | SUITE 817
 BALTIMORE, MARYLAND | 21227
 P 410.731.8977 | F 410.536.5016
 www.hallie.com

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPETENT ENGINEER, MAY BE CONSIDERED A VIOLATION OF THE PROFESSIONAL ENGINEER'S ETHICS. THE DESIGN OF THIS PROJECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS A MISDEMEANOR.



ELECTRICAL
 CONTRACTOR:
 TITLE:
 PROVIDE PAS, FIRE PROTECTION IMPROVEMENTS AND ACM ABATEMENT
 LOCATION:
 HUTCHINGS PSYCHIATRIC CENTER
 620 MADISON STREET
 SYRACUSE, NY 13210
 CLIENT:
 NYS OFFICE OF MENTAL HEALTH

NO.	DATE	DESCRIPTION
NO.2	05/29/14	ADDENDUM
NO.1	05/13/14	ADDENDUM
A	03/03/14	FINAL BID DOCUMENTS

PROJECT NUMBER: 44611
 DESIGNED BY: SHF
 DRAWN BY: DMS
 FIELD CHECK: -
 APPROVED: MH

BUILDING 17 ASBESTOS REMOVAL PLAN - 3RD FLOOR
 DRAWING NUMBER: H-111
 SHEET 195 OF 196