



---

---

**ADDENDUM NO. 2 TO PROJECT NO. 44720  
CONSTRUCTION WORK, HVAC WORK, ELECTRICAL WORK  
REPLACE COOLERS AND FREEZERS  
BUILDING NOS. 15 AND 89  
ATTICA CORRECTIONAL FACILITY  
639 EXCHANGE STREET  
ATTICA, NY**

November 7, 2014

**NOTE:** This Addendum forms a part of the Contract Documents. Insert it in the Project Manual. Acknowledge receipt of this Addendum in the space provided on the Bid Form.

**SPECIFICATION GROUP**

**CONSTRUCTION WORK AND ELECTRICAL WORK PROJECT MANUALS:**

1. 015250 TEMPORARY REFRIGERATED TRAILERS: Delete from Paragraph 1.02 A, "Include temporary services and accessories necessary for the use of the items specified."
2. 015250 TEMPORARY REFRIGERATED TRAILERS: Delete this section from HVAC Project Manual.


**CONSTRUCTION WORK DRAWINGS**

1. Drawing S-501, STRUCTURAL DETAILS: Refer to Details No. 7,9 & 10. Change 1 hr minimum rating to 2 hrs.
2. Drawings A-101, Bldg. 15 & 89 PARTIAL BASEMENT & FIRST FLOOR REMOVAL PLAN, A-102 Bldg. 15 & 89 PARTIAL FIRST FLOOR AND REFLECTED CEILING REMOVAL PLANS. Refer to Drawings A-103 & A-104 for locations for Temporary Construction Barrier/Fence locations.
3. Drawing A-103, BUILDING 15 & 89 FIRST FLOOR PLAN, Refer to wire partition located in Hanging Meats Room 115. Apply Note #2 to the wire partition. Note #15 identifies patching required at existing concrete floors where damage is produced when new concrete footings are located at structural steel posts. Note #3 Applies to the re-installation of a steel guardrail located adjacent to the loading dock 101, between the existing steel columns.
4. Drawing A-103, BUILDING 15 & 89 FIRST FLOOR PLAN, Refer to Butcher Shop 116. The existing opening at the Corridor will remain, door is not to be provided.

5. Drawing A-104, BUILDING NO.15 PARTIAL FIRST FLOOR PLAN & DOOR SCHEDULE, Refer to Door Schedule, Door No. A-129 shall be indicated as a 1 1/2 hr fire rated door and frame. Threshold detail at Daily Use Cooler I-35, to reference 4/A502 not 2/A502.
6. Drawing A-501, COOLER FREEZER DOOR AND MISCELLANEOUS DETAILS, Delete Corner Guard Detail #4. Refer to Typical Fascia Panel Detail #2. Change 18 gauge to 14 gauge.
7. Drawing M-101, BASEMENT PLAN REMOVALS HVAC, Delete reference to Bldg. 89 and change to Bldg, 15.
8. Drawing E-103, BUILDING NO. 15 & NO.89 FIRST FLOOR POWER PLAN, Note#18, Electrical Contractor is required to provide electrical power connections to the refrigeration equipment, lighting, etc. furnished as part of the Temporary Refrigerated Trailers provided by the "C" Contractor.
9. Refer to Drawing M-102 FIRST FLOOR PLAN REMOVALS HVAC, Refer to attached Sketchs SK-A001 and SK-S002, for repairing of the existing EPDM roof after the removal of the existing cooling tower.

**END OF ADDENDUM**

Margaret F. Larkin  
Executive Director  
Design and Construction

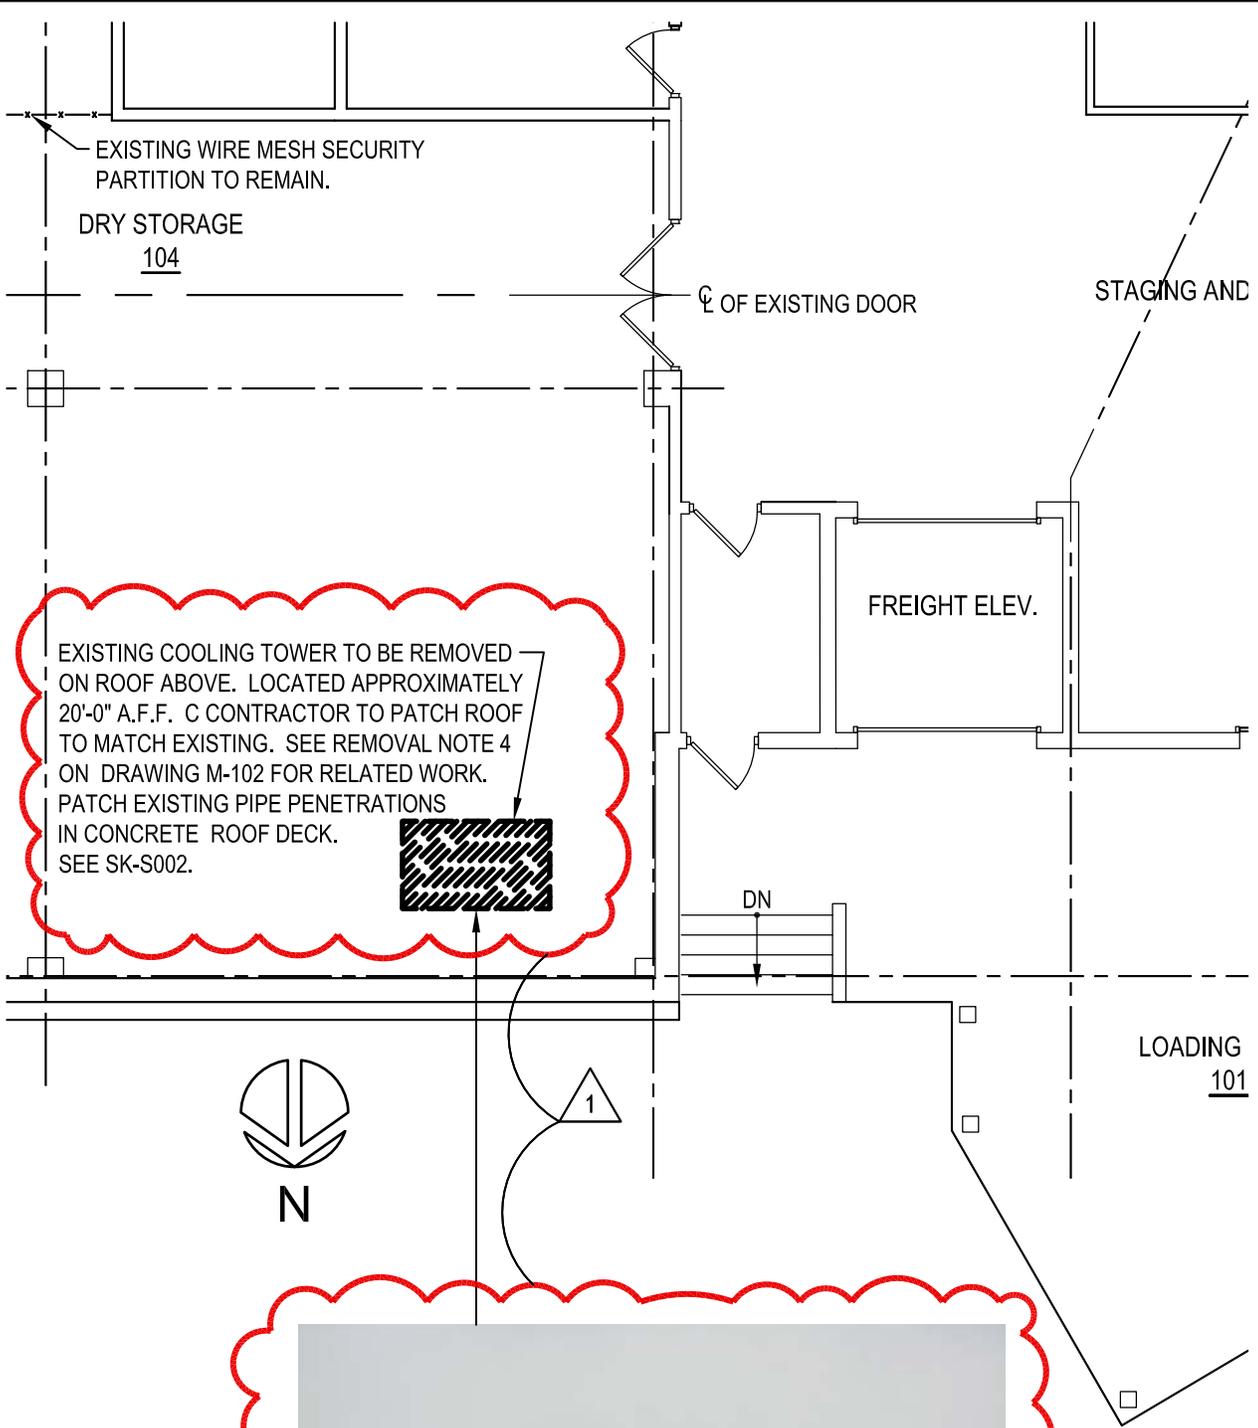

EXISTING COOLING TOWER TO BE REMOVED ON ROOF ABOVE. LOCATED APPROXIMATELY 20'-0" A.F.F. C CONTRACTOR TO PATCH ROOF TO MATCH EXISTING. SEE REMOVAL NOTE 4 ON DRAWING M-102 FOR RELATED WORK. PATCH EXISTING PIPE PENETRATIONS IN CONCRETE ROOF DECK. SEE SK-S002.



**TRAUTMAN ASSOCIATES**  
ARCHITECTS/ENGINEERS

DEPT. OF CORRECTIONS AND COMMUNITY SUPERVISION  
 REPLACE COOLERS AND FREEZERS, BUILDING NOS. 15 AND 89  
 ATTICA CORRECTIONAL FACILITY, ATTICA, NEW YORK  
 OGS PROJECT NO.: 44720  
**REVISION 1 - BUILDING 15 & 89 FIRST FLOOR REMOVAL PLAN**


**SK-A001**  
 Reference Sheet: 1/A-101  
 Date: 06 NOV. 2014  
 Project Number: 13016.00

SCALE: 1/8" = 1'-0"

DEPT. OF CORRECTIONS AND COMMUNITY SUPERVISION  
REPLACE COOLERS AND FREEZERS, BUILDING NOS. 15 AND 89  
ATTICA CORRECTIONAL FACILITY, ATTICA, NEW YORK  
OGS PROJECT NO.: 44720  
**REVISION 1 - PIPE PENETRATION INFILL**

**SK-S002**

Reference Sheet: SK-A001  
Date: 06 NOV. 2014  
Project Number: 13016.00

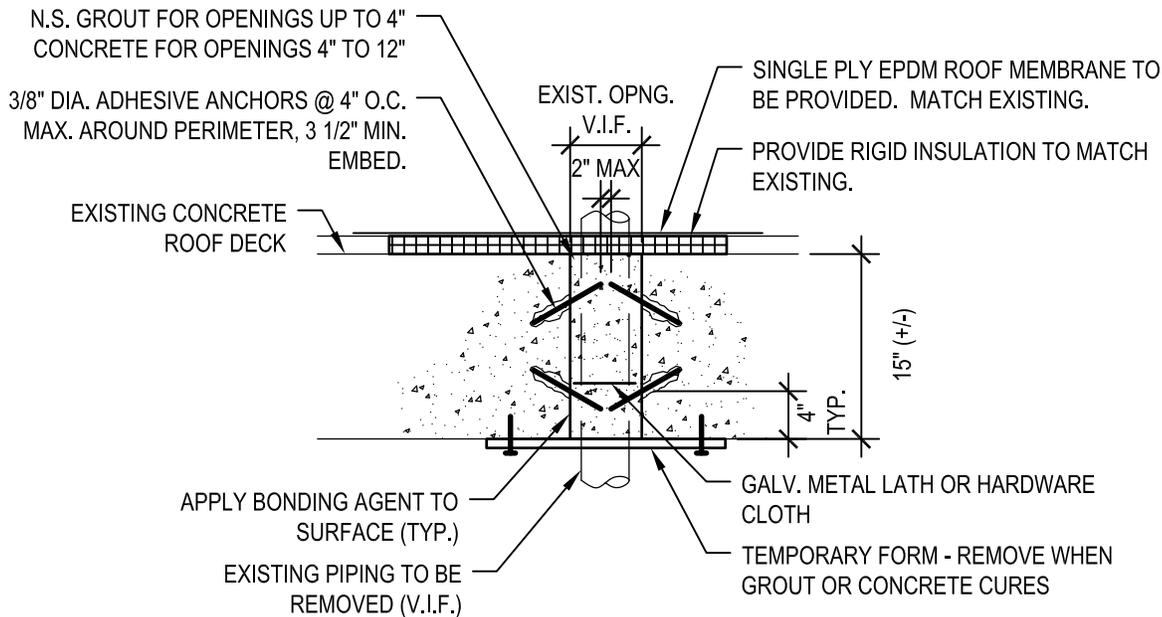

NOTIFY DIRECTOR'S REPRESENTATIVE  
IF OPENINGS LARGER THAN 12" ARE  
DISCOVERED

**1** **EXIST. COOLING TOWER  
PIPING PENETRATION INFILL**  
N.T.S.