



DESIGN AND CONSTRUCTION GROUP
THE GOVERNOR NELSON A. ROCKEFELLER
EMPIRE STATE PLAZA
ALBANY, NY 12242

ADDENDUM NO. 2 TO PROJECT NO. 44986

**CONSTRUCTION WORK and PLUMBING WORK
REPLACE WATER DISTRIBUTION SYSTEM
ELMIRA CORRECTIONAL FACILITY
1879 DAVIS STREET
ELMIRA, NY 14902**

March 4, 2016

NOTE: This Addendum forms a part of the Contract Documents. Insert it in the Project Manual. Acknowledge receipt of this Addendum in the space provided on the Bid Form.

BIDDING REQUIREMENTS

CONSTRUCTION CONTRACT

1. DOCUMENT 002216 SUPPLEMENTARY INSTRUCTIONS TO BIDDERS – ASBESTOS PROJECTS: Discard this Document (page 1) from the Project Manual.

SPECIFICATION GROUP

CONSTRUCTION WORK SPECIFICATIONS

2. Page 347115 – 1, Article 2.01, Change Paragraph 2.01 B. to read:
 - B. Bumper Post Sleeve: **Model 1736** by Eagle Manufacturing Company, 2400 Charles Street, Wellsburg, WV 26070, (304) 737-3171, www.eagle-mfg.com.
 1. Color: Yellow.

DRAWINGS

CONSTRUCTION WORK DRAWINGS

3. Revised Drawings:
 - a. Drawing No. G-003 noted “ADDENDUM NO. 2 – 3/02/2016” accompanies this Addendum and supersedes the same numbered originally issued drawing.


ADDENDUM NO. 1 TO PROJECT NO. 44986

February 2, 2016

4. Drawing No. C-210:
 - a. 3/C-210 Water Line P: Delete “(2 Pipes 10’ apart)” note.

END OF ADDENDUM

Margaret F. Larkin
Executive Director
Design and Construction

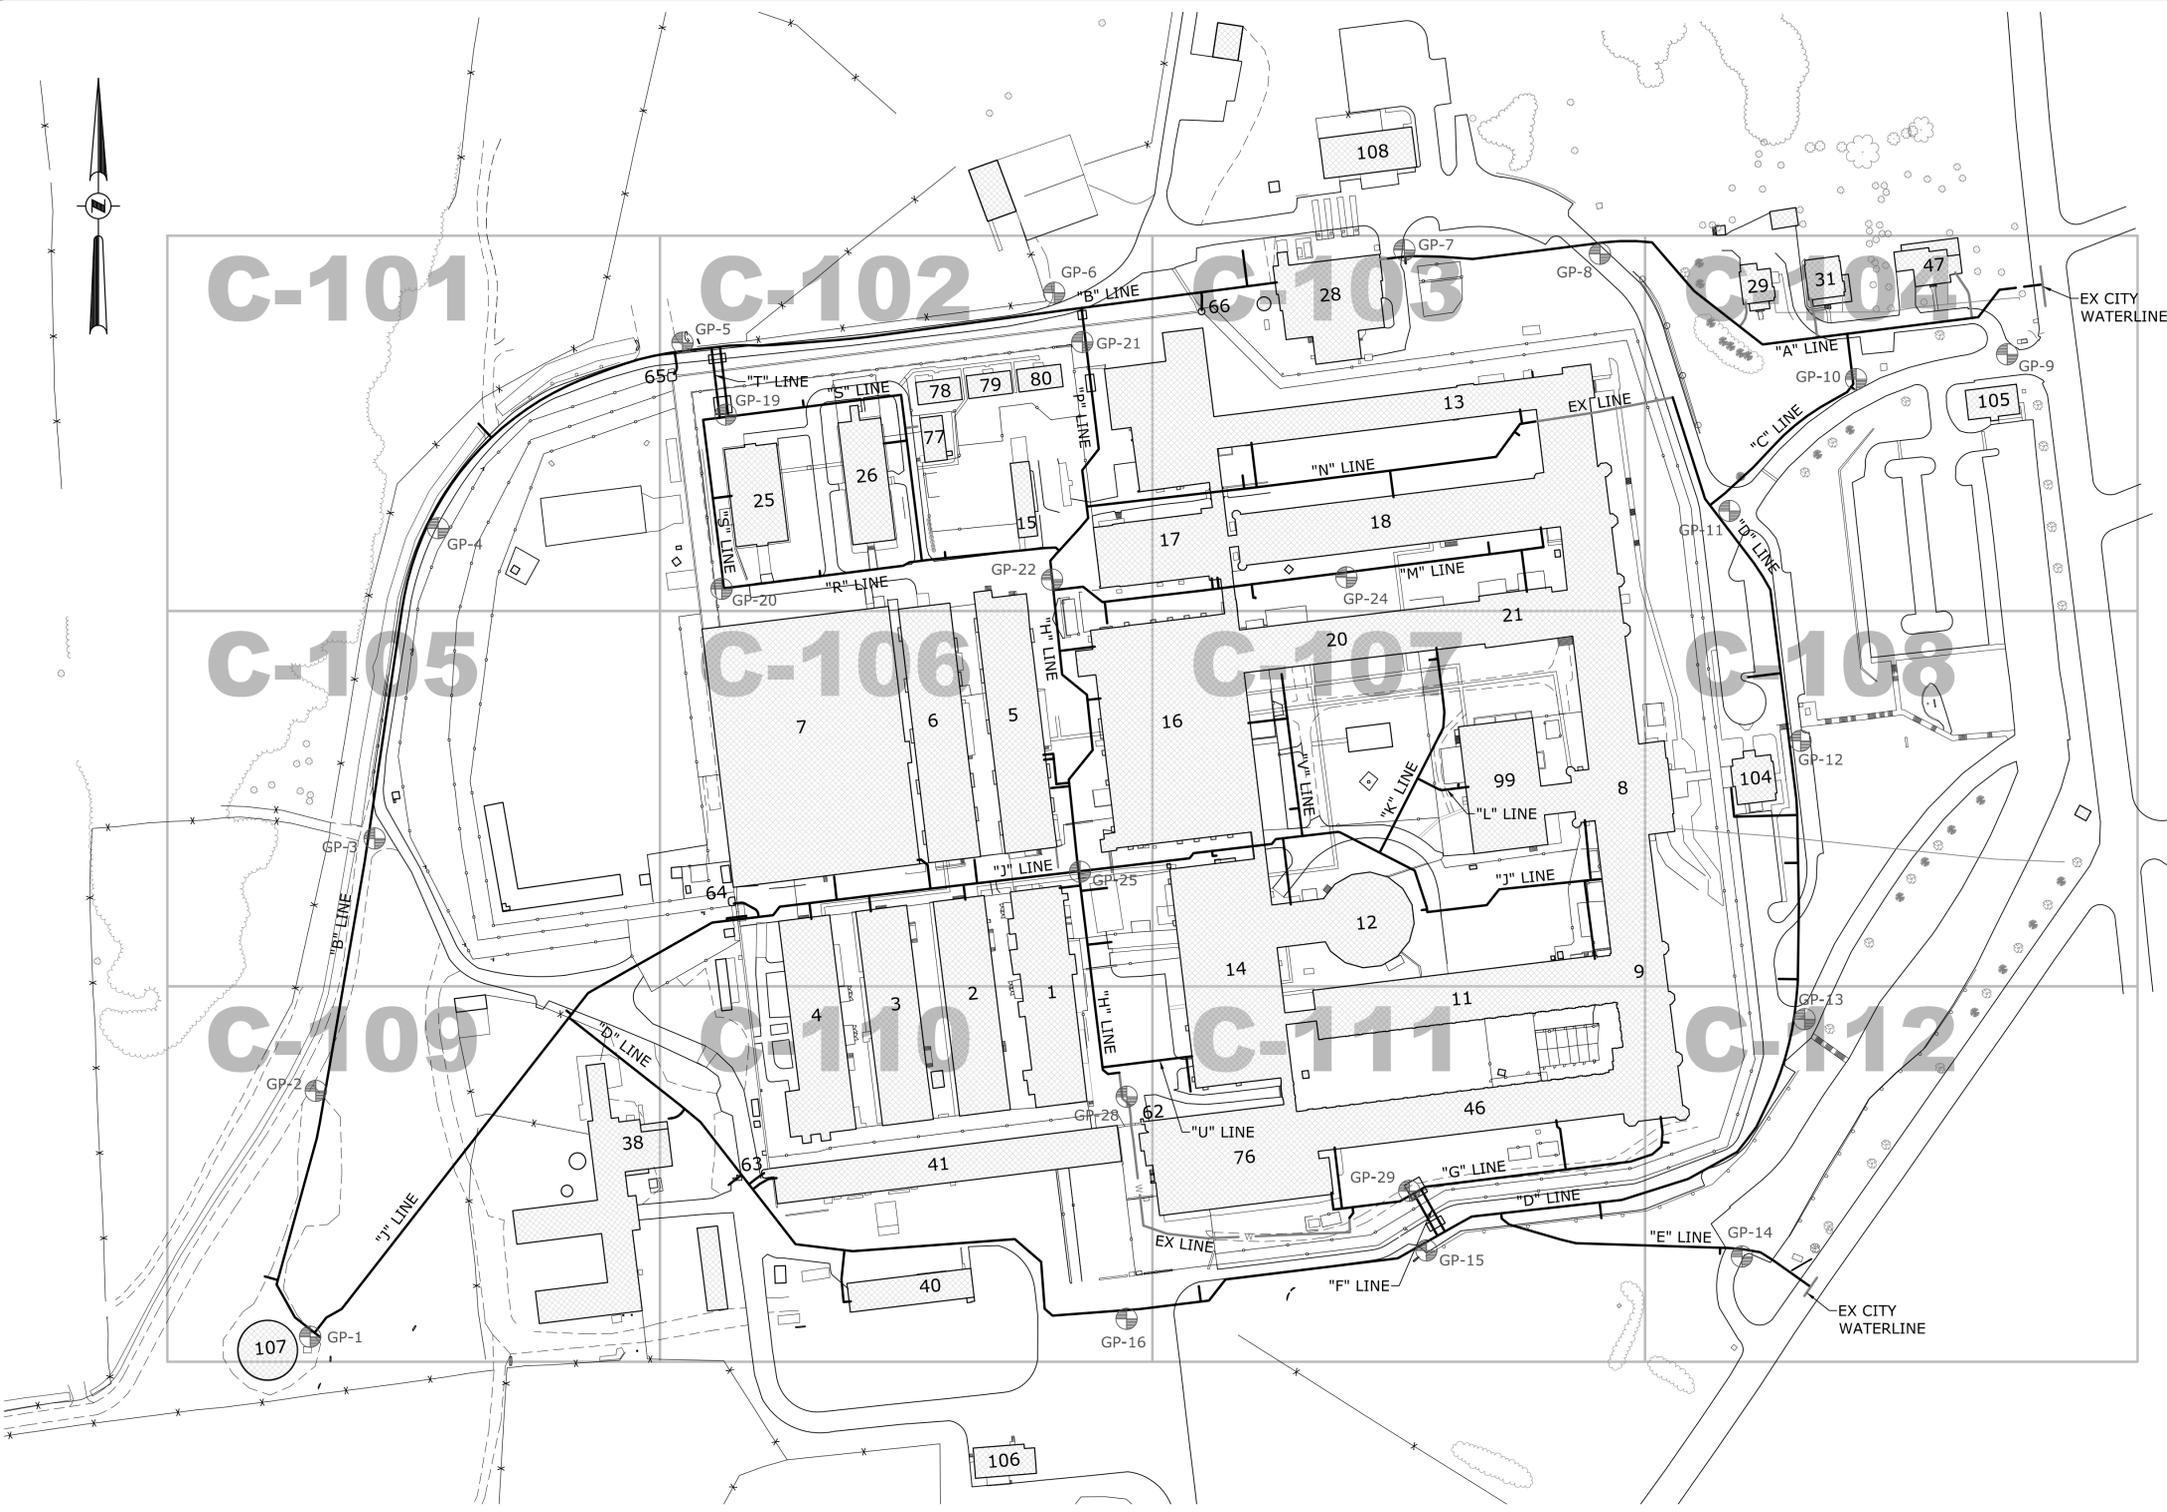

BUILDING NO.	DESCRIPTION
1	DRAFT PROCESSING/MACHINE SHOP
2	VOCATIONAL SHOP
3	FOUNDRY SHOP
4	MAINTENANCE SHOP
5	PRINT SHOP
6	BUSINESS & COMPUTER SHOP
7	FIELD HOUSE
8	ADMINISTRATION
9	HOUSING F, H & PC
11	HOUSING G
12	GYMNASIUM
13	RECEPTION
14	LAUNDRY
15	RECYCLING
16	DINING & KITCHEN
17	AUDITORIUM
18	HOUSING A & B
20	HOUSING C
21	HOUSING D
22	HOUSING E
25	SCHOOL
26	MHU
29	RESIDENCE #3
31	RESIDENCE #2
38	BARN/PASTERIZATION PLANT
40	GARAGE
41	MAINTENANCE & STORAGE
46	HOUSING I
47	RESIDENCE #1
62	WALL POST 2
63	WALL POST 3
64	WALL POST 4
65	WALL POST 5
66	WALL POST 6
76	SHU
77	URINALYSIS TEST
78	FAMILY REUNION APTS 1 & 2
79	FAMILY REUNION APTS 3 & 4
80	FAMILY REUNION APTS 5 & 6
99	INFIRMARY
104	ENTRY BUILDING
105	HOSPITALITY BUILDING
106	OGS TRAILER
107	WATER STORAGE TANK
108	GENERATOR BUILDING

GP-15 GEOPROBE LOCATIONS



DESIGN & CONSTRUCTION

CONSULTANT:

C.T. MALE ASSOCIATES
 ENGINEERING, SURVEYING, ARCHITECTURE & LANDSCAPE ARCHITECTURE, P.C.
 CTM PROJ NO: 14.4154 CTM DWG NO: 15.0320

C.T. MALE ASSOCIATES © 2015

WARNING:
 THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS 'A' MISDEMEANOR.



CONSTRUCTION

TITLE:
 REPLACE WATER DISTRIBUTION SYSTEM

LOCATION:
 ELMIRA CORRECTIONAL FACILITY
 1879 DAVIS STREET
 ELMIRA, CHEMUNG COUNTY, NEW YORK

CLIENT:
 DEPARTMENT OF CORRECTIONS
 AND COMMUNITY SUPERVISION

BID DOCUMENTS

ADDENDUM	DATE	DESCRIPTION
ADDENDUM 2	3/2/2016	ADDENDUM NO. 2
ADDENDUM 1	2/26/2016	ADDENDUM NO. 1
BID	12/30/2015	BID DOCUMENTS
100%	6/22/2015	100% SUBMISSION
80%	6/22/2015	80% SUBMISSION
DD		DESIGN DEVELOPMENT
SD		SCHEMATIC DESIGN
MARK	DATE	DESCRIPTION

PROJECT NUMBER: **44986 - C**
 DESIGNED BY: _____
 DRAWN BY: _____
 FIELD CHECK: _____
 APPROVED: _____

WATER MAIN KEY PLAN

DRAWING NUMBER:
G-003

GENERAL SECURITY NOTES:

- ELMIRA CORRECTIONAL FACILITY IS AN OPERATIONAL AND OCCUPIED MAXIMUM SECURITY CORRECTIONAL FACILITY. ALL WORK PERFORMED UNDER THIS PROJECT SHALL BE PERFORMED SO AS TO MAINTAIN FACILITY OPERATIONS AT ALL TIMES.
- ACCESS TO THE FACILITY IS MADE THROUGH THE ENTRY BUILDING AND VEHICLE COMPOUNDS WHICH SHALL BE MAINTAINED OPERATIONAL AT ALL TIMES DURING THE CONSTRUCTION OF THIS CONTRACT. THE FACILITY PATROL ROAD WILL BE USED DURING CONSTRUCTION AND MUST REMAIN ACCESSIBLE AT ALL TIMES.
- THE FACILITY'S PERIMETER IS PROTECTED BY PERIMETER SECURITY FENCES, PERIMETER FENCE LIGHTING SYSTEM, AND PERIMETER SECURITY DETECTION ZONES (WITH EACH ZONE PROTECTED BY A MINIMUM OF TWO DETECTION SYSTEMS) AND A PERIMETER SURVEILLANCE CCTV SYSTEM WHICH ARE INTERCONNECTED TOGETHER TO WORK AS AN INTEGRATED PERIMETER SECURITY SYSTEM.
- PERIMETER SECURITY OF THE FACILITY SHALL BE MAINTAINED AND FULLY OPERATIONAL AT ALL TIMES DURING THE WORK OF THIS CONTRACT. PERIMETER SECURITY FENCES ARE TO REMAIN INTACT AT ALL TIMES.
- PROJECT SCHEDULE: THE PROJECT SCHEDULE SHALL BE SUBMITTED, REVIEWED AND APPROVED PRIOR TO STARTING ANY WORK.
- SUBMITTALS: IN ACCORDANCE WITH ARTICLE 4.4 OF THE GENERAL CONDITIONS, NO WORK SHALL COMMENCE UNTIL THE APPROPRIATE SUBMITTALS REQUIRED FOR THAT WORK HAVE BEEN SUBMITTED, REVIEWED AND APPROVED.
- THE EXACT LOCATIONS OF EXISTING UNDERGROUND UTILITIES AND PERIMETER SECURITY SYSTEM LINES ARE UNKNOWN AND SHOWN APPROXIMATE ONLY. BEFORE ANY WORK IS STARTED NEAR THE PERIMETER FENCES, DETERMINE EXACT LOCATION OF ALL UNDERGROUND UTILITIES AND PERIMETER SECURITY SYSTEM LINES (WHETHER SHOWN ON DRAWINGS OR NOT) BY USE OF AN UNDERGROUND UTILITY LOCATOR SERVICE. MARK AND PROTECT ALL UNDERGROUND UTILITIES AND PERIMETER SECURITY SYSTEM LINES. CONTRACTOR SHALL BE HELD RESPONSIBLE FOR ANY DAMAGE TO ANY UNDERGROUND UTILITIES AND PERIMETER SECURITY SYSTEM LINES.
- EXTREME CAUTION SHALL BE USED WHEN WORKING NEAR THE PERIMETER SECURITY SYSTEMS AND THEIR ASSOCIATED CONDUITS. THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR ANY DAMAGE TO THESE SYSTEMS AND/OR LOSSES DUE TO DAMAGE TO THESE SYSTEMS, INCLUDING THE COST TO REPAIR THE DAMAGE AND ANY COST INCURRED BY THE STATE FOR ADDITIONAL SECURITY STAFF TO PROTECT THE PERIMETER OF THE FACILITY DUE TO ANY OUTAGES OF THE SECURITY SYSTEMS.

