



**DESIGN AND CONSTRUCTION GROUP  
THE GOVERNOR NELSON A. ROCKEFELLER  
EMPIRE STATE PLAZA  
ALBANY, NY 12242**

---

**ADDENDUM NO. 2 TO PROJECT NO. 45149**

**CONSTRUCTION WORK AND PLUMBING WORK  
PROVIDE STRUCTURAL REPAIRS TO PARKING GARAGE  
EMPIRE STATE PLAZA EAST PARKING GARAGE  
PHILIP STREET,  
ALBANY, NY**

June 2, 2017

**NOTE:** This Addendum forms a part of the Contract Documents. Insert it in the Project Manual. Acknowledge receipt of this Addendum in the space provided on the Bid Form.

**CONSTRUCTION WORK SPECIFICATIONS**

1. Page 030131-3, ARTICLE 2.01 COMPANIES: Add the following Paragraph:  
“G. DS Brown Company, 300 E Cherry St., North Baltimore, OH 45872, (419) 257-3561, www.dsbrown.com.”
2. Page 030131-4, Paragraph 2.02 C.: Add the following Subparagraph:  
“5. Elastomeric Concrete: “Emcrete” by Emseal Joint Systems LTD, “WaboCrete II” by Master Builders (BASF), “Delpatch” by DS Brown Company.”
3. Page 079000-3, Subparagraph 2.03 B.2.: Delete this Subparagraph in its entirety, and replace with the following:  
“2. ”Emshield DFR2” by Emseal Joint Systems LTD.”

**PLUMBING WORK SPECIFICATIONS**

4. Page 211200-2, ARTICLE 2.03 STEEL PIPE AND FITTINGS: Delete this Article in its entirety and replace with the following:  
“2.03 STEEL PIPE AND FITTINGS  
  
A. Steel Pipe for Roll Grooving: Standard weight, Schedule 40, hot dipped galvanized; ASTM A 53, Grade B, Type F for sizes 3/4 inch to 1-1/2 inch, and Type E or S for sizes 2 inch to 24 inch, or ASTM A 135.  
  
B. Hot Dipped Galvanized Couplings: Grinnell Corp.’s Rigidlok Fig. 7401, or Victaulic Co.’s Style 107, having minimum pressure rating of:
  1. 750 psi from 1-1/2 inch to 4 inch.
  2. 700 psi for 6 inch.
  3. 600 psi for 8 inch.”

- C. Hot Dipped Fittings: By same manufacturer as couplings, having pressure ratings equal to or greater than couplings. Comply with the following standards:
  - 1. Steel: ASTM A 53 or A 106, Grade B.
  - 2. Malleable Iron: ASTM A 47.
  - 3. Ductile Iron: ASTM A 536.
  
- D. Gaskets For Use With Grooved End Pipe and Fittings: Type and materials as recommended and furnished by the fitting manufacturer, for the service of piping system in which installed.”
  
- 5. Page 211200-3, Paragraph 3.03 A.: Add the following Subparagraphs:
  - “2. Field cutting of piping is not allowed.
  - 3. Perform hot dipped galvanizing after piping is cut to length and the rolled grooving is completed.”
  
- 6. Page 211200-4, ARTICLE 3.06 PIPE AND FITTING SCHEDULE: Delete this Article in its Entirety and replace with the following:  
  
**“3.06 PIPE AND FITTING SCHEDULE**
  - A. Fire Standpipe: Standard weight hot dipped galvanized steel pipe, with roll grooved ends, hot dipped galvanized steel grooved pipe fittings, and couplings.”


**CONSTRUCTION WORK DRAWINGS**

- 7. Drawing No. A-508, Detail 1: Delete this Detail in its entirety. See Addendum Drawing No. A-511 which accompanies this Addendum for replacement detail.
  
- 8. Addendum Drawings:
  - a. Drawing Nos. A-511 and A-512 noted “ADDENDUM DRAWING 05/30/17” accompany this Addendum and form part of the Contract Documents.

**END OF ADDENDUM**


Margaret F. Larkin  
Executive Director  
Design and Construction

JRC:jc

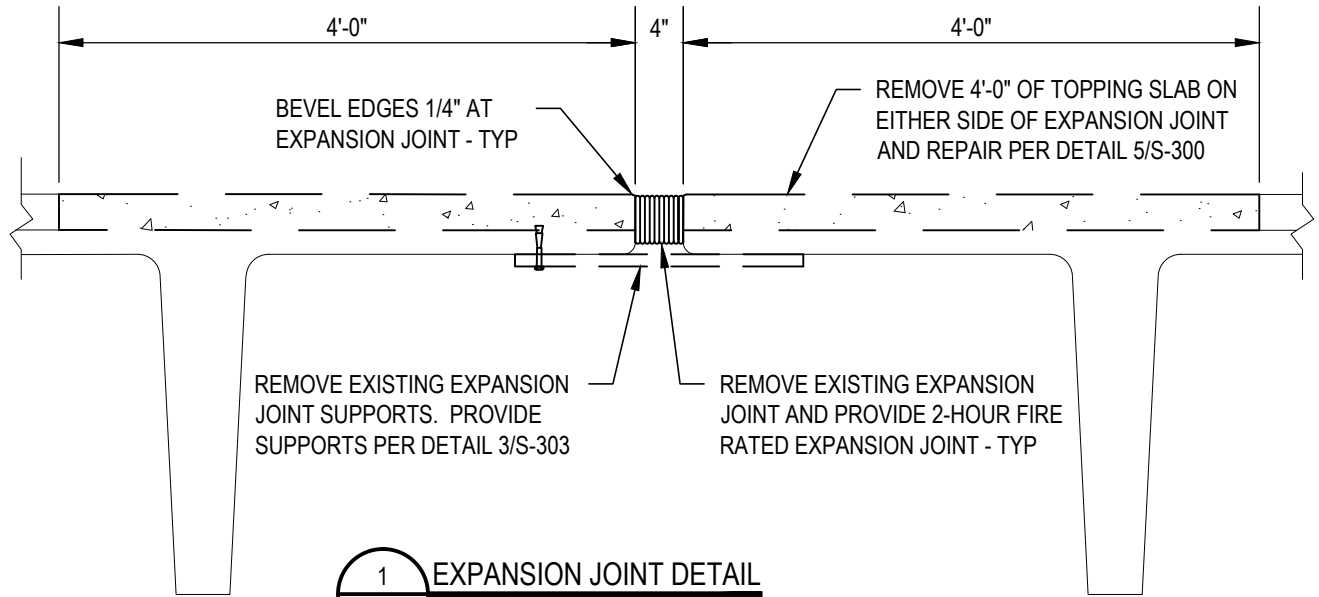

**1** EXPANSION JOINT DETAIL  
A-508 3/4"=1'-0"

THIS DETAIL REPLACES DETAIL 1/A-508 ON SHEET A-508

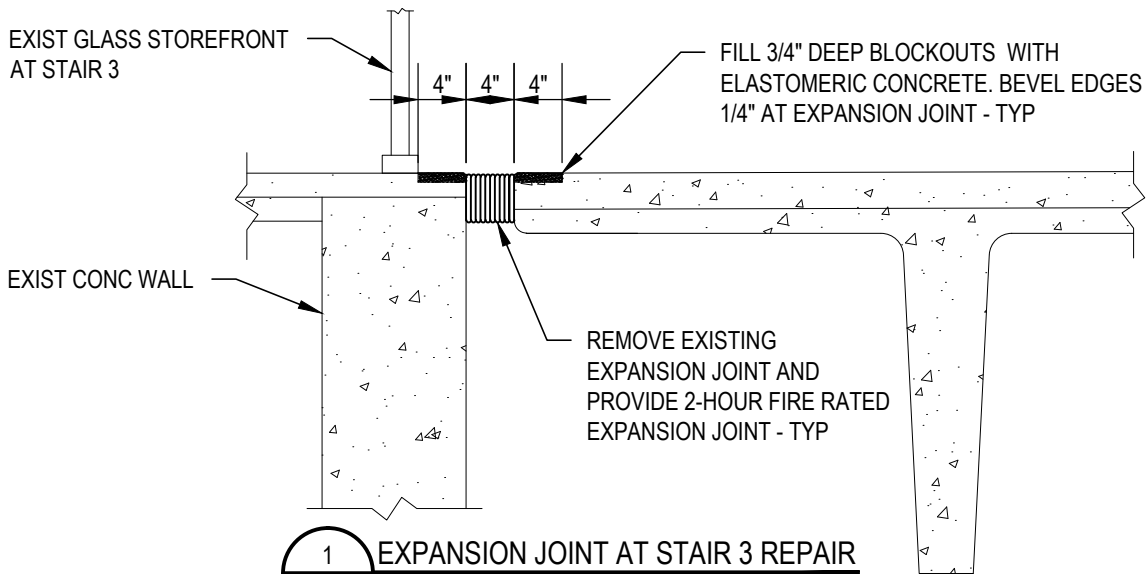

**1** EXPANSION JOINT AT STAIR 3 REPAIR  
A-511 3/4"=1'-0"

USE THIS DETAIL AT STAIR 3 INTERSECTION OF WALL AND DECK BETWEEN COLUMNS F AND G. REFER TO PLAN BLOW UP ON SHEET A-512.

ADDENDUM DRAWING 05/30/2017




SHEET TITLE: EAST PARKING GARAGE  
ADDENDUM 2  
EXPANSION JOINT DETAILS

PROJECT: PROVIDE STRUCTURAL REPAIRS TO  
PARKING GARAGE  
ESP EAST PARKING GARAGE

CONTRACT: CONSTRUCTION  
PROJ. NO: 45149-C  
DATE: 05/30/2017  
DRAWN: BMH  
APPROVED: CST

WARNING: THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS 'A' MISDEMEANOR.


DWG NO:  
A-511

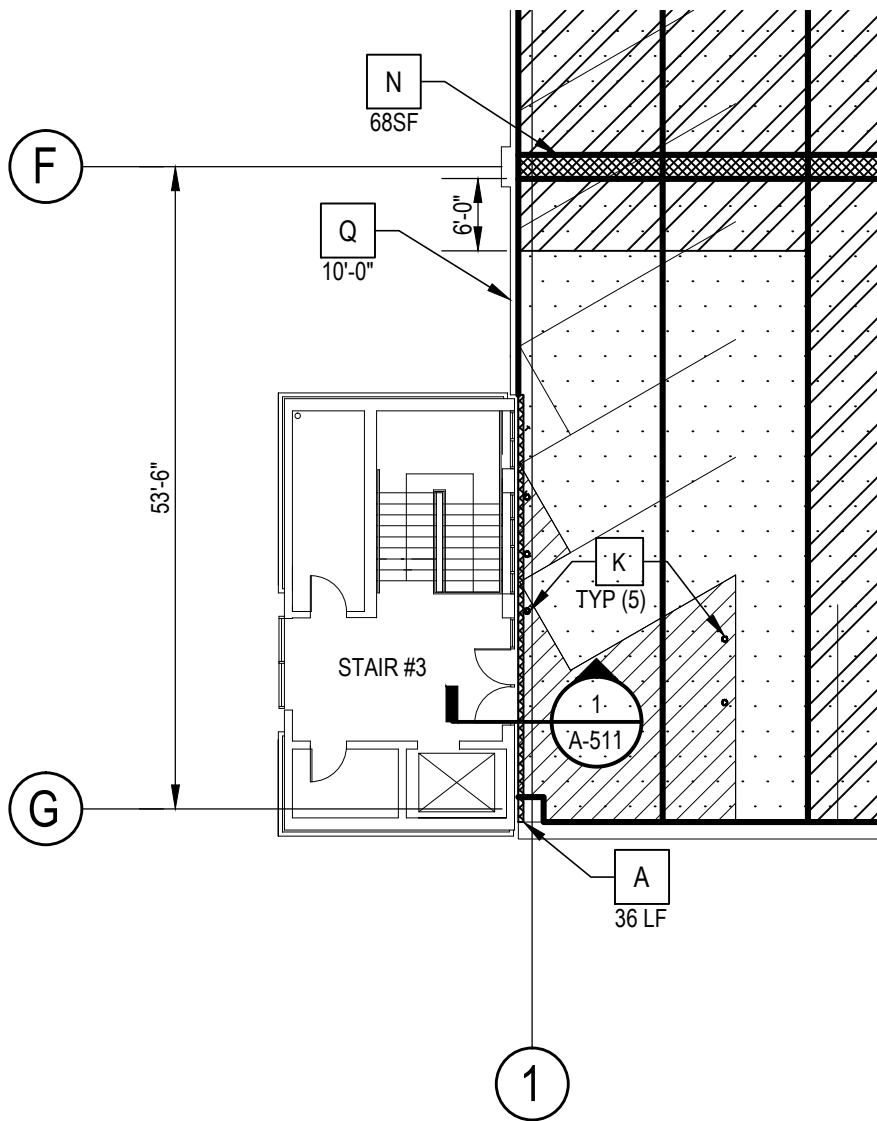

1 FIFTH FLOOR PLAN SOUTH - STAIR 3 BLOW UP  
 A-512 1/16"=1'-0"

REFER TO DETAIL 1/A-511 FOR EXPANSION JOINT REPAIR.

ADDENDUM DRAWING 05/30/2017

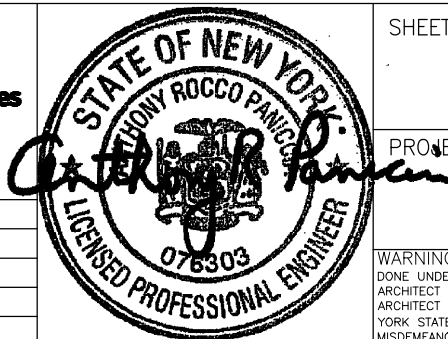

SHEET TITLE: EAST PARKING GARAGE  
 ADDENDUM 2  
 FIFTH FLOOR STAIR 3 PLAN

PROJECT: PROVIDE STRUCTURAL REPAIRS TO  
 PARKING GARAGE  
 ESP EAST PARKING GARAGE

CONTRACT: CONSTRUCTION  
 PROJ. NO: 45149-C  
 DATE: 05/30/2017  
 DRAWN: BMH  
 APPROVED: CST

WARNING: THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS  
 DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E.  
 ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE  
 ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW  
 YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS 'A'  
 MISDEMEANOR.

DWG NO:  
 A-512