



DESIGN & CONSTRUCTION GROUP
THE GOVERNOR NELSON A. ROCKEFELLER
EMPIRE STATE PLAZA
ALBANY, NY 12242

ADDENDUM NO. 2 TO PROJECT NO. 47193

**HVAC WORK
PROVIDE VENTILATION SYSTEM
DOT REGION 9
TIOGA COUNTY
1497 STATE ROUTE 96
OWEGO, NY**

September 5, 2023

NOTE: This Addendum forms a part of the Contract Documents. Insert it in the Project Manual. Acknowledge receipt of this Addendum in the space provided on the Bid Form.

CONTRACTING REQUIREMENTS

1. DOCUMENT 007310 SUPPLEMENTARY CONDITIONS SUPERVISION: Add the accompanying Document (page 007310 – 1 thru 007310 - 2) to the Project Manual.
2. DOCUMENT 007311 SUPPLEMENTARY CONDITIONS PAYMENT: Add the accompanying Document (page 007311 – 1) to the Project Manual.

HVAC WORK

3. Page 230719 – 3, Add the following Article to PART 2 PRODUCTS:

“2.05 JACKETS

- A. Canvas Jackets: Cotton duck, fire retardant, complying with NFPA 701, 4 oz per square yard.”

HVAC DRAWINGS

4. Revised Drawings:
 - a. Drawing No. G-002, noted “ADDENDUM #2 8/25/2023” accompanies this Addendum and supersedes the same numbered originally issued drawing.

END OF ADDENDUM

Brady M. Sherlock, P.E.
Director, Division of Design
Design & Construction

DOCUMENT 007310

SUPPLEMENTARY CONDITIONS - CONTRACTOR'S SUPERVISION

This supplement modifies the General Conditions. Where any part of the General Conditions is modified by this supplement, the unaltered provisions of that part shall remain in effect.

ARTICLE 6 - CONTRACTOR'S SUPERVISION

ARTICLE 6 Delete this Article in its entirety and replace with the following:

6.1 The Contractor shall designate in writing, competent supervision and/or management representatives as required below to represent the Contractor at all times with authority to act for the Contractor. All direction given to the Contractor's representatives shall be as binding as if given to the Contractor. A superintendent or project manager shall be classified as management representatives included in the Contractor's overhead and shall perform management, supervisory and/or administrative tasks (non labor) only. Individuals listed under this Article shall have the ability to effectively communicate (verbal and written) with all parties associated with the administration/supervision of this contract.

6.1.1 For contracts awarded up to \$1,000,000 the Contractor shall provide a supervisor, for the Contractor's staff, who shall be in attendance at the Site throughout the active performance of the Work, including active performance of the Work by subcontractors.

6.1.2 For contracts awarded from \$1,000,001 to \$5,000,000, the Contractor shall provide a superintendent, for the Contractor's staff, who shall be in attendance at the Site throughout the active performance of the Work until Substantial Completion. Upon Substantial Completion the Contractor shall provide a supervisor who shall be in attendance at the Site throughout the active performance of the Work until Physical Completion. The superintendent's responsibilities include, but are not limited to, directing and scheduling the Work, attending all Project meetings, coordinating and controlling the Work of subcontractors, and ensuring full compliance with the Contract documents. The Contractor shall also provide a project manager for the Contractor's staff from award through Substantial Completion. The Project Manager's responsibilities shall include, but are not limited to, developing and maintaining the submittal system and project schedules, attending Project meetings, making purchasing and cost decisions on behalf of the Contractor, Orders on Contract responses and negotiations, and closeout and warranty documentation. The Contractor shall provide required information to the Director's Representative for the Project schedule.

6.1.3 For contracts awarded from \$5,000,001 to \$10,000,000, in addition to the requirements of Article 6.1.2, the contractor shall provide a Project Manager for the Contractor's staff that shall be in attendance at the site throughout the active performance of the Work until Substantial Completion.

6.1.4 For contracts awarded for more than \$10,000,000, in addition to the requirements set forth in Article 6.1.3, if at any time the Contractor has more than five subcontractors performing Work on the Site simultaneously, the Contractor shall provide an additional Superintendent to coordinate the Work of the subcontractors.

6.2 Should the Director deem any employees of the Contractor not satisfactory or unfit for their duty, the Contractor shall dismiss them and they shall not again be employed on the Work.

6.2.1 Dismissible infractions for project managers, superintendents, or supervisors include, but are not limited to, the failure to develop and maintain Project schedules, failure to comply and enforce

safety regulations, failure to schedule inspections or provide adequate notice as required by Contract Documents, failure to attend and adequately prepare for meetings as required by Contract Documents, and failure to follow directions regarding the Work provided by the Director's Representative.

6.3 The experience levels noted below in this Article will be used in evaluating the qualifications and experience of the supervisors, superintendents, and Project Managers, as applicable.

6.3.1 Supervisors, required by paragraph 6.1.1, shall have a minimum of five years of experience in the role of supervisor with a minimum of three projects of similar size and scope, and shall be subject to review and written approval by the Director's Representative before commencing the Work, and subsequently during the course of the Project if the supervisor is replaced after Work has commenced. The Contractor will provide references to validate qualifications of the proposed supervisor upon request.

6.3.2 Superintendents, required for any contracts awarded above \$1,000,000 as set forth in Article 6.1.2, shall have a minimum of five years of experience in the role of Superintendent with a minimum of three projects of similar size and scope, and shall be subject to review and written approval by the Director's Representative before commencing the Work, and subsequently during the course of the Project if the Superintendent is replaced after Work has commenced. The Contractor will provide references to validate qualifications of the proposed Superintendent upon request.

6.3.3 The Project Manager, required for any contracts awarded above \$1,000,000 as set forth in Article 6.1.2, shall have a minimum of five years of experience in the role of Project Manager with a minimum of three projects of similar size and scope, and shall be subject to review and written approval by the Director's Representative before commencing the Work, and subsequently during the course of the Project if the Project Manager is replaced after Work has commenced. The Contractor will provide references to validate qualifications of the proposed Project Manager upon request.

6.4 No subcontractor shall be allowed at the Work Site before approval by the Director and the Contracting Officer. Before any part of the Contract shall be sublet or material purchased, the Contractor shall submit to the Director in writing the name of each proposed subcontractor and supplier and obtain the Director's written consent to such subcontractor and supplier. The names shall be submitted in ample time to permit acceptance or rejection of each proposed subcontractor and supplier by the Director or Contracting Officer without causing delay in the Work of the Project. The Contractor shall promptly furnish such information as the Director or Contracting Officer may require concerning the proposed subcontractor's and supplier's ability and qualifications, and certification status as a Minority- and Women-Owned Business Enterprises and/or Service-Disabled Veteran-Owned Business. Each request for approval of a subcontractor whose subcontract will be valued at \$10,000 or more shall also be accompanied by a NYS Vendor Responsibility Questionnaire - For-Profit Construction properly completed and executed by the proposed subcontractor.

6.5 The Contractor's use of subcontractors shall not diminish the Contractor's obligations to complete the Work in accordance with the Contract. The Contractor shall control and coordinate the Work of its subcontractors.

6.6 The Contractor shall be responsible for informing its subcontractors and suppliers of all the terms, conditions and requirements of the Contract Documents including, but not limited to, the General Conditions, Supplementary Conditions, the Drawings and Specifications, Appendix A, and changes made by Addenda and Orders on Contract.

END OF DOCUMENT

DOCUMENT 007311

SUPPLEMENTARY CONDITIONS – PAYMENT

This supplement modifies the General Conditions. Where any part of the General Conditions is modified by this supplement, the unaltered provisions of that part shall remain in effect.

ARTICLE 21 - PAYMENT

Add the following sub-paragraph:

21.2.1 The Director or the Contracting Officer may withhold payment requisitions or refuse to approve a portion of a payment requisition if the Contractor fails to provide an agreed to Baseline Project Work Plan, Project Schedule Updates, Recovery Project Schedule, or other scheduling requirements in accordance with Division 01 - General Requirements.

END OF DOCUMENT

CODE DATA

THE FOLLOWING CODES ARE APPLICABLE TO THE SCOPE OF WORK.

- 2020 BUILDING CODE OF NEW YORK STATE (BCNYS 2020)
2020 EXISTING BUILDING CODE OF NEW YORK STATE (EBCNYS 2020)
2020 FIRE CODE OF NEW YORK STATE (FCNYS 2020)
2020 PLUMBING CODE OF NEW YORK STATE (PCNYS 2020)
2020 MECHANICAL CODE OF NEW YORK STATE (MCNYS 2020)
2020 ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE (ECCCNYS 2020)
2017 NATIONAL ELECTRIC CODE

PROJECT TYPE: EXISTING BUILDING ALTERATIONS - LEVEL 2

WORK INVOLVED: GENERAL CONSTRUCTION, HVAC, ELECTRICAL

EBCNYS 2020

CHAPTER 3 PROVISIONS FOR ALL COMPLIANCE METHODS

SECTION 301 ADMINISTRATION
301.3 ALTERATION, ADDITION, OR CHANGE OF OCCUPANCY
THE ALTERATIONS OF THIS EXISTING BUILDING SHALL COMPLY WITH SECTION 301.3.2 WORK AREA COMPLIANCE METHOD.

CHAPTER 6 CLASSIFICATION OF WORK

SECTION 603 ALTERATIONS - LEVEL 2
603.1 SCOPE
LEVEL 2 ALTERATIONS APPLY WHERE THE WORK AREA EXCEEDS 50 PERCENT OF THE BUILDING AREA.

603.2 APPLICATION
LEVEL 2 ALTERATIONS SHALL COMPLY WITH THE PROVISIONS OF CHAPTERS 7 AND CHAPTER 8.

CHAPTER 7 ALTERATIONS - LEVEL 1

SECTION 702 BUILDING ELEMENTS AND MATERIALS
702.6 MATERIALS AND METHODS
NEW WORK SHALL COMPLY WITH THE MATERIALS AND METHODS REQUIREMENTS IN THE BC NYS, ENERGY CODE, MC NYS, AND PC NYS, AS APPLICABLE.

SECTION 703 FIRE PROTECTION
THE LEVEL OF FIRE PROTECTION PROVIDED SHALL BE MAINTAINED.

SECTION 704 MEANS OF EGRESS
THE LEVEL OF PROTECTION PROVIDED FOR THE MEANS OF EGRESS SHALL BE MAINTAINED.

CHAPTER 8 ALTERATIONS - LEVEL 2

SECTION 801 GENERAL
801.3 COMPLIANCE
NEW CONSTRUCTION ELEMENTS, COMPONENTS, SYSTEMS, AND SPACES SHALL COMPLY WITH THE REQUIREMENTS OF THE BC NYS.

SECTION 802 BUILDING ELEMENTS AND MATERIALS
802.4 INTERIOR FINISH
THE INTERIOR FINISH OF WALLS AND CEILINGS IN EXITS AND CORRIDORS THROUGHOUT THE BUILDING SHALL COMPLY WITH THE REQUIREMENTS OF THE BC NYS.

803 FIRE PROTECTION
803.2 AUTOMATIC SPRINKLER SYSTEMS
803.2.2 GROUPS A, B, E, F-1, H, I, M, R-1, R-2, R-4, S-1, AND S-2
THE BUILDING CONTAINS OCCUPANCY GROUP S-1, REPAIR GARAGE. THE WORK AREA IS NOT SHARED BY MORE THAN ONE TENANT. THE EXITS AND CORRIDORS DO NOT SERVE AN OCCUPANT LOAD OF GREATER THAN 30. THE OCCUPANT LOAD OF THE BUILDING IS LESS THAN 30 OCCUPANTS.

IN ACCORDANCE WITH THIS SECTION, PROVISION OF A SPRINKLER SYSTEM IS CONTINGENT UPON BOTH OF THE FOLLOWING CONDITIONS:

1. THE WORK AREA IS REQUIRED TO BE PROVIDED WITH AUTOMATIC SPRINKLER PROTECTION IN ACCORDANCE WITH THE BC NYS AS APPLICABLE TO NEW CONSTRUCTION.

2. THE WORK AREA EXCEEDS 50% OF THE FLOOR AREA.

SINCE THE WORK AREA IS NOT SHARED BY MORE THAN ONE TENANT, THE EXITS DO NOT SERVE AN OCCUPANT LOAD OF MORE THAN 30 OCCUPANTS, AND THE WORK AREA IS LESS THAN 50% OF THE FLOOR AREA, AN AUTOMATIC SPRINKLER SYSTEM IS NOT REQUIRED TO BE PROVIDED.

SECTION 804 CARBON MONOXIDE DETECTION AND NOTIFICATION
804.1 CARBON MONOXIDE DETECTION AND NOTIFICATION
CARBON MONOXIDE DETECTION AND NOTIFICATION SHALL BE PROVIDED IN ACCORDANCE WITH SECTIONS 503.15 THROUGH 503.15.1.

SECTION 806 STRUCTURAL
806.2 EXISTING STRUCTURAL ELEMENTS CARRYING GRAVITY LOADS
ANY EXISTING GRAVITY LOAD-CARRYING STRUCTURAL ELEMENT FOR WHICH AN ALTERATION CAUSES AN INCREASE IN DESIGN DEAD, LIVE OR SNOW LOAD, INCLUDING SNOW DRIFT EFFECTS, OF MORE THAN 5 PERCENT SHALL BE REPLACED OR ALTERED AS NEEDED TO CARRY THE GRAVITY LOADS REQUIRED BY THE BUILDING CODE OF NEW YORK STATE FOR NEW STRUCTURES.

SECTION 809 PLUMBING
809.1 MINIMUM FIXTURES
THE OCCUPANT LOAD IS NOT INCREASED BY MORE THAN 20%; THEREFORE, PLUMBING FIXTURES FOR THE STORY ARE NOT REQUIRED TO BE PROVIDED IN QUANTITIES SPECIFIED IN THE PLUMBING CODE OF NEW YORK STATE.

SECTION 810 ENERGY CONSERVATION
810.1 MINIMUM REQUIREMENTS

LEVEL 2 ALTERATIONS TO EXISTING BUILDINGS OR STRUCTURES ARE PERMITTED WITHOUT REQUIRING THE ENTIRE BUILDING OR STRUCTURE TO COMPLY WITH THE ENERGY REQUIREMENTS OF THE ENERGY CODE. THE ALTERATIONS SHALL CONFORM TO THE ENERGY REQUIREMENTS OF THE ENERGY CODE AS THEY RELATE TO NEW CONSTRUCTION ONLY.

BCNYS 2020

CHAPTER 3 OCCUPANCY CLASSIFICATION AND USE

SECTION 311 STORAGE GROUP S
311.2 STORAGE GROUP S1 (VEHICLE STORAGE BUILDING)

CHAPTER 5 GENERAL BUILDING HEIGHTS AND AREAS
THE EXISTING BUILDING IS A ONE-STORY BUILDING APPROXIMATELY 26'-6" TALL AT THE HIGH SIDE OF THE SHED ROOF, 16'-10" AT THE LOW SIDE OF THE SHED ROOF. THE AREA OF THE BUILDING IS APPROXIMATELY 11,999 SF.

THE EXISTING BUILDING HEIGHT AND AREA CONFORMS TO CURRENT BUILDING CODE HEIGHT AND AREA LIMITATIONS.

CHAPTER 6 TYPES OF CONSTRUCTION

SECTION 602 CONSTRUCTION CLASSIFICATION
602.2 TYPE II, UNPROTECTED, NONCOMBUSTIBLE MATERIALS

CHAPTER 9 FIRE PROTECTION AND LIFE SAFETY SYSTEMS
SECTION 903 AUTOMATIC SPRINKLER SYSTEMS
903.2 WHERE REQUIRED

903.2.9 GROUP S-1 VEHICLE STORAGE BUILDING
AN AUTOMATIC SPRINKLER SYSTEM SHALL BE PROVIDED THROUGHOUT ALL BUILDINGS CONTAINING A GROUP S-1 OCCUPANCY WHERE ONE OF THE FOLLOWING CONDITIONS EXISTS:

- 1. GROUP S-1 FIRE AREA EXCEEDS 12,000 SF.
a. THE FIRE AREA OF THE EXISTING BUILDING IS 11,999 SF.
2. GROUP S-1 FIRE AREA IS LOCATED MORE THAN THREE STORIES ABOVE GRADE PLANE.
a. THE EXISTING BUILDING IS A ONE-STORY BUILDING.
3. THE COMBINED AREA OF ALL GROUP S-1 FIRE AREAS ON ALL FLOORS, INCLUDING ANY MEZZANINES, EXCEEDS 24,000 SF.
a. THE COMBINED AREA OF THE BUILDING IS 11,999 SF.
4. A GROUP S-1 FIRE AREA USED FOR THE STORAGE OF COMMERCIAL MOTOR VEHICLES WHERE THE FIRE AREA EXCEEDS 5,000 SF.
a. AT THE TIME THE BUILDING WAS CONSTRUCTED, THE BUILDING WAS NOT CONSIDERED TO BE USED FOR THE STORAGE OF COMMERCIAL MOTOR VEHICLES BY THE AUTHORITY HAVING JURISDICTION.
5. GROUP S-1 OCCUPANCY USED FOR THE STORAGE OF UPHOLSTERED FURNITURE OR MATTRESSES EXCEEDS 2,500 SF.
a. THE BUILDING IS NOT USED FOR THIS PURPOSE.

THE EXISTING BUILDING IS NOT PROTECTED BY AN AUTOMATIC SPRINKLER SYSTEM. PER EBC NYS, SECTION 803.2.2, A SPRINKLER SYSTEM IS NOT REQUIRED TO BE PROVIDED AS A PART OF THIS PROJECT SCOPE OF WORK.

CHAPTER 10 MEANS OF EGRESS

SECTION 1004 OCCUPANT LOAD
1004.5 AREAS WITHOUT FIXED SEATING
THE NUMBER OF OCCUPANTS SHALL BE COMPUTED AT THE RATE OF ONE OCCUPANT PER UNIT OF AREA AS PRESCRIBED IN TABLE 1004.5. FOR AREAS WITHOUT FIXED SEATING, THE OCCUPANT LOAD SHALL BE NOT LESS THAN THAT NUMBER DETERMINED BY DIVIDING THE FLOOR AREA UNDER CONSIDERATION BY THE OCCUPANT LOAD FACTOR ASSIGNED TO THE FUNCTION OF THE SPACE AS SET FORTH IN TABLE 1004.5.

EXCEPTION: WHERE APPROVED BY THE BUILDING OFFICIAL, THE ACTUAL NUMBER OF OCCUPANTS FOR WHOM EACH OCCUPIED SPACE, FLOOR OR BUILDING IS DESIGNED, ALTHOUGH LESS THAN THOSE DETERMINED BY CALCULATION, SHALL BE PERMITTED TO BE USED IN THE DETERMINATION OF THE DESIGN OCCUPANT LOAD.

TABLE 1004.5 MAXIMUM FLOOR AREA ALLOWANCES PER OCCUPANT
0 PARKING GARAGES: 1 OCCUPANT / 200 GROSS SQUARE FEET = 11,999 / 200 = 60 OCCUPANTS.
0 THE ACTUAL NUMBER OF OCCUPANTS FOR WHOM THE SPACE IS DESIGNED IS NO MORE THAN FIFTEEN (15). PER THE EXCEPTION TO 1004.5, THE ACTUAL NUMBER OF OCCUPANTS MAY BE USED TO DETERMINE THE DESIGN OCCUPANT LOAD WHERE APPROVED BY THE BUILDING OFFICIAL.

MCNYS 2020

CHAPTER 4 VENTILATION
SECTION 401 GENERAL
401.2 VENTILATION REQUIRED
THIS BUILDING IS REQUIRED TO BE VENTILATED BY MECHANICAL MEANS IN ACCORDANCE WITH SECTION 403.

401.3 WHEN REQUIRED
VENTILATION IS REQUIRED DURING PERIODS THAT THE SPACE IS OCCUPIED.

401.4 INTAKE OPENING LOCATIONS
AIR INTAKE OPENINGS SHALL COMPLY WITH ALL OF THE FOLLOWING:
1. INTAKE OPENINGS SHALL BE LOCATED NOT LESS THAN 10 FEET FROM LOT LINES OR BUILDINGS ON THE SAME LOT.
2. MECHANICAL OUTDOOR AIR INTAKE OPENINGS SHALL BE LOCATED NOT LESS THAN 10 FEET HORIZONTALLY FROM ANY HAZARDOUS OR NOXIOUS CONTAMINANT SOURCE.
3. INTAKE OPENINGS SHALL BE LOCATED NOT LESS THAN 3 FEET BELOW CONTAMINANT SOURCES WHERE SUCH SOURCES ARE LOCATED WITHIN 10 FEET OF THE OPENING.
4. INTAKE OPENINGS ON STRUCTURES IN FLOOD HAZARD AREAS SHALL BE AT OR ABOVE THE ELEVATIONS REQUIRED BY SECTION 1612 OF THE BC NYS FOR UTILITIES AND ATTENDANT EQUIPMENT.

401.5 INTAKE OPENING PROTECTION
AIR INTAKE OPENINGS THAT TERMINATE OUTDOORS SHALL BE PROTECTED WITH CORROSION-RESISTANT SCREENS, LOUVERS, OR GRILLES. PER TABLE 401.5, OPENINGS SHALL BE GREATER THAN 1/4" AND LESS THAN 1" OPENINGS SHALL BE PROTECTED AGAINST LOCAL WEATHER CONDITIONS. OUTDOOR AIR INTAKE OPENINGS LOCATED IN EXTERIOR WALLS SHALL MEET THE PROVISIONS FOR EXTERIOR WALL OPENING PROTECTIVES IN ACCORDANCE WITH THE BC NYS.

SECTION 403 MECHANICAL VENTILATION
403.1 VENTILATION SYSTEM
MECHANICAL VENTILATION SHALL BE PROVIDED BY A METHOD OF SUPPLY AIR AND RETURN OR EXHAUST AIR. THE AMOUNT OF SUPPLY AIR SHALL BE APPROXIMATELY EQUAL TO THE AMOUNT

OF RETURN AND EXHAUST AIR. THE SYSTEM SHALL BE PROHIBITED FROM PRODUCING NEGATIVE OR POSITIVE PRESSURE. THE SYSTEM TO CONVEY VENTILATION AIR SHALL BE DESIGNED AND INSTALLED IN ACCORDANCE WITH MC NYS CHAPTER 6.

403.2 OUTDOOR AIR REQUIRED
THE MINIMUM OUTDOOR AIRFLOW RATE SHALL BE DETERMINED IN ACCORDANCE WITH SECTION 403.3.

403.2.1 RECIRCULATION OF AIR
THE OUTDOOR AIR REQUIRED SHALL NOT BE RECIRCULATED.

403.3 OUTDOOR AIR AND LOCAL EXHAUST AIRFLOW RATES

TABLE 403.3.1.1 MINIMUM VENTILATION RATES
ENCLOSED PARKING GARAGES, EXHAUST AIRFLOW RATE: 0.75 CFM / SF OF THE OCCUPIED FLOOR AREA SERVED.

SECTION 404 ENCLOSED PARKING GARAGES
404.1 ENCLOSED PARKING GARAGES
THE MECHANICAL VENTILATION SYSTEM SHALL BE AUTOMATICALLY OPERATED BY MEANS OF CARBON MONOXIDE DETECTORS APPLIED IN CONJUNCTION WITH NITROGEN DIOXIDE DETECTORS. AUTOMATIC OPERATION SHALL CYCLE THE VENTILATION SYSTEM BETWEEN THE FOLLOWING TWO MODES OF OPERATION:
1. FULL-ON AT AN AIRFLOW RATE OF NOT LESS THAN 0.75 CFM / SF OF THE FLOOR AREA SERVED.
2. STANDBY AT AN AIRFLOW RATE OF NOT LESS THAN 0.05 CFM / SF OF THE FLOOR AREA SERVED.

SECTION 405 SYSTEMS CONTROL
405.1 GENERAL
MECHANICAL VENTILATION SYSTEMS SHALL BE PROVIDED WITH AUTOMATIC CONTROLS THAT WILL OPERATE SUCH SYSTEMS WHENEVER THE SPACES ARE OCCUPIED.

DESIGN & CONSTRUCTION

CONSULTANT
CERTIFICATE OF AUTHORIZATION #: 0020435




BUILDING CODE COMPLIANCE:

UNIFORM CODES STATEMENT: TO THE BEST OF MY KNOWLEDGE, BELIEF AND PROFESSIONAL JUDGEMENT, THE CONTRACT DRAWINGS AND SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 NYS ENERGY CONSERVATION CONSTRUCTION CODE.

ENERGY CODE COMPLIANCE:

ENERGY CODE STATEMENT: TO THE BEST OF MY KNOWLEDGE, BELIEF AND PROFESSIONAL JUDGEMENT, THE CONTRACT DRAWINGS AND SPECIFICATIONS ARE IN COMPLIANCE WITH THE 2020 NYS ENERGY CONSERVATION CONSTRUCTION CODE.

WARNING: THE ALTERATION OF THIS MATERIAL IN ANY WAY, UNLESS DONE UNDER THE DIRECTION OF A COMPARABLE PROFESSIONAL, I.E. ARCHITECT FOR AN ARCHITECT, ENGINEER FOR AN ENGINEER OR LANDSCAPE ARCHITECT FOR A LANDSCAPE ARCHITECT, IS A VIOLATION OF THE NEW YORK STATE EDUCATION LAW AND/OR REGULATIONS AND IS A CLASS "A" MISDEMEANOR.

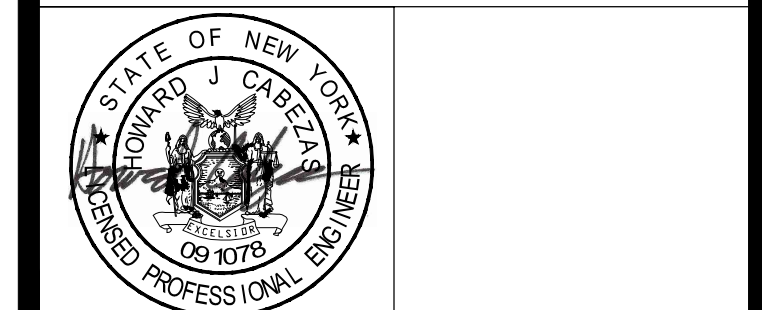

REGISTRATION EXPIRES: 08/31/2023

CONTRACT: HVAC

TITLE: PROVIDE VENTILATION SYSTEM IN TRUCK GARAGE

LOCATION: DOT REGION 9, TIOGA COUNTY
1497 STATE ROUTE 96
OWEGO, NY

CLIENT: DEPARTMENT OF TRANSPORTATION

Table with 3 columns: MARK, DATE, DESCRIPTION. Includes project number 47193-H and design dates 08/25/2023 and 05/19/2023.

CODE INFORMATION AND CODE COMPLIANCE PLAN

DRAWING NUMBER: G-002

ADDENDUM DRAWING
08/25/2023